



Cite this: *Environ. Sci.: Water Res. Technol.*, 2023, 9, 1436

## Stay in the loop: lessons learned about the microbial water quality in pipe loops transitioned from conventional to direct potable reuse water†

Lauren C. Kennedy, <sup>‡abc</sup> Scott E. Miller, <sup>‡ab</sup> Rose S. Kantor,<sup>ab</sup>  
Hannah Greenwald, <sup>ab</sup> Michael J. Adelman,<sup>d</sup> Hari Seshan,<sup>e</sup>  
Paige Russell <sup>f</sup> and Kara L. Nelson <sup>\*ab</sup>

Direct potable reuse offers water-scarce regions a local and reliable source of drinking water, but few studies have investigated the effect of introducing advanced-treated wastewater to drinking water distribution systems on microbial water quality. We aimed to characterize the impact on microbial water quality of transitioning a drinking water distribution system fed with conventionally-treated surface water to a blend with advanced-treated wastewater. Three pipe loops were fed with the same source water (conventional water alone or blended with advanced-treated wastewater) for 21 weeks, and two pipe loops transitioned from conventional water to advanced-treated wastewater (*i.e.*, conditioned reverse osmosis permeate) after the first 10 weeks. Microbial water quality was evaluated *via* flow cytometry-based cell counts, adenosine triphosphate concentrations, quantitative PCR, and 16S rRNA gene amplicon sequencing. Handling (*i.e.*, conveyance, transportation, and storage) of reverse osmosis permeate introduced bioavailable carbon, which resulted in high microbial abundance in the advanced-treated wastewater that was fed to the pipe loops. In the pipe loops, the microbial community profile in the bulk water and biofilm reflected that of the primary feedwater (*i.e.*, conventionally-treated surface water or advanced-treated wastewater). The antibiotic resistance gene *sul1* was detected in all samples, increased in absolute abundance in the RO permeate after handling, and increased in relative and absolute abundance in the bulk water and biofilm of pipe loops after the transition. In addition, 21 amplicon sequence variants (ASVs) were significantly enriched or depleted in the bulk water and biofilm of pipe loops after the transition. Of these ASVs, one *Pseudomonas*-classified ASV was present in the RO permeate, increased in estimated absolute abundance during RO handling, and remained at high estimated absolute abundance in pipe loops fed with primarily advanced-treated wastewater. Thus, advanced-treated wastewater has potential to be a source of antibiotic resistance and opportunistic pathogens in drinking water distribution systems. Though these contaminants will likely be low in abundance following treatment, nutrients introduced during storage or conveyance of advanced-treated wastewater could increase the abundance of antibiotic resistance genes and opportunistic pathogens. To ensure that risks are not elevated compared to conventional source waters, enhanced monitoring is recommended, that begins two years before the transition to direct potable reuse, continues for two years after, and includes absolute microbial abundance as well as screening for opportunistic pathogens and antibiotic resistance genes.

Received 11th November 2022,  
Accepted 3rd March 2023

DOI: 10.1039/d2ew00858k

rs.li/es-water

### Water impact

Direct potable reuse is becoming a realistic option for water-stressed cities, but there are knowledge gaps about the microbial impacts from introducing advanced-treated wastewater to drinking water distribution systems. Engineering consultants, water utility representatives, and academic researchers collaborated on this research that will inform future bench- and pilot-scale studies as well as full-scale direct potable reuse systems.

<sup>a</sup> Department of Civil and Environmental Engineering, College of Engineering, University of California, Berkeley, CA, USA. E-mail: karanelson@berkeley.edu

<sup>b</sup> National Science Foundation Engineering Research Center for Re-inventing the Nation's Urban Water Infrastructure, Berkeley, CA, USA

<sup>c</sup> Department of Civil and Environmental Engineering, College of Engineering, Stanford University, Stanford, CA, USA

<sup>d</sup> Stantec, Pasadena, CA, USA

<sup>e</sup> Tyr Group, Brisbane, Queensland, Australia

<sup>f</sup> Brown and Caldwell, San Diego, CA, USA

† Electronic supplementary information (ESI) available. See DOI: <https://doi.org/10.1039/d2ew00858k>

‡ Authors contributed equally to the work.



# 1. Introduction


Direct potable reuse offers water-scarce regions a local and reliable source of drinking water through advanced treatment of wastewater. A growing body of research has demonstrated that advanced treatment of wastewater can yield a finished water that meets or exceeds water quality standards for drinking water by providing treatment barriers against pathogens and chemical contaminants.<sup>1–5</sup> Direct potable reuse alternatives include i) raw water augmentation, in which advanced-treated wastewater is blended with raw water supplies upstream of a drinking water treatment plant and ii) treated water augmentation, in which advanced-treated wastewater is directly introduced into a drinking water distribution system. In some cases, direct potable reuse is an attractive alternative for reuse systems because it could reduce costs and energy associated with conveyance, pumping, and storage in environmental buffers.<sup>6</sup> Potable reuse in general has system-level impacts on all aspects of the engineered water cycle, and direct potable reuse in particular has important water quality implications for drinking water systems.<sup>7</sup> However, few studies have investigated the impacts that direct potable reuse may have on chemical and microbial water quality in drinking water distribution systems and premise plumbing.<sup>8–11</sup> One recent bench-scale study investigated the effects of DPR blending on treatability at a conventional drinking water plant, but noted potential impacts on distribution system water chemistry and microbiology as topics for future study.<sup>12</sup>

Drinking water distribution system water quality is a topic of great importance, with particular interest in improving the fundamental understanding of microbial water quality and biofilms. Drinking water distribution systems contain biofilm microbial communities, and changes in feedwater quality in the system have been shown to affect biofilm microbial community composition and absolute abundance.<sup>13–15</sup> The water quality of advanced-treated wastewater can differ from conventional drinking water in ways that could affect the microbial water quality of the drinking water distribution system. For example, advanced treatment using reverse osmosis or nanofiltration will yield permeate with low concentrations of organic carbon,<sup>13,16</sup> which could affect raw or treated water augmentation direct potable reuse systems. Based on studies of conventional drinking water distribution systems, lower concentrations of carbon, nutrients, or ions in advanced-treated wastewater can lead to sloughing of existing loose deposits and biofilm,<sup>14,17</sup> reduced rates of chlorine decay during distribution,<sup>18</sup> and reduced growth of distribution system microorganisms<sup>13</sup> (e.g., opportunistic pathogens such as *Mycobacterium* spp. and *Legionella pneumophila*). For example, previous studies have observed significant, positive correlations between organic carbon and *Mycobacterium* spp.,<sup>19</sup> *Legionella pneumophila*,<sup>20</sup> and *Vermamoeba vermiformis*<sup>20</sup> (formerly known as *Hartmanella vermiformis*; an amoebal host for *Legionella pneumophila*<sup>21</sup>) in full-scale and simulated distribution systems.

Direct potable reuse, and particularly treated water augmentation, is still an emerging approach to potable reuse. Raw water augmentation projects and the associated regulatory framework are underway in several regions, and, to date, only three full-scale treated water augmentation systems are documented in the world.<sup>22</sup> Because these systems are uncommon, bench- and pilot-scale simulation experiments can help identify microbial issues that could arise prior to new full-scale implementation. However, simulating a drinking water distribution system effectively is difficult and care must be taken in extending the results to full-scale systems. In one study simulating an upgrade of a conventional drinking water treatment facility to include membrane filtration, organic carbon and biomass decreased in bulk water and biofilm.<sup>13,16</sup> However, full-scale upgrades in conventional treatment have been associated with immediate increases in biofilm sloughing.<sup>14,23</sup> One reason for discrepancies between simulated and full-scale system findings is that tradeoffs must be made during the design of simulated systems. In particular, decisions are made about which design parameters or operational conditions are prioritized to mimic a full-scale system (e.g., shear force, flow rate, or water age).<sup>24</sup> Studies of microbial water quality in particular require additional design considerations, such as including a sufficient conditioning period to establish biofilm in the simulated distribution system,<sup>25–28</sup> obtaining samples with enough biomass for analyses, and achieving realistic primary and secondary disinfectant conditions. While there are plans for both raw and treated water augmentation systems (e.g., in San Diego, CA and El Paso, TX<sup>1</sup> respectively), there are major knowledge gaps regarding the microbial impacts of a transition from an existing conventional system to one that incorporates direct potable reuse.<sup>8,10,9,11</sup> Another challenge is that studying these impacts requires co-location of advanced-treated wastewater and conventional drinking water. Given the rarity of full-scale or treated water augmentation systems as well as the importance of filling knowledge gaps about these systems, more guidance is needed for simulated treated water augmentation system study design.

The objectives of this work were to: (i) characterize the impact on microbial water quality from transitioning a pilot-scale piped drinking water distribution system fed with conventionally-treated surface water to a treated water augmentation system; and (ii) evaluate the tradeoffs made in the study design to provide recommendations for future direct potable reuse simulation studies. We partnered with a water utility to design and operate an experimental setup of five simulated distribution systems (i.e., pipe loops). The pipe loops were fed different blends of conventionally-treated and advanced-treated waters over the course of two phases of operation (in total 21 weeks; Fig. 1), during which bulk water and biofilm samples were collected from each pipe loop to assess microbial water quality. Microbial



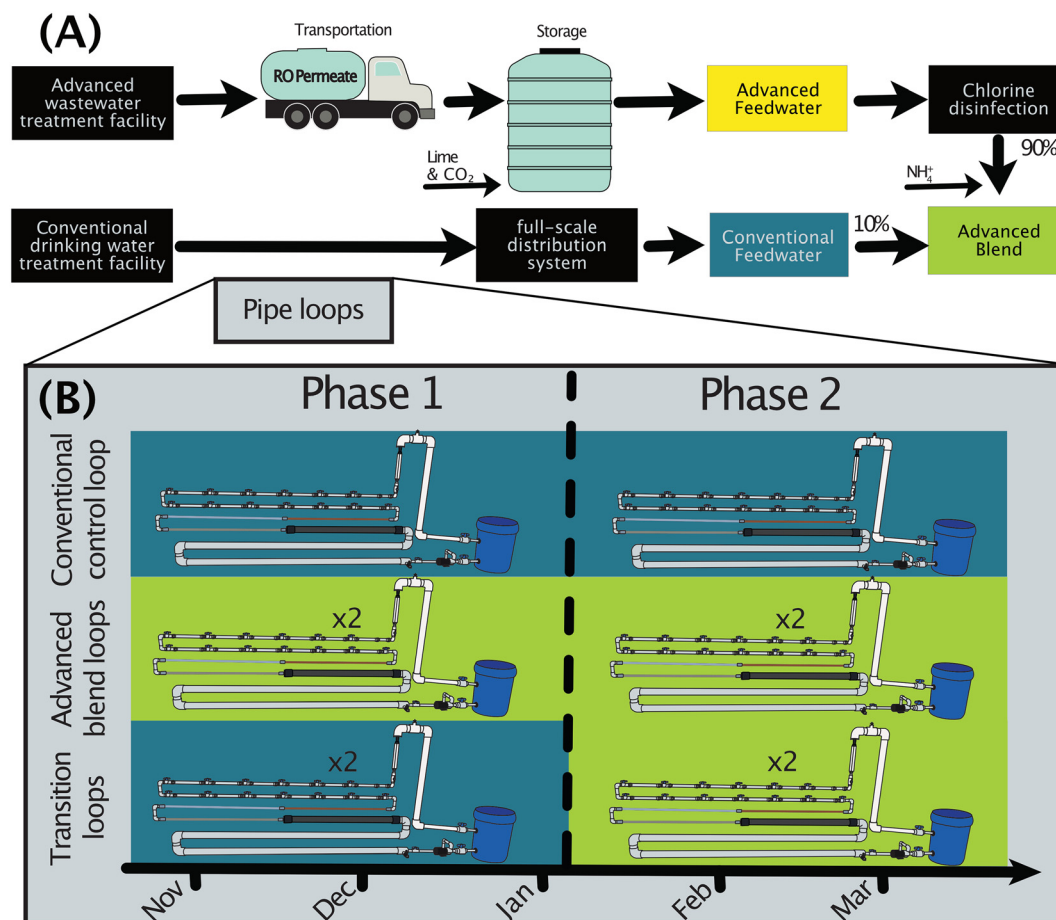

**Fig. 1** (A) Feedwaters and origins. RO permeate originated from the advanced wastewater treatment facility and was transported to the pipe loop study location, conditioned, and stored until use. Conventional feedwater originated from a tap in the full-scale conventional drinking water distribution system. The advanced blend consisted of 10% conventional feedwater and 90% advanced feedwater. Pipe loops were located onsite at the conventional drinking water treatment facility. (B) Pipe loop feedwater composition for the pipe loops during Phases 1 (10/23/17–1/5/18) and 2 (1/5/18–3/26/18) and naming conventions used throughout (left side).

water quality was evaluated *via* flow cytometry-based cell counts, adenosine triphosphate (ATP) concentration, quantitative PCR (qPCR), and 16S rRNA gene amplicon sequencing. qPCR targets were the 16S rRNA gene, one free-living amoeba, two opportunistic pathogens, and two antibiotic resistance genes. To our knowledge, this study is the first to investigate the microbial impacts of the transition from a conventional drinking water distribution system to a treated water augmentation system.

## 2. Methods

To simulate a transition of a drinking water distribution system to treated water augmentation, conventionally-treated drinking water and advanced-treated wastewater were fed to five pilot-scale pipe loops in a covered, outdoor area at a conventional drinking water treatment facility (Fig. 1).

### 2.1. Origins of pipe loop feedwaters

The chloraminated conventionally-treated drinking water was obtained onsite (“conventional feedwater”). The advanced-

treated wastewater (“advanced feedwater”) originated from a demonstration-scale advanced wastewater treatment facility to demonstrate suitability for potable reuse, at which tertiary-treated wastewater effluent underwent ozonation, biologically active carbon filtration, microfiltration, and reverse osmosis (“RO”) before collection for this study. RO permeate was transported *via* tanker truck from the advanced wastewater treatment facility and stored in a tank onsite at the drinking water treatment facility until use as advanced feedwater (Fig. 1A). Post-RO stabilization is an important step in full-scale potable reuse systems, so the advanced feedwater was conditioned with calcium hydroxide (“lime”) and carbon dioxide gas to achieve an alkalinity of 75–100 mg L<sup>-1</sup> as CaCO<sub>3</sub> and a pH of 8 in the range of typical post-stabilization targets. To compare the water quality in the advanced feedwater to that of the RO permeate, we utilized a previously published dataset for the RO permeate.<sup>29</sup>

To compare the water quality in the pipe loops to that in the full-scale distribution system, three additional sites in the distribution system were sampled and combined with a previously published dataset on microbial abundance (DWDS



F)<sup>30</sup> from the same system (“full-scale distribution system”). Utility drinking water distribution system taps were sampled six times between February 14, 2018 and April 26, 2018, and the sites were selected to include a range in water age (50.6 h, 70.0 h, and 289 h). The water ages were provided by the utility based on an internal model (SynerGEE Water; v4.7.0).

## 2.2. Pipe loop design and start-up

To mimic the materials used in the full-scale distribution system and premise plumbing, the five identical pipe loops were constructed using copper, galvanized iron, leaded brass, and cement-lined ductile iron pipe segments, with the majority of piping made from PVC (Fig. S1†). Twelve removable segments of 0.3 m length PVC pipe, with true-union fittings and isolation valves between each segment, were installed in each pipe loop for biofilm collection. Pipe lengths and diameters are provided in the ESI†.

Each loop included a reservoir for blending, a recirculation pump, a sample tap, a rotameter, and a hydraulic loop to ensure full flow in all pipes (Fig. S1†). The hydraulic loop had a syringe filter on its air vent to prevent intrusion of airborne bacteria. Water was recirculated continuously in each pipe loop at a flow rate of 30.3 L min<sup>-1</sup> (8 gallons per minute). This achieved a fluid shear of 0.25 N m<sup>-2</sup> on the inner surfaces of each PVC pipe segment used for biofilm collection, to simulate typical shear forces in drinking water distribution pipes.<sup>24</sup> The pipe loops were designed to recirculate 100 L batches of water with residence times roughly equal for both the piping and reservoir sections of each pipe loop (1.9 and 1.8 minutes, respectively).

During start up, pipe loops were disinfected by recirculating 100 L of conventional drinking water with a high free chlorine residual (100 mg L<sup>-1</sup> as Cl<sub>2</sub>), rinsed with four full batches of conventional drinking water, and then inoculated with concentrated biomass from the full-scale drinking water distribution system. The concentrated inoculum biomass was divided evenly across the five pipe loops and mixed with a fresh 100 L batch of conventional feedwater. The pipe loops recirculated the inoculum for seven days, after which, Phase 1 of the study began (Fig. 1B). More information on pipe loop start up can be found in the ESI† (e.g., inoculum preparation, inoculation of the pipe loops).

## 2.3. Pipe loop batching and operation

The pipe loops recirculated conventional feedwater that was either unaltered (“conventional”) or blended with advanced-treated wastewater (“advanced blend”) (Fig. 1B). The advanced blend contained 10% conventional feedwater and 90% advanced feedwater. The partner utility expected to have an annual average of 40% advanced-treated wastewater in the planned full-scale system. However, 90% advanced-treated wastewater was selected as a conservative but realistic blending scenario (e.g., drought conditions). Two pipe loops were fed with the advanced blend throughout the study (“advanced blend loops”), two were fed with conventional

feedwater for 10 weeks followed by the advanced blend for 11 weeks (“transition loops”), and one was fed with conventional feedwater throughout the study (“conventional control loop”). The pipe loops were operated in semi-batch mode such that the loops were fully drained and replenished with fresh feedwater every 3.5 days, which simulated a conservative water age for the full-scale drinking water distribution system (only 12% of the network contains water with an age of three days or more).

To prepare a batch of water for recirculation, 100 L of conventional feedwater was added into the pipe loop reservoir for pipe loops fed with conventional feedwater. For pipe loops fed with the advanced blend (i.e., the advanced blend loops in Phases 1 and 2 and the transition loops in Phase 2), 90 L of advanced feedwater was added to the reservoir and disinfected using free chlorine (Clorox bleach; 5% w/v) to target a CT of 45 mg-min L<sup>-1</sup>. Free chlorine was converted to chloramines *via* addition (in excess) and mixing of lab-grade ammonium chloride in the pipe loop reservoir, which simulated the use of chloramines in the full-scale distribution system. There were two short-term batch preparation protocols that deviated from standard operating procedures in Phase 1, including testing a seven-day recirculation period for all pipe loops and storing the conventional feedwater prior to use (more information in the ESI†). In total, there were 41 recirculation periods during the study.

## 2.4. Discrepancies in pipe loop operation conditions

Despite attempts to maintain consistent operating conditions across the five pipe loops and over time, there were three main discrepancies observed. These involved differences in temperature, conventional feedwater cell counts, and chlorine concentration. It is important to keep these differences in mind when interpreting the results. The first discrepancy observed was that the temperatures of the pipe loop bulk waters were lower in Phase 2 compared to Phase 1 (Fig. S3†), following a drop in the outside ambient air temperature from a seasonal change: fall to winter and early spring. The second discrepancy observed was that total and intact cell counts in the conventional feedwater declined during Phase 1 but slightly increased in the advanced feedwater throughout the study (Fig. S2†). The decrease in cell counts observed in the conventional feedwater could be from the decrease in temperature concurrent with the change in seasons. Other researchers have observed microbial water quality effects from changes in season in full-scale conventional drinking water distribution systems.<sup>31–33</sup> The increase in cell counts observed in the advanced feedwater could be from longer residence times in the reservoir at the end of the study: the final three deliveries of RO permeate to the study site had an average of 14 days between deliveries compared to the overall average of 6.1 days between deliveries. The third discrepancy observed was that chlorine concentrations at the end of recirculation periods were





frequently low (*i.e.*,  $<0.2 \text{ mg L}^{-1}$ ; Fig. S4A and Table S3†). Loops 3–5 did not have any total chlorine measurements at the end of recirculation periods that were below the method detection limit ( $0.02 \text{ mg L}^{-1}$ ). In contrast, Loops 1 and 2 had total chlorine measurements at the end of recirculation periods that were more frequently below detection limit: 16.7% of Loop 1 samples in Phase 1, 9.1% of Loop 1 samples in Phase 2, 5.6% of Loop 2 samples in Phase 1, and 4.5% of Loop 2 samples in Phase 2 (Table S3†). The average total chlorine concentration at the end of recirculation periods was higher in Loop 3 during Phase 1 ( $0.56 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ), Loop 4 during Phase 1 ( $0.50 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ), and Loop 5 during Phase 2 ( $0.79 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ) compared to other pipe loops and phases (range from  $0.096$  to  $0.26 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ; Table S3†).

### 2.5. Field water quality analysis and grab sampling

Bulk water in the feedwaters and pipe loops were evaluated by various field and laboratory measurements of physicochemical variables (Table S1†). Temperature and pH (Electrode Sealed SJ F; Fisher Scientific) and residual chlorine (DPD method, HACH® pocket colorimeter II; Hach) were measured in daily grab samples from pipe loops. Other variables including major ions, heavy metals, and general characteristics were measured either semi-weekly or weekly from grab samples (Table S1†). The method detection limits for both the free and total chlorine were  $0.02 \text{ mg L}^{-1}$ . A summary of the physical and chemical water quality parameters is presented in Table S4†.

We sampled bulk water for cell counts by flow cytometry, ATP, batch growth assays, qPCR targets, and 16S rRNA gene amplicon sequencing analyses (Table S2†). Before sample collection, sample taps were disinfected with 70% ethanol, flushed (to remove cells sloughing from the tap fixture and piping) at maximum flow rate to achieve the following: at least five minutes of flush flow (full-scale drinking water distribution system, RO permeate, and conventional feedwater), at least two minutes of flush flow (advanced feedwater), and about 1 L of flush volume (pipe loop sampling ports). Grab samples of water for cell counts and ATP quantification were collected in 500 mL autoclave-sterilized glass bottles containing excess sodium thiosulfate to quench residual chlorine, transported on ice, and stored at  $4 \text{ }^\circ\text{C}$  until further processing. Flow cytometry and ATP assays were completed within 48 hours of sample collection. For pipe loop bulk water samples, cell counts and ATP were quantified for 66% and 63% of recirculation periods respectively, and samples were collected at the end of a recirculation period (for 24 and 23 recirculation periods, respectively) or one day before the end of the recirculation period (for three recirculation periods) unless otherwise noted. The qPCR targets and 16S rRNA gene amplicon library preparation and sequencing were completed after ultrafiltration and further processing of bulk water biomass in the laboratory.

We performed batch growth assays on RO permeate samples collected after each step of conveyance, transportation, and storage before blending in pipe loop reservoirs as previously described with slight modifications.<sup>34</sup> Briefly, growth potential was assessed by measuring the change in total cell counts in bulk water after incubation at  $30 \text{ }^\circ\text{C}$  for five days. Prior to incubation, 1 mL of microbial inoculum (unfiltered bottled mineral water; Evian, France) was added to samples along with inorganic nutrient and mineral stock solutions to induce carbon-limiting conditions.<sup>35</sup> Following incubation at  $30 \text{ }^\circ\text{C}$  with mixing by inversion once daily, all samples were stored at  $4 \text{ }^\circ\text{C}$  and processed within three days of collection. Carbon-free glassware, filters, consumables, and nutrient solutions were prepared as described previously.<sup>36</sup>

### 2.6. Dead-end ultrafiltration concentration of bulk water

For qPCR and 16S rRNA gene amplicon sequencing analyses, bulk water biomass was concentrated using dead-end ultrafiltration as previously described<sup>29,37</sup> with different volumes concentrated depending on the biomass and volume available by sample type: pipe loop bulk water (50–120 L), pipe loop feedwaters (100–700 L), drinking water distribution system water (350–1000 L), and RO permeate (700–4000 L) as previously described.<sup>29</sup> For pipe loop samples, bulk water biomass was only collected at the end of a recirculation period, and it was collected for 39% of the recirculation periods in the study. Briefly, ultrafilters (REXEED 25S, Henry Schein, Melville, NY) were soaked overnight in bovine calf serum (5% w/v) and rinsed *via* crossflow filtration with sample water prior to filtering the sample. After sample filtration, ultrafilters were transported to the laboratory on ice and backflushed with sterile backflush solution (0.5% w/v Tween 80, 0.01% w/v sodium polyphosphate, and 0.001% w/v Y-30 antifoam emulsion). Backflush was collected in an autoclaved 1 L glass bottle and was used for downstream secondary concentration using polyethylene glycol (PEG) flocculation. Field blanks for dead-end ultrafiltration field sampling consisted of ultrafilters that were processed alongside samples, including overnight soaking, backflushing, and secondary concentration. After overnight soaking, field blank ultrafilters were flushed with 1 L of autoclaved deionized water (*via* crossflow filtration) to remove the soaking solution, capped with sterilized caps, brought to the field, retained at ambient temperature during sample filtration, and then returned to the laboratory for parallel processing with field samples. Nine field blanks were included for 16S rRNA gene amplicon sequencing data analysis (see Section 2.12).

### 2.7. Pipe wall biofilm sampling and analysis

Periodically, 0.3 m PVC segments (2.54 cm diameter) were removed from the pipe loops to harvest the biofilm, which was analyzed for ATP, qPCR targets, and 16S rRNA gene amplicon sequencing (Table S2†). Each biofilm sampling



event occurred either at the end of a recirculation period (for six recirculation periods) or the day before the end of the recirculation period (for two recirculation periods), and biofilm was collected for 20% of recirculation periods in the study on the following dates: 12/13/2017, 12/29/2017, 1/5/2018, 1/11/2018, 1/15/2018, 1/18/2018, 2/15/2018, and 3/26/2018. 700 mL of water from the corresponding pipe loop was filtered (0.22  $\mu\text{m}$  pore size syringe filter) and quenched with excess sodium thiosulfate. Isolation valves on either side of the segment were closed, and the entire segment exterior was wiped down with 70% ethanol to disinfect and remove accumulated dust/dirt. The segment was then isolated, removed by disconnecting the true-union fittings, drained, filled with the filtered water, capped on both ends, and transported on ice to the laboratory for further processing. The segment was replaced by a PVC segment that was disinfected (submerged in 0.5% bleach solution for >30 min) and rinsed with conventional feedwater. Each biofilm sampling event used a pipe segment that had been in place in the pipe loop since the beginning of operation: the replacement pipe segments were not sampled. Biofilm was recovered from the inside walls of the harvested pipe segments by a combination of two 3 min sonication periods (Branson 3510-DTH) and scraping. Full details are presented in the ESI.† In total, 160 to 260 mL of sample water was produced from the sonication procedure. A small aliquot (<10 mL) was analyzed for total and intracellular ATP concentrations, and the remaining sample underwent secondary concentration *via* PEG flocculation prior to DNA extraction and genomic analyses.

## 2.8. PEG flocculation

PEG flocculation was used to concentrate sonicated water from biofilm samples, as well as ultrafilter backflush from bulk water samples and field blanks, following a protocol from Mark Borchardt at the United States Department of Agriculture (USDA; Marshfield, WI) as previously described with slight modifications.<sup>29,38</sup> Briefly, backflush samples or sonicated biofilm samples were mixed with 1.15% w/v NaCl, 8% w/v polyethylene glycol 8000, and 1% w/v beef extract (catalog #DF0115173; Fisher Scientific). The solution was then kept at 4 °C as it was stirred for 1 hour, incubated overnight, transferred to autoclave-sterilized 500 mL centrifuge tubes, and centrifuged at 4200 RPM (relative centrifugal force not known) for 45 minutes in a swing-bucket centrifuge (Sorvall RC 5C with SH-3000 rotor). Supernatant was removed by decanting, and resulting pellets were resuspended in 1 to 4 mL of autoclave-sterilized tris-EDTA buffer, split into two equal aliquots (with volumes from 0.5 to 4.5 mL per aliquot), and stored at -80 °C until DNA extraction and genomic analyses.

## 2.9. DNA extraction

DNA extraction from concentrated biomass samples was completed using a PowerSoil Pro extraction kit (Qiagen) with

slight modifications, as previously described.<sup>29</sup> Briefly, one pellet aliquot was thawed and vortexed for 10 seconds. For advanced feedwater, 200  $\mu\text{L}$  of homogenized sample was added directly to each PowerSoil Pro Powerbead tube. For all other samples, sample homogenates were centrifuged at  $34000 \times g$  for 1 minute, and the pellet was stored on ice. To concentrate nucleic acids remaining in the supernatant, it was aliquoted onto a centrifugal filtration unit (Amicon ultra-15 100 kDa; Millipore, Cork, Ireland). The filtration unit was centrifuged at  $7500 \times g$  for 30 minutes and the concentrate was combined with the pellet and homogenized. 200  $\mu\text{L}$  of the concentrated sample (out of a total volume ranging from 0.25 to 2 mL) was added to the Powerbead Tube. The sample was incubated at 37 °C for 30 min with an enzymatic digestion solution: 50  $\mu\text{L}$  of 0.001% lysozyme (Sigma-Aldrich, Darmstadt, Germany), 50  $\mu\text{L}$  of 0.00001% achromopeptidase (Sigma-Aldrich, Darmstadt, Germany), and 8  $\mu\text{L}$  of 0.01% carrier RNA in buffer AVL (Qiagen). Solution CD1 was added to the sample (500  $\mu\text{L}$ ), and then the PowerSoil Pro kit was followed as specified by the manufacturer until the step immediately before elution, when a 5 min room-temperature incubation step was added. The sample was eluted and stored at -80 °C until further processing. Six extraction blanks of nuclease-free water were included for 16S rRNA gene amplicon sequencing data analysis (see Section 2.12).

## 2.10. Flow cytometry, ATP analysis, and quantitative PCR

Total and intact cell counts were determined for bulk water grab samples as was previously described.<sup>11</sup> Briefly, cell concentrations were measured using flow cytometry with SYBR Green I (S9430; Sigma-Aldrich, St. Louis, MO) and propidium iodide (30 mM P1304MP; Life Technologies, Carlsbad, CA) to distinguish cells with intact membranes. From each bulk water grab sample, three 1000  $\mu\text{L}$  or 1500  $\mu\text{L}$  aliquots were processed and the geometric mean and geometric standard deviation were calculated. Measurements were performed on two separate flow cytometers, an Accuri™ C6 flow cytometer (Accuri; BD Biosciences, San Jose, CA) and a BD FACSCanto™ cell analyzer (Canto; BD Biosciences, San Jose, CA), as previously described.<sup>30</sup> The Accuri was used to sample until February 6th, 2018, and the Canto was used for the remaining study period. More detail can be found in the ESI.† For the Accuri, the limits of detection were previously determined for intact cell count (22 cells per mL) and total cell count (12 cells per mL) using the same instrument used in this study.<sup>11</sup> The Canto limit of detection was based on a recommended lower quantification limit ( $10^2$  cells per mL).<sup>39</sup>

For ATP assays, the BacTiter-Glo™ kit (Promega Corporation) and a GloMax Luminometer (Model #E6080) were used as previously described.<sup>11</sup> Briefly, total and intracellular ATP was measured in triplicate 500  $\mu\text{L}$  aliquots of bulk water and biofilm samples. The geometric mean and geometric standard deviation were calculated. For total and extracellular ATP, the quantification limits were set by the



standard curve ( $1 \times 10^{-4}$  nM to 10 nM). For ATP assays as well as cell count assays, we were not able to complete all sample analyses for some locations on all sample days because of logistical constraints which resulted in small inconsistencies in the number of samples for each assay and location.

qPCR sequences for primers and probes were applied as described previously to target the 16S rRNA gene, *Mycobacterium avium* complex, *Legionella pneumophila*, *Acanthamoeba* spp., *bla*<sub>TEM</sub>, *sul1* (Table S2†).<sup>29,40–43</sup> Briefly, samples were analyzed in technical triplicate on a StepOnePlus™ Real-Time PCR System (Applied Biosystems, Foster City, CA) using triplicate DNA (gBlocks Gene Fragments; Integrated DNA Technologies, Coarville, IA) standard curves on 96-well optical plates (MicroAmp™ Fast Optical). DNA standard curves on each qPCR plate were used to calculate gene counts and establish a limit of quantification (LoQ) for each assay. qPCR validation data (Tables S5, S6, and Fig. S5†) and standard details (Table S7†) can be found in the ESI.† Triplicate negative controls (*i.e.*, PCR-grade water) were run on every plate. All negative controls amplified below the LoQ of each assay. Samples were considered positive (*i.e.*, detected) if there was amplification in at least one of three qPCR triplicates, including if amplification was below the LoQ. For *Legionella pneumophila*, *bla*<sub>TEM</sub>, *Mycobacterium avium* complex, and *Acanthamoeba* spp., less than 22% of samples were within the quantifiable range, and only percent positive data are shown. For the 16S rRNA gene and *sul1*, the LoQs were determined to be 1000 and 10 gene copies per PCR reaction respectively. For statistical analyses and log<sub>10</sub> reduction calculations, all values below the LoQ were set at the LoQ. Primers and probes for all assays were selected from the literature (Table S8†). There was insufficient extracted sample volume to complete all analyses on all samples, so subsets of samples representative of each phase were measured for each qPCR assay. Thermal cycling conditions for each assay were optimized before analysis of samples (Table S9†). Inhibition testing of samples followed the spike and dilute method<sup>44</sup> (Table S10†). Detailed information on qPCR methodology is presented in the ESI.†

### 2.11. Library preparation and 16S rRNA gene amplicon sequencing

Library preparation for amplicon sequencing followed the Schloss Lab MiSeq wet-lab protocol for amplification of the V4 region of the 16S rRNA gene and Kantor *et al.* (2019),<sup>10</sup> with slight modifications. Briefly, the V4 region was amplified using uniquely barcoded 515F and 806R primers with Phusion HotStart II polymerase (ThermoFisher Scientific), HF buffer (ThermoFisher Scientific), and 10 to 25 ng (up to 2 μL total) of genomic DNA. Triplicate 25 μL reactions were combined. For reactions that failed to amplify, PCR was repeated with 3% dimethyl sulfoxide and 0.2% bovine serum albumin added to the reaction mixture (25 μL total volume reactions). At the Vincent J. Coates Genomics

Sequencing Laboratory at UC Berkeley, the dual-barcoded libraries were pooled and then sequenced on an Illumina MiSeq, yielding 300 bp paired-end reads. Two library preparation blanks of nuclease-free water (one on each plate) were included for 16S rRNA gene amplicon sequencing data analysis (see Data analysis section). The data have been deposited with links to BioProject accession number PRJNA896721 in the NCBI BioProject database (<https://www.ncbi.nlm.nih.gov/bioproject/>).

Amplicon sequence data were processed as previously described<sup>10</sup> with slight modifications. Briefly, reads were demultiplexed, mapped to PhiX, and processed using DADA2 (v1.12.1)<sup>45</sup> to generate amplicon sequence variants (ASVs). FastQC was used to assess quality and to determine cutoffs for the following five quality control measures: (i) truncation of all reads after 251 nucleotides (nts); (ii) trimming of all reads to remove 5 nts from the 5' end; (iii) truncation of a subset of reads where quality score dropped to 10 or below; (iv) removal of reads with expected errors greater than 1; and (v) removal of reads with lengths less than 200 nts. The remaining reads were denoised, chimeras were removed from the dataset using removeBimeraDenovo, and taxonomy of sequences was assigned using the Ribosomal Database Project Naive Bayesian classifier<sup>46</sup> trained using data from the SILVA database (v132).<sup>47</sup>

### 2.12. Data analysis


Data analysis was completed in R (v4.1.3) unless otherwise specified. Relative abundance of *sul1* was calculated as the concentration of *sul1* divided by the 16S rRNA gene concentration. Flow cytometric cell count data, intracellular ATP concentrations, and *sul1* relative abundance data were not normally distributed; for comparisons between locations, a Kruskal–Wallis test was performed followed by pairwise Dunn's tests with Holm–Bonferroni correction using rstatix (v0.7).

Data analysis for 16S rRNA gene amplicon sequencing was completed using Phyloseq (v1.38.0). Two blanks with fewer than 7500 reads were removed from downstream analyses. Contamination in samples was assessed using differential abundance analysis with DeSeq2 (v1.24.0) as previously described.<sup>10</sup> In brief, samples were compared to extraction, library preparation, and field blanks and ASVs shared between samples and any negative control were determined. 151 ASVs were removed from the dataset that were shared between samples and any negative control and that were not significantly enriched in samples over negative controls. Subsequently, only samples with more than 300 reads remaining were kept for further analysis. The percent relative abundance of each ASV in each sample was determined and then Bray–Curtis dissimilarities were calculated. Non-metric multidimensional scaling (NMDS) of Bray–Curtis dissimilarities was performed for all bulk water samples as well as only pipe loop bulk water samples (*i.e.*, not including samples from the full-scale distribution system, the demonstration-scale RO permeate, or the feedwater to the



pipe loops). Clustering by sample date and feedwater composition was assessed in pipe loop bulk water samples using PERMANOVA (Vegan v2.5.7). Estimated absolute abundances were calculated for each sample by multiplying the relative abundance fraction with the total cell count measured. Differential abundance analysis was completed using DeSeq2 to identify significantly ( $p < 0.05$ ) enriched or

depleted ASVs after the pipe loops transitioned from conventional drinking water to the advanced blends. 16S rRNA gene amplicon sequencing data preparation code (<https://github.com/rosekantor/awtp2>) as well as 16S rRNA gene amplicon sequencing and water quality data analysis code (<https://doi.org/10.5281/zenodo.7734207>) are publicly available.

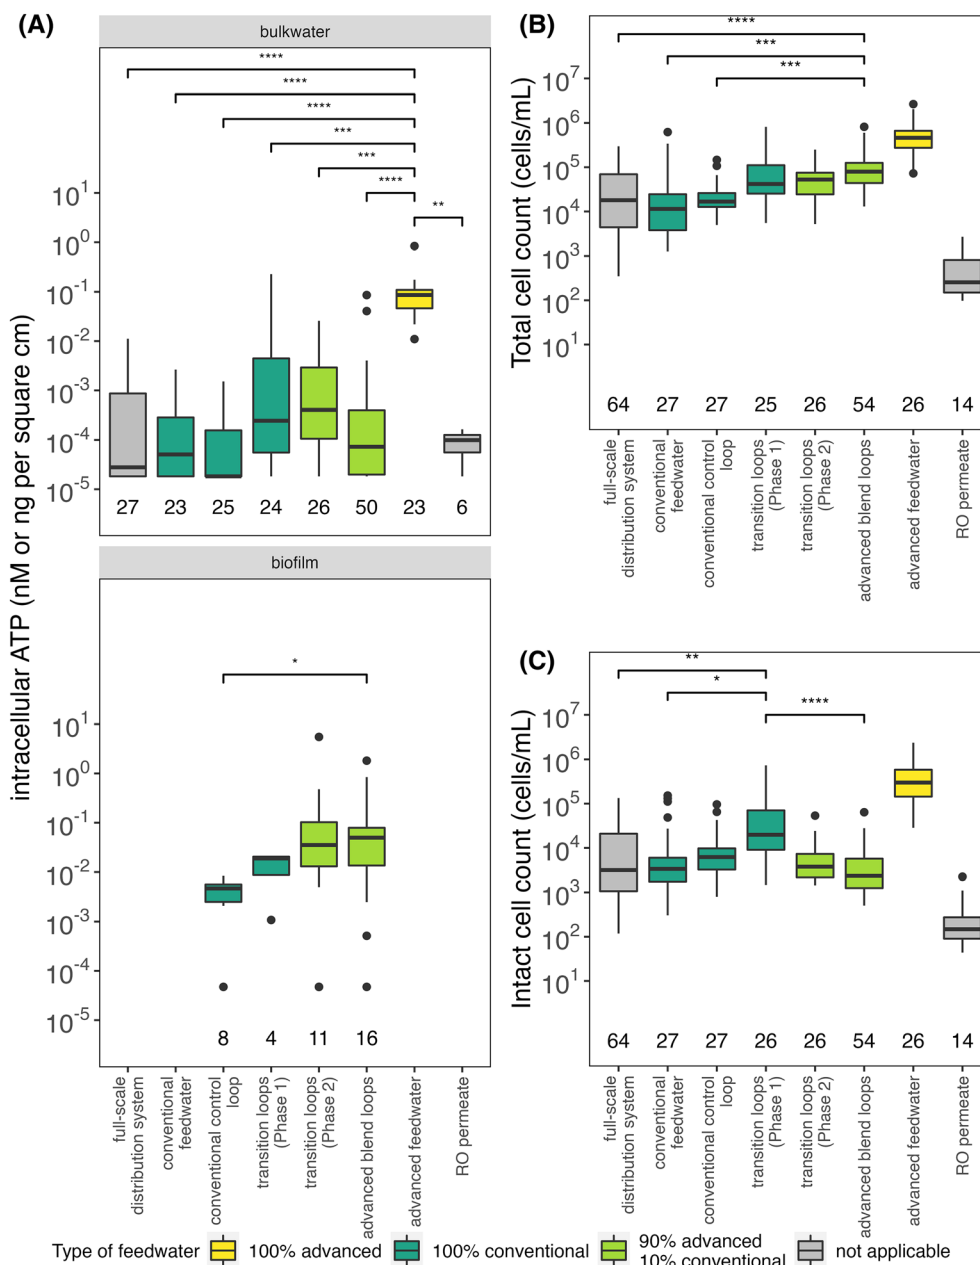

**Fig. 2** (A) Boxplots of intracellular ATP in bulk water (nM) and biofilm (ng cm<sup>-2</sup>) samples and of (B) total and (C) intact cell counts by flow cytometry in bulk water samples. For A, B and C, the total number of samples taken for each sample group is located immediately above the x-axes. Boxes are colored by water type. Kruskal–Wallis tests were significant for bulk water intact cell counts ( $p < 0.00001$ ) and total cell count ( $p < 0.00001$ ) groups as well as intracellular ATP for bulk water ( $p < 0.00001$ ) and biofilm ( $p < 0.05$ ). Both advanced feedwater and RO permeate in B and C were significantly different ( $p < 0.05$ ) from every other sample, including each other (not shown on the plot). The advanced feedwater was sampled before primary and secondary disinfection. Adjusted  $p$ -values from pairwise Dunn's tests are represented as \* for  $p < 0.05$ , \*\* for  $p < 0.01$ , \*\*\* for  $p < 0.001$ , and \*\*\*\* for  $p < 0.0001$ .





### 3. Results

#### 3.1. Microbial water quality of feedwaters

The microbial water quality of the conventional feedwater samples was expected to closely resemble that of the full-scale drinking water distribution system samples because it originated from a distribution pipe onsite at the drinking water treatment facility and just downstream of treatment (Fig. 1A). Throughout the study period, a large portion of microbial cells in the conventional feedwater were intact (average total and intact cell counts of  $6.79 \times 10^4$  and  $1.98 \times 10^4$  cells per mL, respectively), despite a relatively high total chlorine concentration in the conventional feedwater (average of  $2.20 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ). Intracellular ATP (Fig. 2A), total cell counts (Fig. 2B), and intact cell counts (Fig. 2C) were not significantly different between the conventional feedwater and the full-scale drinking water distribution system samples further downstream.

In contrast, the handling of advanced feedwater prior to use (Fig. 1A) resulted in a water quality that differed from the RO permeate at the advanced wastewater treatment plant and the conventional feedwater. While the RO permeate initially had very low cell counts, it was transported by tanker truck from the advanced wastewater treatment facility to the pipe loop site, conditioned to adjust the pH and alkalinity, and stored without disinfectant residual in a large outdoor plastic tank until batch chlorination (Fig. 1A). The average water age of the conditioned, stored RO permeate (advanced feedwater) was  $6.1 \pm 5.4$  days, which provided substantial time for microorganisms to grow prior to batch chlorination. Intracellular ATP (Fig. 2A), total cell counts (Fig. 2B), and intact cell counts (Fig. 2C) were significantly higher in the advanced feedwater (prior to batch chlorination) compared to the RO permeate samples. In addition, the microbial community shifted during handling: RO permeate samples clustered together tightly and separately from advanced feedwater (Fig. 3). Microbial batch growth assays conducted under carbon-limiting conditions were completed during each step of RO permeate handling to determine if

bioavailable carbon was introduced during RO handling. Each handling step, including conveyance, transportation (highest contribution), and storage onsite at the conventional drinking water treatment facility, introduced bioavailable carbon (Table S11†). As a result of the RO permeate handling, there was a shift in the microbial community composition (Fig. 3) and a >1000-fold increase in the average concentration of intact cells to levels that were significantly higher than the conventional feedwater (Fig. 2).

During the final step to produce the advanced blend for the pipe loops, batch chlorination was used to disinfect 90 L of advanced feedwater and to yield a chloramine residual in the pipe loop reservoirs prior to blending with 10 L of conventional feedwater. Although we did not sample this blend prior to its first introduction to the pipe loops, the samples from the advanced blend pipe loops (after a 3.5 day recirculation period) provide insight into its water quality. As discussed further in the next section, the batch chlorination of the RO permeate that had been transported, conditioned and stored led to a feedwater quality that was unlike typical finished drinking water due to the high concentration of bacterial cells damaged by chlorination.

#### 3.2. Microbial water quality in the conventional and advanced blend pipe loops

Three pipe loops were fed with a consistent feedwater composition throughout the study: the conventional control loop and two advanced blend loops (Fig. 1B). This section focuses on a comparison of these three loops, prior to presenting the results for the loops that were transitioned from 100% conventional feedwater to advanced blends (Section 3.3). The conventional control loop was intended to represent the full-scale drinking water distribution system. Intracellular ATP (Fig. 2A), total cell counts (Fig. 2B), and intact cell counts (Fig. 2C) were not significantly different between the conventional control loop, the conventional feedwater, and the full-scale drinking water distribution system samples. These results indicate that the conventional feedwater was fairly “stable” with respect to microbial growth, because cell counts did not increase in the pipe loops (after 3.5 days of recirculation) nor were cell counts higher in the full-scale distribution system samples. In addition, the microbial community of the conventional control loop was more similar to that of the full-scale distribution system compared to the RO permeate (Fig. 3).

The advanced blend loops had significantly lower concentrations of intracellular ATP, total cell counts, and intact cell counts than the (unchlorinated) advanced feedwater. This finding suggests that disinfection caused both loss of membrane integrity and lysis of cells (Fig. 2). We expected an inverse relationship between chlorine residual and intact cell counts, as has been observed in chlorinated and chloraminated full-scale drinking water distribution systems.<sup>11,30,34,48–50</sup> Instead, we observed a decline in both chlorine concentration and intact cell counts (Fig. S6†). We

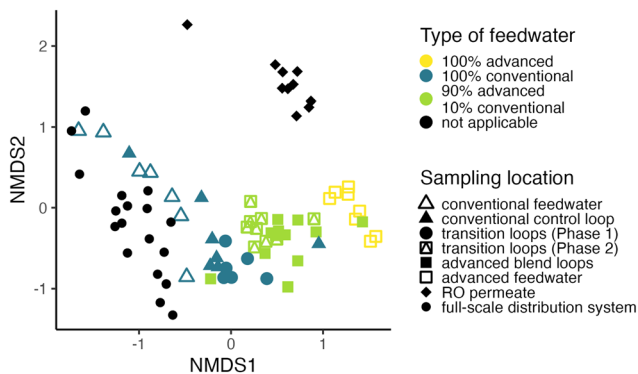


Fig. 3 Non-metric multidimensional scaling of Bray-Curtis dissimilarity for all bulk water microbial communities via 16S rRNA gene amplicon sequencing (*i.e.*, pipe loop feedwaters, feedwater origins, and pipe loop samples) (stress = 0.17).



hypothesized that, in the advanced blend loops, cells continued to lyse throughout each 3.5 day recirculation period rather than grow in response to decreased disinfectant concentrations. This trend was not reflective of what has been observed previously in the same full-scale conventional drinking water distribution system,<sup>30</sup> and provides insight into the unique conditions that were created by disinfecting the advanced feedwater with high cell counts from recent growth. Nonetheless, the microbial community of the advanced blend loops resembled that of the advanced feedwater (Fig. 3), but it is possible that we would have observed a shift in the microbial community if DNA from only intact cells was sequenced.

Interestingly, the advanced blend loops had similar intracellular ATP and intact cell counts to that of the full-scale distribution system, conventional feedwater, and conventional control loop (Fig. 2A and C). However, the total cell count was significantly higher (Fig. 2B), which also suggests cell lysis continued to occur as the advanced blend feed recirculated in the pipe loops. While the conventional and advanced feedwaters were characterized by distinct microbial community profiles, the microbial community profiles in the advanced blend loops converged between the feedwaters (Fig. 3). Of note, average total chlorine concentrations in the advanced blend loops at the end of recirculation periods were frequently low in Phase 2 ( $\geq 50\%$  of samples had  $< 0.2 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ; Table S3†) at the end of recirculation periods as compared to the conventional control loop in Phase 2 (average of  $0.79 \text{ mg L}^{-1}$  as  $\text{Cl}_2$ ; Fig. S4 and Table S3†). Disinfectant residual has been shown to affect microbial water quality in drinking water distribution systems,<sup>30,51–57</sup> and there is an inherent challenge of comparing test conditions with different disinfectant residual concentrations.

### 3.3. Pipe loop transition from conventional feedwater to the advanced blend

Two pipe loops were transitioned from conventional feedwater (Phase 1) to advanced blend feedwater (Phase 2; Fig. 1B). To assess biofilm sloughing in the transition loops, we determined if there was a significant increase in intracellular ATP or intact cell counts in bulk water or decrease in intracellular ATP in Phase 2 compared to Phase 1. We did not observe evidence of biofilm sloughing; intact and total cell counts in the bulk water of the transition loops were not significantly different in Phase 1 compared to Phase 2 (Fig. S4B†), nor was the intracellular ATP of biofilm samples (Fig. 2A). Indeed, the intracellular ATP in bulk water and biofilm, and the intact cell counts in the transition loop bulk water were similar to that of the conventional control loop (Fig. 2A and C). The timescale for chemical and biological destabilization in drinking water distribution systems is not well established,<sup>17</sup> but we did not observe large increases in intact cell count in the pipe loop bulk water that were immediate (after the first 3.5 day

recirculation period) or long-term (during the 11 weeks of Phase 2; Fig. S4B†).


The feedwater type affected the microbial community profiles in the bulk water and biofilm of the pipe loops. First, the effect of feedwater type on the microbial community profiles of all pipe loop bulk water samples collected in this study was assessed (Fig. S7A†). In the transition loops, the microbial community profile shifted in Phase 2 and samples clustered between the conventional and advanced blend loops. The pipe loop bulk water samples clustered by type of feedwater ( $R^2 = 0.24$ ,  $p = 0.001$ ), but sample date did not explain the variation in microbial community profiles ( $R^2 = 0.03$ ,  $p < 0.05$ ). Next, the effect of sample type (*i.e.*, bulk water compared to biofilm) compared to feedwater type on the microbial community profiles in the transition loops was assessed (Fig. S7B†). The transition loop samples clustered visually by feedwater type, but feedwater type ( $R^2 = 0.05$ ,  $p < 0.05$ ), sample type ( $R^2 = 0.09$ ,  $p < 0.01$ ), and sample date ( $R^2 = 0.04$ ,  $p > 0.05$ ) did not explain the variation in microbial community profiles. In the transition loops, 21 ASVs were significantly enriched or depleted after the feedwater switch to advanced blends from 100% conventional feedwater (Phase 2 compared to Phase 1; Fig. 4). Many of the enriched ASVs were introduced by the advanced feedwater (Fig. S8†). For example, the *Hydrogenophaga*-classified ASV was enriched in the transition loops in Phase 2 (Fig. 4) and had high relative abundance in most of the advanced feedwater samples (Fig. S8A†). Several of the genera enriched in Phase 2 have been identified in drinking water treatment and distribution systems in previous studies.<sup>15,58–61</sup> The enriched *Pseudomonas*-classified ASV is discussed in more detail in the next sections.

### 3.4. Antibiotic resistance genes *sul1* and *bla*<sub>TEM</sub>

*Sul1* concentrations were similar in the conventional feedwater, RO permeate, and full-scale distribution system and comparable to other previously studied full-scale distribution systems (Fig. 5A).<sup>9,62,63</sup> In comparison to the conventional feedwater, the relative abundance (*i.e.*, *sul1* concentration/16S rRNA gene concentration) of *sul1* in RO permeate was significantly higher (Fig. 5B). The RO permeate handling resulted in increased concentrations of the 16S rRNA gene and *sul1*. *Sul1* increased proportionally such that the relative abundance remained consistently high in the advanced feedwater.

The feedwater type affected the *sul1* abundance measured in the bulk water and biofilm of the pipe loops. The pipe loops with the same feedwater type in Phases 1 and 2 had similar low (conventional control loop) or high (advanced blend loops) concentration and relative abundance of *sul1* as the respective primary feedwater. Similarly, in the transition loops, the abundance of *sul1* reflected that of the primary feedwater for each phase; importantly, the concentration and relative abundance of *sul1* increased in both the bulk water and biofilm after introduction of the advanced blend (*i.e.*, in Phase 2 compared to Phase 1; Fig. 5). Previous studies of drinking water have found that chlorine exposure reduced the relative abundance of *sul1*, but increased the relative



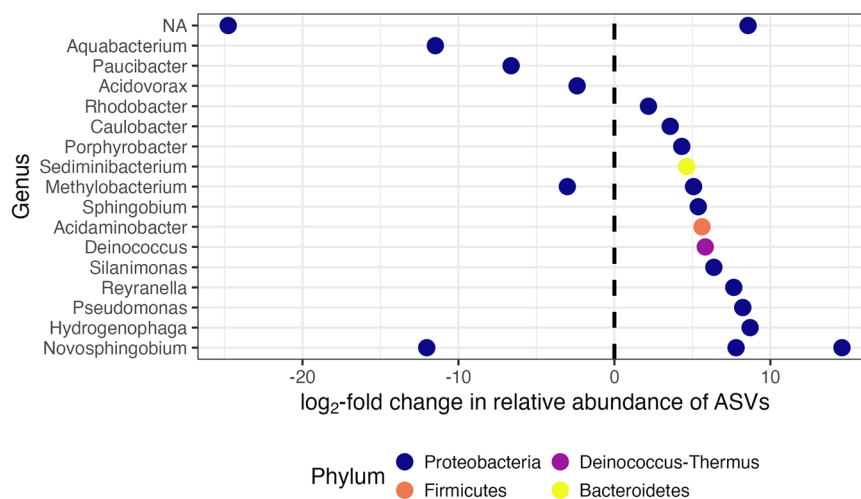

**Fig. 4** Differential abundance analysis results where the vertical dashed line at 0 indicates ASVs that were significantly ( $p < 0.05$ ) enriched (right) or depleted (left) in the bulk water and biofilm of the transition loops in Phase 2 compared to Phase 1.

abundance of other antibiotic resistance genes.<sup>62,64,65</sup> We did not observe a significant difference in *sul1* concentrations in the advanced feedwater compared to the pipe loops fed with the advanced blend (*i.e.*, after the advanced feedwater underwent primary disinfection with chlorine, formation of chloramine residual, blending with conventional water, and recirculation for 3.5 days). However, the study design did not allow for measurement of *sul1* concentrations immediately following disinfection because batch chlorination was completed in pipe loop reservoirs with water needed for subsequent bulk water filtration sampling events (90 L).

We observed a *Pseudomonas*-classified ASV that was enriched in the transition loops after the introduction of the advanced blend (Fig. 4), and *Pseudomonas* have been shown to carry *sul1* (there are currently seven species of *Pseudomonas* with resistomes that include *sul1* in the CARD database).<sup>66</sup> The relative abundance of the enriched *Pseudomonas*-classified ASV was low in RO permeate samples (Fig. S9<sup>†</sup>) and higher in biofilm samples from pipe loops fed with the advanced blend (Fig. S8B<sup>†</sup>). With this dataset, it is not possible to determine if the *Pseudomonas*-classified ASV carried *sul1*, but *Pseudomonas* species in direct potable reuse systems and their potential for antibiotic resistance warrant further study.

The beta-lactam resistance gene *bla*<sub>TEM</sub> was rarely detected in this study. While *sul1* was detected in all samples ( $n = 84$ ), *bla*<sub>TEM</sub> was detected in only 33% of samples (28 of 84 samples). Of these, 15 samples were in the quantifiable range. All sample locations had at least one *bla*<sub>TEM</sub> detection, except the RO permeate samples (0 detects out of 7 tested).


### 3.5. Opportunistic pathogens assessed with 16S rRNA gene amplicon sequencing and qPCR

*Mycobacterium* spp. were present in nearly every sample collected in this study regardless of feedwater type, and *Mycobacterium avium* complex was detected *via* qPCR in the

majority of samples tested. At least one *Mycobacterium*-classified ASV was present in all samples, except for some of the advanced feedwater samples (Fig. 6 and S10<sup>†</sup>), but no *Mycobacterium*-classified ASV was significantly enriched in the bulk water and biofilm of the transition loops in Phase 2 compared to Phase 1 (Fig. 4). In addition, 59% of samples tested were positive for the *Mycobacterium avium* complex gene by qPCR (40 of 68 samples), with only 2 samples in the quantifiable range. RO permeate samples were not tested for *Mycobacterium avium* complex, but all other sample locations had at least one sample positive for *Mycobacterium avium* complex by qPCR. The relatively frequent detection of *Mycobacterium avium* complex and *Mycobacterium*-classified ASVs in this study is consistent with previous studies in which *Mycobacterium* spp. has been observed in chloraminated full-scale distribution systems<sup>43,67</sup> and in simulated distribution systems fed with advanced-treated wastewater.<sup>8,10</sup>

*Legionella* spp. and *Acanthamoeba* spp. were present in many of the samples in this study, but *Legionella pneumophila* was rarely detected by qPCR. At least one *Legionella*-classified ASV was observed in a majority of samples and locations (Fig. 6), including the RO permeate. However, the majority of RO permeate samples only had one *Legionella*-classified ASV, and the estimated absolute abundance (*i.e.*, the relative abundance multiplied by the intact cell count) of this ASV was relatively low in the majority of samples of the bulk water of the advanced blend loops (*Legionella* 144; Fig. S10<sup>†</sup>). Similarly, *Acanthamoeba* spp., a host of *Legionella*,<sup>21</sup> was detected by qPCR in 46% of samples (36 out of 79 samples), including at least one detection for each sample location. In addition, biofilms of pipe loops fed with the advanced blend had more samples with at least one *Legionella*-classified ASV compared to biofilms from pipe loops fed with conventional feedwater (Fig. 6), but no *Legionella*-classified ASV was significantly enriched in the bulk water and biofilm of the transition loops in Phase 2 compared to Phase 1 (Fig. 4).



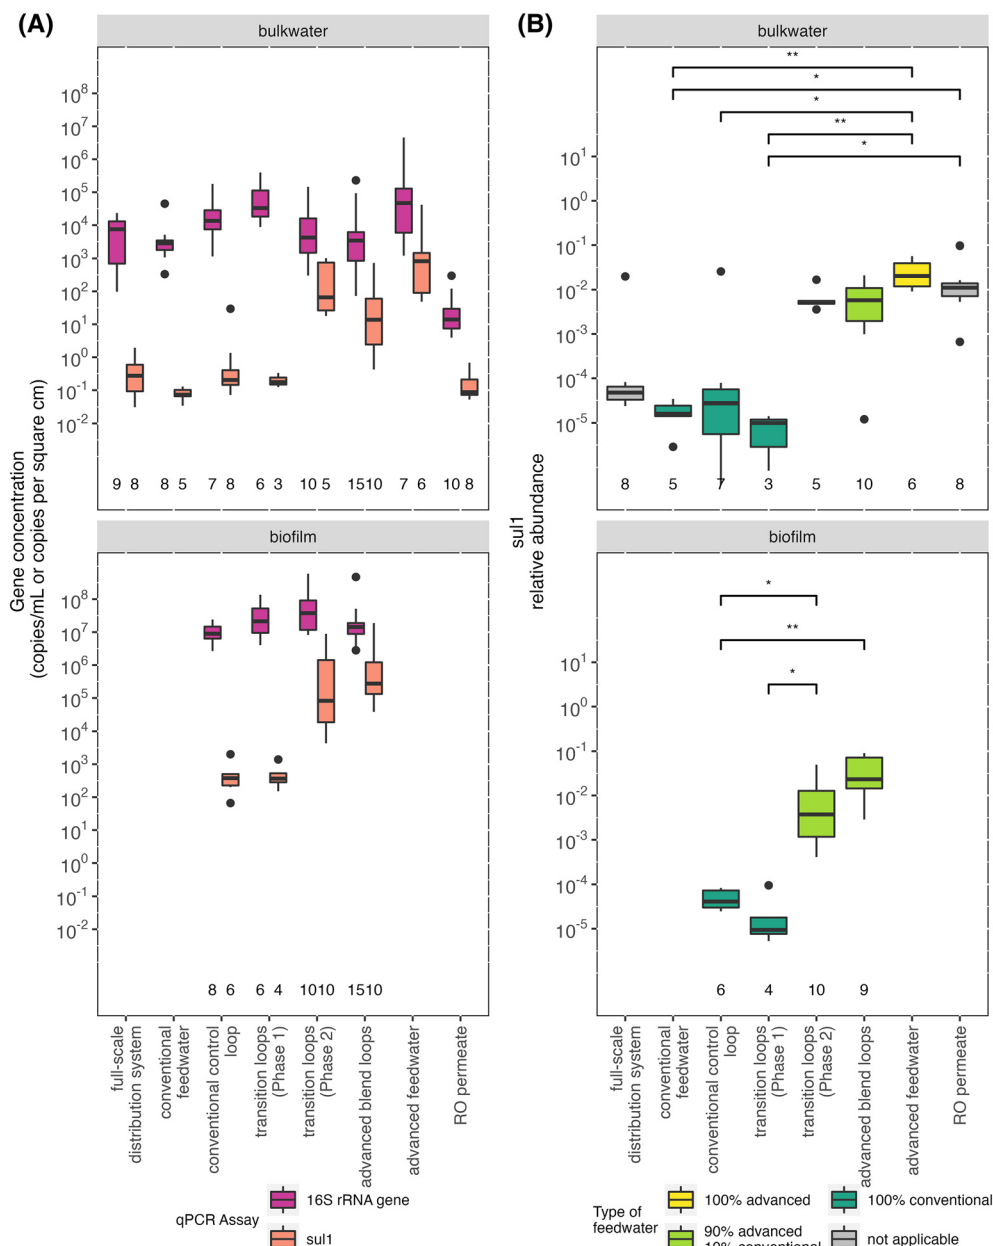

**Fig. 5** (A) Boxplots of 16S rRNA gene and *sul1* concentrations in bulk water (gene copies per ml) and biofilm (gene copies per cm<sup>2</sup>) samples. (B) Boxplots of *sul1* relative abundance proportion in bulk water and biofilm samples. Bulk water ( $p < 0.0001$ ) and biofilm ( $p < 0.0001$ ) samples had at least one sample group significantly different from the others via a Kruskal-Wallis test. Adjusted  $p$ -values from pairwise Dunn's tests are represented as \* for  $p < 0.05$ , \*\* for  $p < 0.01$ , \*\*\* for  $p < 0.001$ , and \*\*\*\* for  $p < 0.0001$ . For A and B, the total number of samples taken for each sample group is located immediately above the x-axes.


Despite the presence of *Legionella*-classified ASVs and the detection of *Acanthamoeba* spp. via qPCR, *Legionella pneumophila* was detected by qPCR in only one advanced blend loop sample out of 73 samples tested (RO permeate samples were not tested by qPCR for *Legionella pneumophila* or *Acanthamoeba* spp.). These results are consistent with previous studies, which have documented low detection of *Legionella pneumophila* in chloraminated drinking water distribution systems.<sup>68,69</sup>

*Pseudomonas* spp. were present in the RO permeate and increased in pipe loop samples, but the proportion of

*Pseudomonas aeruginosa* specifically is unknown. At least one *Pseudomonas*-classified ASV was present in the majority of samples collected from RO permeate, the advanced feedwater, and pipe loops fed with the advanced blend (Fig. 6). Similarly, more samples with at least one *Pseudomonas*-classified ASV were present in biofilms of pipe loops fed with the advanced blend compared to conventional feedwater (Fig. 6). In the advanced feedwater, two *Pseudomonas*-classified ASVs increased in estimated absolute abundance from the RO permeate, and one ASV was also in high abundance in the advanced blend pipe loops





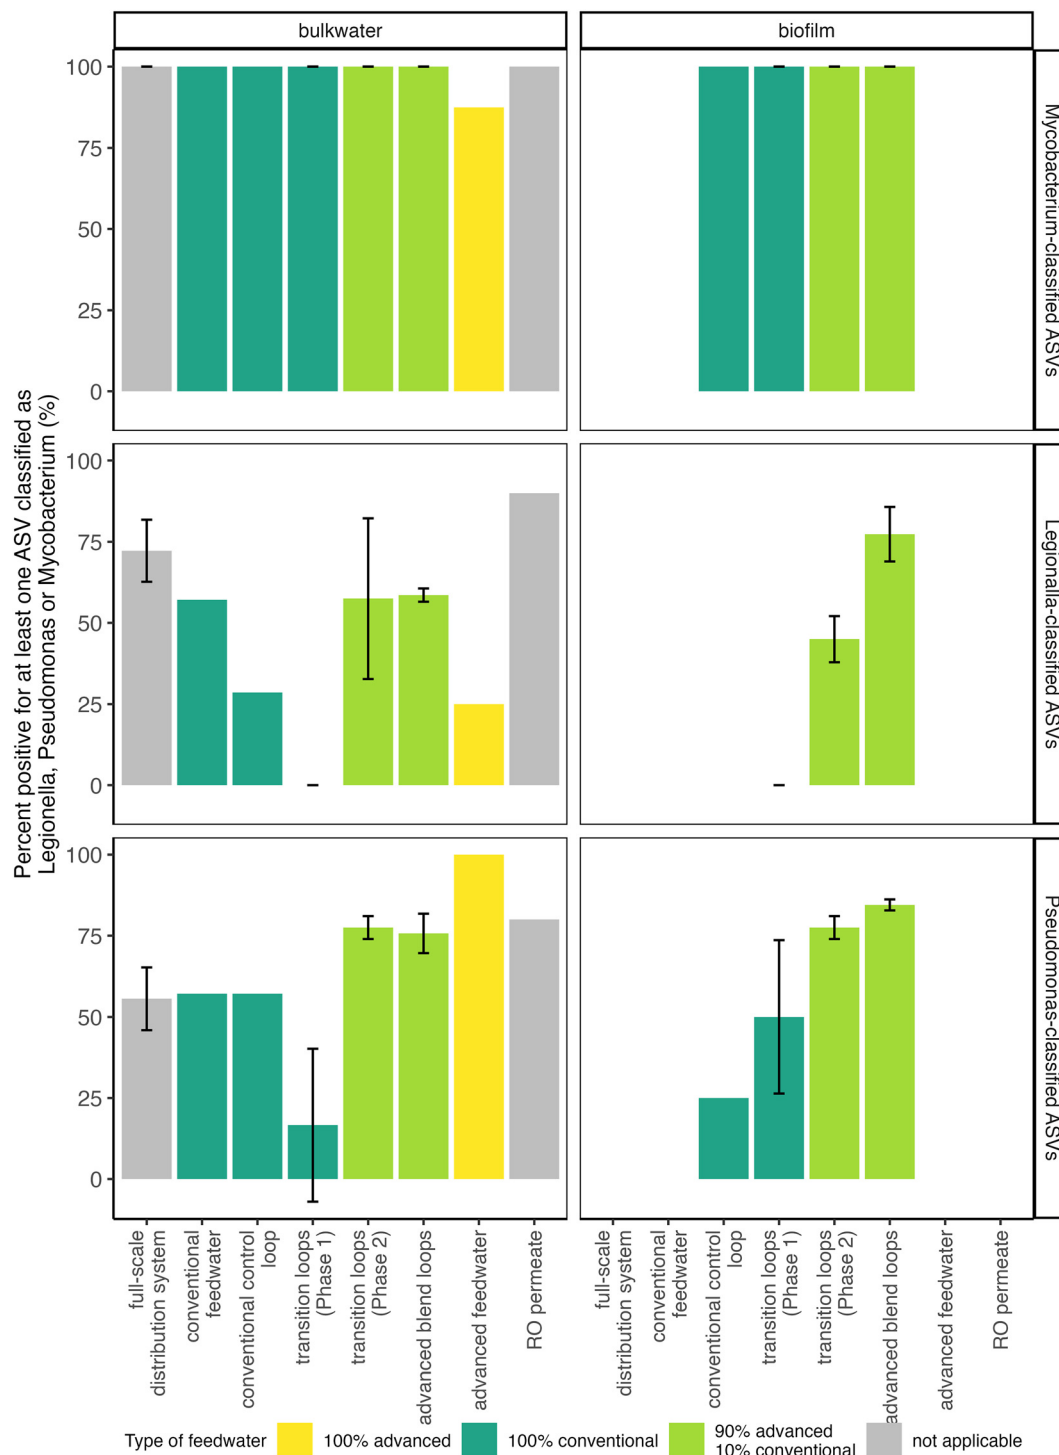

**Fig. 6** ASVs with at least 0.05% abundance in at least one sample classified as *Legionella*, *Pseudomonas*, or *Mycobacterium* were enumerated for each sample location and the percent of samples positive for at least one ASV classified in the respective genera are shown. The arithmetic mean and arithmetic standard deviation as error bars are shown of the percent of positive samples calculated for duplicate pipe loops (*i.e.*, the advanced blend loops and transition loops in Phases 1 and 2) or triplicate sampling sites for the full scale drinking water distribution system only.

("Pseudomonas\_24"; Fig. S10†). This *Pseudomonas*-classified ASV was previously identified to be enriched in the transition loops after the introduction of the advanced blend (Fig. 4). We did not quantify *Pseudomonas aeruginosa* via qPCR in this study, but *Pseudomonas aeruginosa* was not detected by

Garner *et al.* (2019)<sup>8</sup> in simulated distribution systems fed with advanced-treated wastewater. Indeed, they found that simulated distribution systems fed with advanced-treated wastewater did not support the growth of any opportunistic pathogens quantified.



## 4. Discussion

### 4.1. Pipe loop transition from conventional feedwater to the advanced blend

In the transition loops, the transition from conventional feedwater to the advanced blend affected *sul1* concentrations and the microbial community composition, but not absolute abundance metrics (e.g., ATP or cell counts). The microbial community composition of the transition loops reflected the respective primary feedwater before and after the transition, and advanced blend loops and conventional control loops reflected the respective primary feedwater throughout the study. A literature review did not reveal work that simulated the microbial impacts of the transition from conventional to treated water augmentation in distribution systems. However, other researchers have observed similar shifts in microbial community profiles in conventional systems following the transition to a new feedwater or upgraded treatment at full scale.<sup>14,15,23</sup> 21 ASVs were significantly enriched or depleted in the bulk water and biofilm following the transition, including one *Pseudomonas*-classified ASV that was also at high estimated absolute abundance in pipe loops fed with the advanced blend and not identified in the pipe loops fed with 100% conventional water. This *Pseudomonas*-classified ASV increased in estimated absolute abundance after handling of RO permeate. Similarly, *sul1* in the bulk water and biofilm of the transition loops increased in both absolute and relative abundance after the transition, reflecting the composition of *sul1* in the feedwaters. These findings indicate that bacteria from the feedwater were able to compete with the biofilm microbial community that was established prior to the transition. Chen *et al.* (2020)<sup>70</sup> found higher relative abundance of *sul1* in bulk water and biofilms in a conventional drinking water distribution system compared to the finished water at the drinking water treatment facility. In this study, we observed a large increase in the relative abundance of *sul1* and the estimated absolute abundance of a *Pseudomonas*-classified ASV during handling of RO permeate prior to introduction in the pipe loops, and these findings support that bacterial growth during storage and conveyance of advanced-treated wastewater could increase antibiotic resistance and opportunistic pathogen estimated absolute abundance.

### 4.2. Considerations for full-scale direct potable reuse systems

**Avoid conveyance or storage of advanced-treated wastewater without a disinfectant residual.** In this study, the RO permeate had a distinct microbial community (Fig. 3) and did not support significant microbial growth (Table S11†). However, bioavailable carbon was added as a result of conveyance, transportation, and storage of RO permeate (Table S11†), which led to significant growth during handling. Other studies have shown that low nutrient levels alone do not necessarily inhibit microbial growth,<sup>11,71</sup> and in this sense the advanced-treated feedwater was not “stable” as even small amounts of bioavailable carbon introduced to it

during storage and conveyance resulted in microbial growth. While the need to transport RO permeate by truck was unique to this pilot-scale experimental design, pipe conveyance and storage will be necessary in full-scale systems. Thus, we recommend applying a disinfectant residual during storage and conveyance of advanced-treated wastewater. In addition to controlling bacterial growth in the finished water, the disinfectant residual could also be a valuable contribution to pathogen removal credit for the treatment train. However, management of disinfection by-products also must be considered because the unique water quality in advanced-treated wastewater can lead to formation of unique mixtures of disinfection by-products.<sup>72–74</sup>

**Include microbial abundance measures as well as screening for antibiotic resistance genes and opportunistic pathogens in enhanced monitoring programs.** The California Expert Panel on direct potable reuse has recommended enhanced monitoring (i.e., beyond the monitoring required to meet the Total Coliform Rule) for direct potable reuse systems.<sup>9</sup> In this study, flow cytometry-based cell counts and intracellular ATP concentrations provided evidence that i) handling of RO permeate affected the pipe loop feedwater and ii) transitioning to the advanced feedwater used in this study did not induce biofilm sloughing events large enough to affect microbial abundance in the bulk water or biofilm in Phase 2 compared to Phase 1 (Fig. 2). Our findings suggest that flow cytometry-based cell counts or intracellular ATP would be useful to include in enhanced monitoring. With respect to microbial surrogates and pathogens, full-scale chloraminated direct potable reuse systems may benefit from use of qPCR to monitor *Pseudomonas aeruginosa* (Fig. 4 and S10†) and *sul1* (Fig. 5). However, a screening process is recommended for each direct potable reuse system such that a wide range of antibiotic resistance genes and opportunistic pathogens are tested, and specific targets are identified for the enhanced monitoring program. The screening can be conducted in a simulated distribution system study, similar to this one, or immediately after the transition. A combination of breadth (e.g., quantifying microbial abundance with ATP concentrations or flow cytometry-based cell counts) and specificity (e.g., quantifying specific opportunistic pathogens) in enhanced monitoring could help capture effects of the transition that could be missed by either alone.

**Extend enhanced monitoring.** Our findings support that starting enhanced monitoring before the introduction of advanced-treated wastewater will establish a microbial water quality baseline that can serve as a point of comparison after the transition to direct potable reuse. For example, *Mycobacterium* spp. were detected in many of the advanced-treated wastewater samples, but by including a conventional control pipe loop, we were able to identify that *Mycobacterium* spp. were also detected in the conventional system and were not unique to the advanced-treated wastewater. To provide a similar point of comparison, the enhanced monitoring for direct potable reuse systems was recommended to start one



year prior to introduction of advanced-treated wastewater and continue one year after.<sup>9</sup> However, in this study, we also observed temporal changes in feedwater and other environmental conditions (*e.g.*, ambient temperature fluctuations at the outdoor study site; Fig. S3†) and temporal differences in microbial abundance of the conventional feedwater (Fig. S2†). We were able to compare results in this study to the conventional control loop, but temporal effects like these could confound experimental results in an uncontrolled full-scale enhanced monitoring study. Extending the monitoring to last at least two years before and after introducing advanced-treated wastewater would provide replication of seasonal changes to help reduce temporal effects that are confounded with the transition to direct potable reuse.

#### 4.3. Considerations for future direct potable reuse pilot- and bench-scale studies

**Ensure that experimental designs provide sufficient yield of microbial biomass.** Collecting enough biomass to characterize changes in microbial community composition requires more water as compared to pipe loop studies of chemical impacts (*e.g.*, corrosion or disinfection byproducts), particularly if meta-omic techniques will be employed. For example, prior efforts have failed to recover enough biomass from RO permeate for DNA sequencing data analysis and differentiation from negative controls.<sup>10,75,76</sup> The type of simulated distribution system used in the study will affect the sample volume available for analysis. Previous studies using batch pipe systems and annular reactors utilized smaller flow rates and sample volumes (100 times lower than this study).<sup>8,10,11</sup> In this study, the 100 L total batch volume and the 243 cm<sup>2</sup> biofilm sampling area yielded sufficient biomass for microbial community profiling.

**Consider the tradeoffs associated with the type of simulated drinking water distribution system.** Design decisions must be made for simulated distribution systems that are important for the applicability of the study results to full-scale systems. These decisions include, but are not limited to, choice of pipe material, pipe wall shear force, water age, dynamic *versus* static operation (*e.g.*, simulation of diurnal variations in flow and pipe wall shear forces) and ratio of water residence time in storage to residence time in distribution. Experimental considerations that affect simulated distribution system design decisions include the volume of water and area of biofilm needed for downstream analyses. A tradeoff must be made with respect to choice of operation as continuous feed systems or batch-fed systems<sup>24</sup> as well as whether to include features that increase water age, such as recirculation. For example, the semi-batch operation with recirculation, used in this research, provided flexibility to mimic full-scale distribution system shear forces, bulk water residence times, and the ratio of water residence time in storage to residence time in distribution. In addition, the design included materials common to the full-scale

drinking water distribution system and premise plumbing and allowed for large volumes of bulk water to be sampled for analysis of the microbial community. However, our approach was unrealistic in that it exposed the biofilm microbial communities to cycles of water age, disinfectant residual concentration, nutrient decay, and bulk water exposure to distribution system and premise plumbing materials. Additionally, the manual batch chlorination process used in this study was time intensive, and it was difficult to produce a consistent chlorine residual. Lastly, chlorination in batch-fed systems in general may be overly efficient in disinfection relative to large, continuous, flow-through chlorination used in full-scale chlorine contact basins. In comparison, recirculating simulated distribution systems operated with continuous flow have been constructed using consistent material (high density polyethylene), consistent pipe diameters, and a steady residence time.<sup>77</sup> However, the distribution of residence times in this system is wide and unrealistic compared to the water age at a sampling point a full-scale distribution system. While neither approach perfectly mimics a full-scale distribution system, one design may be preferable depending on the research objectives.

**Take care in the selection of technical and experimental controls.** Selection of technical and experimental controls for direct potable reuse simulation studies is especially important because simulated distribution systems have tradeoffs that will affect extension of results to a full-scale system, and, compared to conventional systems, there is a paucity of literature available to contextualize results. Studies of advanced-treated wastewater include samples with a large range in cell counts, nutrients, and sample matrices, particularly if the advanced treatment facility is sampled (*e.g.*, secondary-treated wastewater to advanced oxidation). These discrepancies make method selection challenging for critical steps, such as DNA extraction, and necessitate comprehensive technical and experimental controls. In this study, the negative controls that were collected during field sampling, extractions, and qPCR allowed us to identify contamination in the RO permeate samples. Additionally, two comparisons were essential for contextualizing results. First, the comparison of feedwaters to the respective origins was important. Comparing the advanced feedwater to the RO permeate allowed us to identify that bioavailable carbon was introduced during RO permeate handling. In addition, comparing the results from the bulk water of the full-scale drinking water distribution system to those of the conventional control loop allowed us to evaluate the applicability of results obtained from our simulated distribution systems to full-scale systems. However, it should be noted that we could not obtain biofilm from the full-scale system to compare with the simulated distribution system biofilm samples (*e.g.*, the effect of recirculation in the pipe loops on the biofilm microbial communities). Second, the comparison between the pipe loops fed with the advanced blend and the conventional control loop allowed us to



distinguish changes that were associated with the transition in feedwaters from other temporal effects, such as temperature fluctuations associated with seasonal changes (Fig. S3†).

## 5. Conclusions

- The microbial community profile in the pipe loop bulk water and biofilm reflected that of the current primary feedwater, including in the pipe loops that transitioned from conventional water to direct potable reuse water.

- The bioavailable carbon introduced during conveyance, transportation, and storage of RO permeate contributed to an increase in absolute microbial abundance, which included increases in antibiotic resistance and opportunistic pathogen estimated absolute abundance.

- Enhanced monitoring is recommended for full-scale systems that includes absolute microbial abundance, antibiotic resistance gene targets, and opportunistic pathogen targets for at least two years before and two years after transition to direct potable reuse.

- Future bench- or pilot-scale studies of direct potable reuse microbiology should be designed to include bulk water volume and biofilm sampling area that yield sufficient microbial biomass for analyses, appropriate simulated drinking water distribution systems for the study objectives, and comprehensive technical and experimental controls.

## Publication disclaimer

This publication was developed under STAR Fellowship Assistance Agreement no. 91782901-0, awarded by the EPA. It has not been formally reviewed by EPA. The views expressed in this publication are solely those of the listed authors, and EPA does not endorse any products or commercial services mentioned in this publication.

## Author contributions

Lauren C. Kennedy: conceptualization, data curation, formal analysis, funding acquisition, investigation, methodology, validation, visualization, writing – original draft, writing – review & editing. Scott E. Miller: conceptualization, data curation, formal analysis, funding acquisition, investigation, methodology, validation, visualization, writing – original draft, writing – review & editing. Rose S. Kantor: conceptualization, data curation, funding acquisition, investigation, methodology, validation, writing – original draft, writing – review & editing. Hannah Greenwald: data curation, investigation, methodology, validation, writing – review & editing. Michael J. Adelman: conceptualization, data curation, funding acquisition, investigation, methodology, resources, writing – review & editing. Hari Seshan: conceptualization, data curation, funding acquisition, investigation, methodology, resources, writing – review & editing. Paige Russell: conceptualization, data curation, funding acquisition, investigation, methodology, resources,

writing – review & editing. Kara L. Nelson: conceptualization, funding acquisition, methodology, resources, supervision, writing – original draft, writing – review & editing.

## Conflicts of interest

There are no conflicts of interest to declare.

## Acknowledgements

This work was supported by the National Science Foundation (NSF) Engineering Research Center for Re-Inventing the Nation's Urban Water Infrastructure [EEC-1028968] and a donation from our utility partner. L. C. K was supported by the NSF Graduate Research Fellowship [DGE-1752814]. S. E. M. was supported by the U.S. Environmental Protection Agency (EPA) STAR Fellowship Assistance Agreement no. 91782901-0.

## References

- 1 G. P. Maseeh, C. G. Russell, S. L. Villalobos, J. E. Balliew and G. Trejo, El Paso's Advanced Water Purification Facility: A New Direction in Potable Reuse, *J. AWWA*, 2015, **107**, 36–45.
- 2 B. M. Pecson, S. C. Triolo, S. Olivieri, E. C. Chen, A. N. Pisarenko, C.-C. Yang, A. Olivieri, C. N. Haas, R. S. Trussell and R. R. Trussell, Reliability of pathogen control in direct potable reuse: Performance evaluation and QMRA of a full-scale 1 MGD advanced treatment train, *Water Res.*, 2017, **122**, 258–268.
- 3 J. A. Soller, S. E. Eftim, I. Warren and S. P. Nappier, Evaluation of microbiological risks associated with direct potable reuse, *Microb. Risk Anal.*, 2016, **5**, 3–14.
- 4 E. Steinle-Darling, J. Sutherland and A. Salveson, Sampled Direct Potable Reuse Water Shows Promising Results, *Opflow*, 2016, **42**, 20–22.
- 5 E. L. Marron, W. A. Mitch, U. von Gunten and D. L. Sedlak, A Tale of Two Treatments: The Multiple Barrier Approach to Removing Chemical Contaminants During Potable Water Reuse, *Acc. Chem. Res.*, 2019, **52**, 615–622.
- 6 *A proposed framework for regulating direct potable reuse in California*, California Water Boards, 2018.
- 7 M. J. Adelman, J. H. Borchardt, H. Seshan, P. J. Russell, V. Occiano and A. M. Zare, *Understanding system-level operational impacts in potable reuse planning: case studies from San Diego, CA, USA*, 2021.
- 8 E. Garner, M. Inyang, E. Garvey, J. Parks, C. Glover, A. Grimaldi, E. Dickenson, J. Sutherland, A. Salveson, M. A. Edwards and A. Pruden, Impact of blending for direct potable reuse on premise plumbing microbial ecology and regrowth of opportunistic pathogens and antibiotic resistant bacteria, *Water Res.*, 2019, **151**, 75–86.
- 9 A. Olivieri, J. Crook, M. Anderson, R. Bull, J. Drewes, W. Jakubowski, P. McCarty, K. Nelson, J. Rose, D. Sedlak and T. Wade, *Expert Panel Final Report: Evaluation of the Feasibility of Developing Uniform Water Recycling Criteria for Direct Potable Reuse*, National Water Research Institute, 2016.





- 10 R. S. Kantor, S. E. Miller and K. L. Nelson, The Water Microbiome Through a Pilot Scale Advanced Treatment Facility for Direct Potable Reuse, *Front. Microbiol.*, 2019, **10**, 21.
- 11 S. E. Miller, R. A. Rodriguez and K. L. Nelson, Removal and growth of microorganisms across treatment and simulated distribution at a pilot-scale direct potable reuse facility, *Environ. Sci.: Water Res. Technol.*, 2020, **107**, 36.
- 12 M. J. Adelman, M. S. Smith, T. D. Hancock, J. H. Borchardt, M. D. Williams, J. Quicho and M. L. Weber-Shirk, A bench-scale study of potable reuse impacts on surface water treatment, *AWWA Water Sci.*, 2020, **2**, e1205.
- 13 M. C. Meckes, R. C. Haught, K. Kelty, J. C. Blannon and D. Cmeheil, Impact on water distribution system biofilm densities from reverse osmosis membrane treatment of supply water, *J. Environ. Eng. Sci.*, 2007, **6**, 449–454.
- 14 L. Chen, F. Ling, G. Bakker, W.-T. Liu, G. Medema, W. van der Meer and G. Liu, Assessing the transition effects in a drinking water distribution system caused by changing supply water quality: an indirect approach by characterizing suspended solids, *Water Res.*, 2020, **168**, 115159.
- 15 Y. Hu, D. Dong, K. Wan, C. Chen, X. Yu and H. Lin, Potential shift of bacterial community structure and corrosion-related bacteria in drinking water distribution pipeline driven by water source switching, *Front. Environ. Sci. Eng.*, 2020, **15**, 28.
- 16 I. Sibille, L. Mathieu, J. L. Paquin, D. Gatel and J. C. Block, Microbial characteristics of a distribution system fed with nanofiltered drinking water, *Water Res.*, 1997, **31**, 2318–2326.
- 17 G. Liu, Y. Zhang, W.-J. Knibbe, C. Feng, W. Liu, G. Medema and W. van der Meer, Potential impacts of changing supply-water quality on drinking water distribution: A review, *Water Res.*, 2017, **116**, 135–148.
- 18 P. Laurent, P. Servais, D. Gatel, G. Randon, P. Bonne and J. Cavard, Microbiological quality before and after nanofiltration, *J. AWWA*, 1999, **91**, 62–72.
- 19 E. Torvinen, S. Suomalainen, M. J. Lehtola, I. T. Miettinen, O. Zacheus, L. Paulin, M.-L. Katila and P. J. Martikainen, Mycobacteria in Water and Loose Deposits of Drinking Water Distribution Systems in Finland, *Appl. Environ. Microbiol.*, 2004, **70**, 1973.
- 20 D. van der Kooij, G. L. Bakker, R. Italiaander, H. R. Veenendaal and B. A. Wullings, Biofilm Composition and Threshold Concentration for Growth of *Legionella pneumophila* on Surfaces Exposed to Flowing Warm Tap Water without Disinfectant, *Appl. Environ. Microbiol.*, 2017, **83**, DOI: [10.1128/AEM.02737-16](https://doi.org/10.1128/AEM.02737-16).
- 21 N. J. Ashbolt, Environmental (Saprozoic) Pathogens of Engineered Water Systems: Understanding Their Ecology for Risk Assessment and Management, *Pathogens*, 2015, **4**, 390–405.
- 22 Water Services Association of Australia, *All options on the table: Lessons learned from the journeys of others*, 2019.
- 23 S. Chan, K. Pullerits, A. Keucken, K. M. Persson, C. J. Paul and P. Radström, Bacterial release from pipe biofilm in a full-scale drinking water distribution system, *npj Biofilms Microbiomes*, 2019, **5**, 9–9.
- 24 I. B. Gomes, M. Simões and L. C. Simões, An overview on the reactors to study drinking water biofilms, *Water Res.*, 2014, **62**, 63–87.
- 25 A. C. Martiny, T. M. Jørgensen, H.-J. Albrechtsen, E. Arvin and S. Molin, Long-Term Succession of Structure and Diversity of a Biofilm Formed in a Model Drinking Water Distribution System, *Appl. Environ. Microbiol.*, 2003, **69**, 6899–6907.
- 26 I. Douterelo, K. E. Fish and J. B. Boxall, Succession of bacterial and fungal communities within biofilms of a chlorinated drinking water distribution system, *Water Res.*, 2018, **141**, 74–85.
- 27 I. Douterelo, R. Sharpe and J. Boxall, Bacterial community dynamics during the early stages of biofilm formation in a chlorinated experimental drinking water distribution system: implications for drinking water discolouration, *J. Appl. Microbiol.*, 2014, **117**, 286–301.
- 28 K. Garny, H. Horn and T. R. Neu, Interaction between biofilm development, structure and detachment in rotating annular reactors, *Bioprocess Biosyst. Eng.*, 2008, **31**, 619–629.
- 29 S. Miller, H. Greenwald, L. C. Kennedy, R. S. Kantor, R. Jiang, A. Pisarenko, E. Chen and K. L. Nelson, Microbial Water Quality through a Full-Scale Advanced Wastewater Treatment Demonstration Facility, *ACS ES&T Engg*, 2022, **2**(12), 2206–2219.
- 30 L. C. Kennedy, S. E. Miller, R. S. Kantor and K. Nelson, Effect of disinfectant residual, pH, and temperature on microbial abundance in disinfected drinking water distribution systems, *Environ. Sci.: Water Res. Technol.*, 2021, **7**(78), 78–92.
- 31 A. J. Pinto, J. Schroeder, M. Lunn, W. Sloan and L. Raskin, Spatial-Temporal Survey and Occupancy-Abundance Modeling To Predict Bacterial Community Dynamics in the Drinking Water Microbiome, *MBio*, 2014, **5**, DOI: [10.1128/mBio.01135-14](https://doi.org/10.1128/mBio.01135-14).
- 32 F. Ling, C. Hwang, M. W. LeChevallier, G. L. Andersen and W.-T. Liu, Core-satellite populations and seasonality of water meter biofilms in a metropolitan drinking water distribution system, *ISME J.*, 2015, **10**, 582–595.
- 33 E. I. Prest, D. G. Weissbrodt, F. Hammes, M. C. M. van Loosdrecht and J. S. Vrouwenvelder, Long-Term Bacterial Dynamics in a Full-Scale Drinking Water Distribution System, *PLoS One*, 2016, **11**, e0164445.
- 34 S. Gillespie, P. Lipphaus, J. Green, S. Parsons, P. Weir, K. Juskowiak, B. Jefferson, P. Jarvis and A. Nocker, Assessing microbiological water quality in drinking water distribution systems with disinfectant residual using flow cytometry, *Water Res.*, 2014, **65**, 224–234.
- 35 E. I. Prest, F. Hammes, M. C. M. van Loosdrecht and J. S. Vrouwenvelder, Biological Stability of Drinking Water: Controlling Factors, Methods, and Challenges, *Front. Microbiol.*, 2016, **7**, 133.
- 36 F. A. Hammes and T. Egli, New Method for Assimilable Organic Carbon Determination Using Flow-Cytometric Enumeration and a Natural Microbial Consortium as Inoculum, *Environ. Sci. Technol.*, 2005, **39**, 3289–3294.



- 37 C. M. Smith and V. R. Hill, Dead-End Hollow-Fiber Ultrafiltration for Recovery of Diverse Microbes from Water, *Appl. Environ. Microbiol.*, 2009, **75**, 5284–5289.
- 38 M. A. Borchardt, N. L. Haas and R. J. Hunt, Vulnerability of Drinking-Water Wells in La Crosse, Wisconsin, to Enteric-Virus Contamination from Surface Water Contributions, *Appl. Environ. Microbiol.*, 2004, **70**, 5937–5946.
- 39 E. Gatza, F. Hammes and E. Prest, Assessing water quality with the BD Accuri C6 flow cytometer, *BD Biosciences*, 2013, 1–12.
- 40 P. H. Dobrowsky, S. Khan and W. Khan, Resistance of *Legionella* and *Acanthamoeba mauritaniensis* to heat treatment as determined by relative and quantitative polymerase chain reactions, *Environ. Res.*, 2017, **158**, 82–93.
- 41 L. Proia, A. Anzil, J. Subirats, C. Borrego, M. Farrè, M. Llorca, J. L. Balcázar and P. Servais, Antibiotic resistance along an urban river impacted by treated wastewaters, *Sci. Total Environ.*, 2018, **628–629**, 453–466.
- 42 S. S. Silkie and K. L. Nelson, Concentrations of host-specific and generic fecal markers measured by quantitative PCR in raw sewage and fresh animal feces, *Water Res.*, 2009, **43**, 4860–4871.
- 43 H. Whaley, A. Keegan, H. Fallowfield and R. Bentham, Detection of *Legionella*, *L. pneumophila* and *Mycobacterium Avium* Complex (MAC) along Potable Water Distribution Pipelines, *Int. J. Environ. Res. Public Health*, 2014, **11**, 7393–7405.
- 44 Y. Cao, J. F. Griffith, S. Dorevitch and S. B. Weisberg, Effectiveness of qPCR permutations, internal controls and dilution as means for minimizing the impact of inhibition while measuring *Enterococcus* in environmental waters, *J. Appl. Microbiol.*, 2012, **113**, 66–75.
- 45 B. J. Callahan, P. J. McMurdie, M. J. Rosen, A. W. Han, A. J. A. Johnson and S. P. Holmes, DADA2: High-resolution sample inference from Illumina amplicon data, *Nat. Methods*, 2016, **13**, 581–583.
- 46 Q. Wang, G. M. Garrity, J. M. Tiedje and J. R. Cole, Naive Bayesian Classifier for Rapid Assignment of rRNA Sequences into the New Bacterial Taxonomy, *Appl. Environ. Microbiol.*, 2007, **73**, 5261–5267.
- 47 C. Quast, E. Pruesse, P. Yilmaz, J. Gerken, T. Schweer, P. Yarza, J. Peplies and F. O. Glöckner, The SILVA ribosomal RNA gene database project: improved data processing and web-based tools, *Nucleic Acids Res.*, 2013, **41**, D590–D596.
- 48 C. Bertelli, S. Courtois, M. Rosikiewicz, P. Piriou, S. Aeby, S. Robert, J.-F. Loret and G. Greub, Reduced Chlorine in Drinking Water Distribution Systems Impacts Bacterial Biodiversity in Biofilms, *Front. Microbiol.*, 2018, **9**, 2496.
- 49 R. Cheswick, E. Cartmell, S. Lee, A. Upton, P. Weir, G. Moore, A. Nocker, B. Jefferson and P. Jarvis, Comparing flow cytometry with culture-based methods for microbial monitoring and as a diagnostic tool for assessing drinking water treatment processes, *Environ. Int.*, 2019, **130**, 104893.
- 50 A. Nescerecka, J. Rubulis, M. Vital, T. Juhna and F. Hammes, Biological Instability in a Chlorinated Drinking Water Distribution Network, *PLoS One*, 2014, **9**, e96354.
- 51 Q. M. Bautista-de los Santos, J. L. Schroeder, M. C. Sevillano-Rivera, R. Sungthong, U. Z. Ijaz, W. T. Sloan and A. J. Pinto, Emerging investigators series: microbial communities in full-scale drinking water distribution systems – a meta-analysis, *Environ. Sci.: Water Res. Technol.*, 2016, **2**, 631–644.
- 52 J. Chen, W. Li, Q. Tan, D. Sheng, Y. Li, S. Chen and W. Zhou, Effect of disinfectant exposure and starvation treatment on the detachment of simulated drinking water biofilms, *Sci. Total Environ.*, 2022, **807**, 150896.
- 53 Z. Dai, M. C. Sevillano-Rivera, S. T. Calus, Q. M. Bautista-de los Santos, A. M. Eren, P. W. J. J. van der Wielen, U. Z. Ijaz and A. J. Pinto, Disinfection exhibits systematic impacts on the drinking water microbiome, *Microbiome*, 2020, **8**, 42.
- 54 B. Hegarty, Z. Dai, L. Raskin, A. Pinto, K. Wigginton and M. Duhaime, A snapshot of the global drinking water virome: Diversity and metabolic potential vary with residual disinfectant use, *Water Res.*, 2022, **218**, 118484.
- 55 J. Inkinen, S. Siponen, B. Jayaprakash, A. Tiwari, A.-M. Hokajärvi, A. Pursiainen, J. Ikonen, A. Kauppinen, I. T. Miettinen, J. Paananen, E. Torvinen, M. Kolehmainen and T. Pitkänen, Diverse and active archaea communities occur in non-disinfected drinking water systems—Less activity revealed in disinfected and hot water systems, *Water Res.: X*, 2021, **12**, 100101.
- 56 A. Nescerecka, T. Juhna and F. Hammes, Identifying the underlying causes of biological instability in a full-scale drinking water supply system, *Water Res.*, 2018, **135**, 11–21.
- 57 C. Thom, C. J. Smith, G. Moore, P. Weir and U. Z. Ijaz, Microbiomes in drinking water treatment and distribution: A meta-analysis from source to tap, *Water Res.*, 2022, **212**, 118106.
- 58 H. Wang, C. Hu and B. Shi, The control of red water occurrence and opportunistic pathogens risks in drinking water distribution systems: A review, *J. Environ. Sci.*, 2021, **110**, 92–98.
- 59 I. Vaz-Moreira, O. C. Nunes and C. M. Manaia, Diversity and Antibiotic Resistance Patterns of Sphingomonadaceae Isolates from Drinking Water, *Appl. Environ. Microbiol.*, 2011, **77**, 5697–5706.
- 60 W. E. Blyth, E. Shahsavari, A. Aburto-Medina, A. S. Ball and A. M. Osborn, Variation in the Structure and Composition of Bacterial Communities within Drinking Water Fountains in Melbourne, Australia, *Water*, 2022, **14**, 908.
- 61 L. K. Kimbell, E. L. LaMartina, A. D. Kappell, J. Huo, Y. Wang, R. J. Newton and P. J. McNamara, Cast iron drinking water pipe biofilms support diverse microbial communities containing antibiotic resistance genes, metal resistance genes, and class 1 integrons, *Environ. Sci.: Water Res. Technol.*, 2021, **7**, 584–598.
- 62 C. Xi, Y. Zhang, C. F. Marrs, W. Ye, C. Simon, B. Foxman and J. Nriagu, Prevalence of Antibiotic Resistance in Drinking Water Treatment and Distribution Systems, *Appl. Environ. Microbiol.*, 2009, **75**, 5714–5718.
- 63 Y. Hu, L. Jiang, T. Zhang, L. Jin, Q. Han, D. Zhang, K. Lin and C. Cui, Occurrence and removal of sulfonamide antibiotics and antibiotic resistance genes in conventional



- and advanced drinking water treatment processes, *J. Hazard. Mater.*, 2018, **360**, 364–372.
- 64 S. Jia, P. Shi, Q. Hu, B. Li, T. Zhang and X.-X. Zhang, Bacterial Community Shift Drives Antibiotic Resistance Promotion during Drinking Water Chlorination, *Environ. Sci. Technol.*, 2015, **49**, 12271–12279.
- 65 P. Shi, S. Jia, X.-X. Zhang, T. Zhang, S. Cheng and A. Li, Metagenomic insights into chlorination effects on microbial antibiotic resistance in drinking water, *Water Res.*, 2013, **47**, 111–120.
- 66 B. P. Alcock, A. R. Raphenya, T. T. Y. Lau, K. K. Tsang, M. Bouchard, A. Edalatmand, W. Huynh, A.-L. V. Nguyen, A. A. Cheng, S. Liu, S. Y. Min, A. Miroshnichenko, H.-K. Tran, R. E. Werfalli, J. A. Nasir, M. Oloni, D. J. Speicher, A. Florescu, B. Singh, M. Faltyn, A. Hernandez-Koutoucheva, A. N. Sharma, E. Bordeleau, A. C. Pawlowski, H. L. Zubyk, D. Dooley, E. Griffiths, F. Maguire, G. L. Winsor, R. G. Beiko, F. S. L. Brinkman, W. W. L. Hsiao, G. V. Domselaar and A. G. McArthur, CARD 2020: antibiotic resistome surveillance with the comprehensive antibiotic resistance database, *Nucleic Acids Res.*, 2020, **48**, D517–D525.
- 67 M. R. Moore, M. Pryor, B. Fields, C. Lucas, M. Phelan and R. E. Besser, Introduction of Monochloramine into a Municipal Water System: Impact on Colonization of Buildings by *Legionella* spp, *Appl. Environ. Microbiol.*, 2006, **72**, 378–383.
- 68 M. B. Waak, R. M. Hozalski, C. Hallé and T. M. LaPara, Comparison of the microbiomes of two drinking water distribution systems-with and without residual chloramine disinfection, *Microbiome*, 2019, **7**, 87–87.
- 69 Z. Wang, J. Kim and Y. Seo, Influence of Bacterial Extracellular Polymeric Substances on the Formation of Carbonaceous and Nitrogenous Disinfection Byproducts, *Environ. Sci. Technol.*, 2012, **46**, 11361–11369.
- 70 J. Chen, W. Li, J. Zhang, W. Qi, Y. Li, S. Chen and W. Zhou, Prevalence of antibiotic resistance genes in drinking water and biofilms: The correlation with the microbial community and opportunistic pathogens, *Chemosphere*, 2020, **259**, 127483.
- 71 M. B. Waak, T. M. LaPara, C. Hallé and R. M. Hozalski, Occurrence of *Legionella* spp. in Water-Main Biofilms from Two Drinking Water Distribution Systems, *Environ. Sci. Technol.*, 2018, **52**, 7630–7639.
- 72 Y.-H. Chuang, A. Szczuka and W. A. Mitch, Comparison of Toxicity-Weighted Disinfection Byproduct Concentrations in Potable Reuse Waters and Conventional Drinking Waters as a New Approach to Assessing the Quality of Advanced Treatment Train Waters, *Environ. Sci. Technol.*, 2019, **53**, 3729–3738.
- 73 Y.-H. Chuang and W. A. Mitch, Effect of Ozonation and Biological Activated Carbon Treatment of Wastewater Effluents on Formation of N-nitrosamines and Halogenated Disinfection Byproducts, *Environ. Sci. Technol.*, 2017, **51**, 2329–2338.
- 74 D. L. McCurry, K. P. Ishida, G. L. Oelker and W. A. Mitch, Reverse Osmosis Shifts Chloramine Speciation Causing Re-Formation of NDMA during Potable Reuse of Wastewater, *Environ. Sci. Technol.*, 2017, **51**, 8589–8596.
- 75 B. W. Stamps, M. B. Leddy, M. H. Plumlee, N. A. Hasan, R. R. Colwell and J. R. Spear, Characterization of the Microbiome at the World's Largest Potable Water Reuse Facility, *Front. Microbiol.*, 2018, **9**, 2435–2435.
- 76 M. Sousi, G. Liu, S. G. Salinas-Rodriguez, L. Chen, J. Dusseldorp, P. Wessels, J. C. Schippers, M. D. Kennedy and W. van der Meer, Multi-parametric assessment of biological stability of drinking water produced from groundwater: Reverse osmosis vs. conventional treatment, *Water Res.*, 2020, **186**, 116317.
- 77 K. E. Fish, N. Reeves-McLaren, S. Husband and J. Boxall, Uncharted waters: the unintended impacts of residual chlorine on water quality and biofilms, *npj Biofilms Microbiomes*, 2020, **6**, 1–12.

