RSC Advances



PAPER

View Article Online

View Journal | View Issue



Cite this: RSC Adv., 2019, 9, 10034

New chemical mechanism explaining the breakdown of protective oxides on high temperature steels in biomass combustion and gasification plants†‡

Tom Blomberg, P* Tripurari Tripathi and Maarit Karppinen

Biomass is considered a replacement fuel over fossil fuels to mitigate climate change. The switch to biomass in the combustors changes the inorganic chemistry of the flue gases and leads to more severe corrosion of the construction materials of the combustors. The integrity of most high temperature steels relies on the formation of a protective Cr₂O₃ layer on the steel surface at a high temperature environment. The ash compound found on the heavily corroded steel in biomass combustion and gasification plants is KCl, but the mechanism, which triggers the breakdown of the protective Cr₂O₃ layer under the KCl salt is not known. We studied the chemical reactions involved with furnace exposure of KCl and KOH with Cr₂O₃ and identified the formed reaction products with XRD analysis. The amount of reaction products was analyzed from the leachates of the salt-oxide mixtures by UV/VIS spectroscopy. We also used thermodynamic Gibbs energy minimization calculations to evaluate the evolution of reactions as a function of temperature. The results suggests that the reaction of KCl with Cr₂O₃ involves a KOH reaction intermediate that forms before K₂CrO₄ is formed. The amount of reacted potassium as a function of temperature follows the trend of KCl decomposition to KOH and HCl(g) as predicted by thermodynamics calculations. Therefore, we argue that suggested overall reaction of KCl with Cr₂O₃ as found in the corrosion literature: $4KCl + Cr_2O_3 + 1\frac{1}{2}O_2(g) + 2H_2O(g) \Rightarrow 2K_2CrO_4 + 4HCl(g)$, starting with the initiation step: $KCl + H_2O(g)$ ⇒ KOH + HCl(q) and then the formed KOH reacts with Cr₂O₃ to form K₂CrO₄. This explains the initial breakdown of the protective Cr₂O₃ under KCl salt in water containing high temperature atmospheres. The result is essential for the development of new alloys for biomass fired combustors.

Received 23rd January 2019 Accepted 11th March 2019

DOI: 10.1039/c9ra00582j

rsc.li/rsc-advances

1. Introduction

Burning coal is responsible for approximately 25% of anthropogenic CO_2 emissions. The largest use of coal as a fuel is in electricity and heat production, which accounts for about 16% of the total CO_2 emissions. Peplacing coal with sustainable biomass as the fuel in power boilers would lead to substantial reductions in the net CO_2 emission. Also, SO_2 emissions would be diminished due to the generally much lower sulphur content of biomass based fuels compared to coal. However, biomass combustion leads to more severe fouling and corrosion issues of the heat transfer surfaces in boilers. One way to minimize these

problems is to operate the boilers with lower steam temperatures, but that lowers the efficiency of the Rankine cycle leading to higher emission factors per unit of electricity produced.

Potassium behaviour in the boiler has been identified as the major cause of slagging, fouling and corrosion in biomass fired boilers.6 Potassium is found associated in the fuel moisture as water soluble salts, or reacted with the organic functional groups (carboxylic, alkoxy, phenolic) of the lignocellulosic matrix.7 During combustion, potassium is released in the gas phase as elemental potassium, potassium chloride or potassium hydroxide as measured by mass spectrometric or optical methods.8-10 Due to its extreme reactivity, elemental potassium is expected to react to compounds in the vicinity of the biomass particle it is released from. Therefore, the major gas phase potassium compounds in the biomass boiler flue gases are KCl(g) and KOH(g). These compounds may react further with other fuel elements, such as silicon or sulphur to form potassium silicates or potassium sulphate. K2O-SiO2 silicate formation plays a major role in deposit formation in the furnace (slagging) and in bed agglomeration issues in fluidized bed

Aalto University, Department of Chemistry and Materials Science, Kemistintie 1, 02150 Espoo, Finland. E-mail: tom.blomberg@aalto.fi; tripurari.tripathi@aalto.fi; maarit.karppinen@aalto.fi

[†] Electronic supplementary information (ESI) available. See DOI: 10.1039/c9ra00582j

[‡] The raw/processed data required to reproduce these findings are partly included in the ESI section of the manuscript. Additional raw data is available from the authors upon request.

boilers, where silica containing sand is often used as the bed material. 11-13 Formation of K2SO4 plays a major role in aerosol and deposit formation further downstream of the boiler.14,15 K₂SO₄ formation may decrease the corrosion rate of the heat exchangers forming a less corrosive deposit than KCl or KOH/ K₂CO₃. Its formation may however, also increase fouling rate of the heat exchangers forming tenuous deposits that are difficult to be removed by soot blowing, even though the corrosion rate under the deposits may still be low.16,17 During their path through the boiler, KCl(g) and KOH(g) in the flue gases condense out when the gas temperature is decreased below their dew points. Condensation can happen directly on the heat exchanger surfaces or on the ash particles present in the flue gas flow. Purely homogeneous nucleation is also possible in conditions where the flue gas does not contain enough foreign surfaces that can act as nucleation sites for heterogeneous nucleation.18,19 After condensation KCl(s,l) can react heterogeneously further to K2SO4(s,l) and KOH(s,l) can react to K₂SO₄(s,l), KCl(s,l) or K₂CO₃(s,l) as predicted by thermodynamic stabilities of the compounds.20,21

KCl induced corrosion of Fe-Cr steels has been studied extensively in the scientific literature.22-28 Recently, the effect of K₂CO₃ on the high temperature corrosion has gained more interest. It appears both potassium and chlorine are important in the corrosion reactions with steels. It has been suggested that potassium can initiate the destruction of the protective oxide, but chlorine is needed to sustain the corrosion.29,30 KOH induced corrosion has not been extensively studied in the context of high temperature corrosion in biomass fired boilers, but earlier studies have shown that Fe-Cr alloys are unsuitable for service in KOH containing high temperature environments.31-33 Earlier work of the author on the elemental balances of the deposit forming elements in biomass based fuels suggest that KOH(g) condensation may be more important in fouling and corrosion than has previously been thought. The details of K₂CO₃(s,l) formation on the heat exchanger surfaces has not been clarified yet, but its formation has been predicted by thermodynamics when the (Cl(g) + 2S(g)) molar content in the flue gases is lower than the molar K(g) content. K2CO3(s,l) is formed on the heat exchanger surfaces likely via a surface reaction of adsorbed KOH(ads.) with CO₂(g). Homogeneous formation of K₂CO₃(g) in the gas phase, followed by condensation of K₂CO₃(g) is less likely, because of the thermodynamic instability of K₂CO₃(g).^{34,35} K₂CO₃(s,l) has also been directly detected in some boiler deposits.17 In this work we studied in detail the reactivity of KCl and KOH towards Cr₂O₃ and Fe₂O₃, the protective oxide components formed on the Fe-Cr alloys in high temperature oxidizing service conditions. The results may also be of interest for chromite ore roasting by KOH and for understanding corrosion of Cr₂O₃ containing refractory bricks in potassium and chlorine containing environments.36-38

2. Experimental

2.1 Preparation of the mixtures and furnace exposures

KOH-Cr₂O₃, KCl-Cr₂O₃, KOH-Fe₂O₃, KCl-Fe₂O₃ and K₂CrO₄-Cr₂O₃ mixtures were prepared by mixing known amounts of

powders in a 10 ml glass bottle and manually shaking the bottles for approximately 30 s. KOH was from Sigma Aldrich technical grade ≥ 85%, KCl from Alfa Aesar, ACS grade 99-100.5%, K_2CrO_4 from Merck, EMSURE®, ACS grade \geq 99.5%, Cr₂O₃ from E. Merck, grade unknown and Fe₂O₃ from Johnson Matthey Chemicals, Specpure® grade. All powders were weighted with Sartorius CPA225D analytical balance. Larger agglomerates of KCl, KOH and K2CrO4 were grinded manually in a mortar before mixing with the Cr₂O₃ or Fe₂O₃ powder. Cr2O3 and Fe2O3 powders seemed visually homogeneous without agglomerates and were used without any pre-grinding. KCl/Cr₂O₃, KCl/Fe₂O₃ or KOH/Cr₂O₃, KOH/Fe₂O₃ molar ratios were 1 and K₂CrO₄/Cr₂O₃ molar ratio was 0.5 in order to have the same K/metal molar ratio in all of the mixtures. A 10 g batch of each mixture was prepared in one go in a screw cap sealed bottle. From the 10.0 g batch bottles, 1.00 g samples were weighted to a 10 ml sintered Al₂O₃ crucible and then loaded immediately in a muffle furnace (Nabertherm P330) that was at the isothermal exposure temperature (100-800 °C). The samples were exposed in the furnace for 2 hours in ambient air atmosphere. After furnace exposures, the samples were cooled in ambient air so that handling of the crucible was possible with nitrile gloves (5-10 min) and then transferred to glass bottles that were sealed with screw caps. Then the samples were placed in a desiccator cabin for storage. During the analyses, the sample exposure times to ambient air before starting the analyses were minimized by opening the cap and preparing the sample from the bottle only just before starting the analysis. However, the XRD analysis took approximately an hour per sample, therefore possible reactions during the analysis with ambient air could not be completely eliminated. KOH especially is known to be highly hygroscopic and reactive towards CO2 during exposure to ambient air.

2.2 Qualitative determination of CrO₄²⁻ and Cr₂O₇²⁻

20 ml glass bottles were filled almost full with ion exchanged water. Then 0.10 g of each sample was added to the already water filled bottle. The bottles were not agitated by any means in order to let the sample powder sediment to the bottom of the bottle by gravity. The samples were left to stand overnight. The characteristic yellow colour of the $\text{CrO}_4{}^{2-}$ ion started to appear immediately after adding the sample powder and the intensity of the colour increased with time. The sample bottles were then photographed to record the characteristic yellow colour of $\text{CrO}_4{}^{2-}$ and the orange colour of $\text{CrO}_4{}^{2-}$.

2.3 Qualitative determination of colourful Fe-complex ions

20 ml glass bottles were filled almost full with ion exchanged water. Then 0.10 g of each sample was added to the already water filled bottle. The bottles were not agitated by any means in order to let the sample powder sediment to the bottom of the bottle by gravity. The samples were let to stand still overnight. All the solutions were colourless indicating no signs of water soluble $FeCl_3$ (yellow to orange) or K_2FeO_4 (FeO_4^{2-} ion is purple) in the samples in concentrations high enough to be visible to the naked eye.

(1)

RSC Advances Paper

2.4 XRD measurements

XRD analysis was done with PANalytical X'pert Pro PW 3040/60 powder diffraction spectrometer with monochromated Cu Kalpha X-ray source ($\alpha = 1.5406 \text{ Å}$). Samples were first grinded manually in a mortar to make a visually homogeneous powder. Then the sample holder was filled evenly with the powder, pressed against a flat surface to level the sample surface with the sample holder top surface and then XRD θ -2 θ scans were recorded from 10-90°. The automatic phase identification algorithm of the X'Pert HighScore Plus program was used for preliminary identification of the phases. Then the results were checked manually and the most likely crystalline phases where manually identified using the JCPDS cards. The XRD cards used for phase identifications were 00-021-0645 for KOH, 00-011-0655 for K₂CO₃·1.5H₂O, 00-015-0365 for K₂CrO₄, 04-007-3113 for KCl, 01-078-5435 for Cr₂O₃, 04-012-4476 for K₂Cr₂O₇, 01-085-0599 for Fe₂O₃, 00-039-0892 for KFeO₂, 00-039-1106 for K₂Fe₄O₇ and 01-078-6089 for $K_{1.75}Fe_{1.25}O_4$.

2.5 UV/VIS spectroscopic measurements of CrO₄²⁻

Approximately 0.20 g of sample powder was mixed with 20 ml of room temperature ion exchanged water. The solution was first stirred in a beaker with a magnetic stirrer for 15 min. Then the solution was filtered using qualitative filter paper, 410 (Cat. No. 516-0802 from VWR), the residue washed two times with 10 ml of room temperature ion exchanged water. Then the filtrates were transferred to 50 ml volumetric flasks and the flask was filled to the mark with ion exchanged water and mixed. The CrO₄²⁻ concentrations of the filtrates were determined by UV/ VIS spectroscopy using Shimadzu UV-2600 spectrophotometer and polymethylmethacrylate cuvettes. Absorbance at 372 nm was used for CrO_4^{2-} . It is not possible to determine $Cr_2O_7^{2-}$ and CrO₄²⁻ separately, because they are in equilibrium with each other in a water solution. This equilibrium depends on the pH and p[Cr] of the solution. With pH values > 6.7, the CrO₄²⁻ ion is reported to be the stable form regardless of the Cr-concentration.³⁹ Therefore, the K₂Cr₂O₇ possibly present originally in the samples was detected as CrO₄²⁻ and the concentration determined reflects the sum of K₂CrO₄ + K₂Cr₂O₇ originally in the sample. The pH values of the filtrates were determined to be ≥ 7 with a pH indicator sticks (Fisher Scientific number 10642751). All the KCl based samples had pH = 7 and KOH based samples had pH = 7 in samples exposed at \geq 500 °C and pH 8-12 in samples exposed at ≤400 °C. The higher pH with low temperature samples in case of KOH mixtures was caused by the KOH that was not reacted to K2CrO4, but formed K2CO3·1.5H2O during the furnace/ambient exposures. When dissolving in water, K₂CO₃·1.5H₂O results in a basic solution. Concentration standards were prepared by dissolving known amounts of K₂CrO₄ powder to ion exchanged water in 50 ml volumetric flasks (ESI†). Then the absorbance of the standards were measured and linear concentration-absorbance curves were established. Then the absorbance of the sample filtrates were measured and the concentrations were determined using the standard curves. In cases where the sample had ${\rm CrO_4}^{2-}$ concentration so high that the absorbance was higher than the

standards, the sample was diluted with pure water in volumetric flasks with 1:10 or 1:20 dilution ratios, which ever was suitable to bring the absorbance value in between the standards. Molar ratios reacted to K2CrO4 and K2Cr2O7 were calculated as

$$= \frac{2[\operatorname{CrO}_{4}^{2-}]V}{m}$$

$$\left(\frac{M_{\rm KCl}}{M_{\rm KCl} + M_{\rm Cr_2O_3}} \ M_{\rm KCl} + \frac{M_{\rm Cr_2O_3}}{M_{\rm KCl} + M_{\rm Cr_2O_3}} \ M_{\rm Cr_2O_3}\right)$$

$$\frac{K_2CrO_4 + K_2Cr_2O_7}{K_2CrO_4(theor.)}$$

 $K_2CrO_4 + K_2Cr_2O_7$

$$= \frac{2\left[\text{CrO}_{4}^{2-}\right]V}{\left(\frac{M_{\text{KOH}}}{M_{\text{KOH}} + M_{\text{Cr}_{2}\text{O}_{3}}}M_{\text{KOH}} + \frac{M_{\text{Cr}_{2}\text{O}_{3}}}{M_{\text{KOH}} + M_{\text{Cr}_{2}\text{O}_{3}}}M_{\text{Cr}_{2}\text{O}_{3}}\right)}$$
(2)

V = volume, l; m = sample mass, g; M = molar mass, g mol^{-1} ; $[CrO_4^{2-}] = CrO_4^{2-}$ ion concentration, mol l^{-1} .

Error estimation of the above described method for K₂CrO₄ determination was done by running a few duplicate runs with KOH + Cr₂O₃ mixtures (2 at 300 and 400 °C exposure temperatures). Because of the small number of duplicate samples, error was estimated with the range rather than with statistical methods. The error range (max-min) of the method was found to be about 0.08 (or 8%-points). This error value was assumed to be similar at other exposure temperatures and also for the leaching tests described below for Fe³⁺.

2.6 UV/VIS spectroscopic measurements of Fe³⁺

2.6.1 Water soluble Fe³⁺. Approximately 0.20 g of sample powder was mixed with 20 ml of room temperature ion exchanged water. The solution was stirred in a beaker with a magnetic stirrer for 15 min. Then the solution was filtered using qualitative filter paper 410 (Cat. No. 516-0802 from VWR), the residue washed two times with 10 ml of room temperature ion exchanged water. Then the filtrates were transferred to 50 ml volumetric flasks and the flask was filled to the mark with ion exchanged water and mixed. The Fe3+ concentrations of the filtrates were determined by UV/VIS spectroscopy using Shimadzu UV-2600 spectrophotometer. Absorbance at 225 nm was used for Fe³⁺. Fe³⁺ ion in a water solution is present as Fe³⁺, Fe(OH)²⁺ and Fe(OH)₂⁺ ions or as non-water soluble Fe(OH)₃ precipitate, depending on the pH of the solution.40 The pH values of the filtrates were determined with a pH indicator sticks (Fisher Scientific number 10642751). All the KCl based samples had pH = 7 and all the KOH based samples had pH =12. The high pH value over the entire exposure temperature in case of KOH based samples indicate that they may have contained some unreacted KOH/K2CO3 or then the higher pH at firing temperatures \geq 500 °C (which did not reveal any KOH/ K₂CO₃ residues by XRD) was originated from the dissolution of

RSC Advances

This article is licensed under a Creative Commons Attribution 3.0 Unported Licence. Open Access Article. Published on 29 March 2019. Downloaded on 8/2/2025 5:06:29 AM.

Paper

Fable 1 Input files in the thermodynamic equilibrium calculations with the HSC v.6.12 software $^{\circ}$

KCl-Cr ₂ O ₃	$T[^{\circ}\mathrm{C}]$ [1	kmount kmol]	$\begin{array}{ccc} & \text{Amount Amount} \\ T \left[^{\circ} \text{C} \right] & \text{[kmol]} & \text{[mol\%]} & \text{KCl-Fe}_2 \text{O}_3 \\ \end{array}$	Amount $T\left[^{\circ }C\right] \text{ [kmol]}$	Amount Amount Amount Amount Amount Amount Amount Amount Amount $T[^{\circ}C]$ [kmol] [mol%] KOH- Cr_2O_3 $T[^{\circ}C]$ [kmol] [mol%] KOH- Fe_2O_3 $T[^{\circ}C]$ [kmol] [mol%] [mol%]	Amount 3 T [°C] [kmol]	Amount Amount [kmol] [mol%] KOH–Fe ₂ O	$\frac{Amount}{A_3\ T[^\circC]\ [kmol]}$	Amount Amount [kmol] [mol%] KOH-KC	Amou [T[°C] [kmol	Amount Amount [kmol] [mol%]
Phase 1: KCl	0.020 25.000 0.010	0.020	0.020 100.000 Phase 1: 0.010 50.000 KCl	0.020 25.000 0.010	100.000 Phase 1: $50.000 \text{ Cr}_2\text{O}_3$	0.020 25.000 0.010	0.020 100.000 Phase 1: 0.010 50.000 Fe ₂ O ₃	0.020 25.000 0.010	0.020 100.000 Phase 1: 0.010 50.000 KCl	0.010 25.000 0.010	100.000
Cr_2O_3	25.000	0.010	50.000 Fe ₂ O ₃	25.000 0.010	$50.000 \text{ K}_2\text{O*Cr}_2\text{O}_6$, 25.000	КОН	25.000 0.010	50.000 KOH	25.000	
$\mathrm{K_2O^*Cr_2O_6}$	25.000		КОН	25.000	КОН	25.000 0.010	$50.000 \text{ K}_2\text{CO}_3$. $1.5\text{H}_2\text{O}$	25.000	K_2CO_3	25.000	
КОН	25.000		$K_2CO_3 \cdot 1.5H_2O 25.000$,O 25.000	$ m K_2CO_3$. $ m 1.5H_2O$	25.000	KFeO_2	25.000			
$K_2CO_3 \cdot 1.5H_2O 25.000$	O 25.000		KFeO_2	25.000	$\mathrm{K}_2\mathrm{CrO}_4$	25.000					
K_2CrO_4	25.000										
Phase 2:	6	966.66	100.000 Phase 2:	966.66	100.000 Phase 2:	966.66	100.000 Phase 2:	966.66	100.000 Phase 2:	99.995	100.000
$H_2O(g)$	25.000 0.990	0.660	$0.990 \text{H}_2\text{O(g)}$	25.000 0.990	$0.990 \mathrm{H_2O(g)}$	25.000 0.990	$0.990 \mathrm{H_2O(g)}$	25.000 0.990	$0.990 \mathrm{H_2O(g)}$	25.000 0.990	0.990
$CO_2(g)$	25.000 0.035	0.035	$0.035 \text{ CO}_2(g)$	25.000 0.035	$0.035 \text{ CO}_2(g)$	25.000 0.035	$0.035 \text{ CO}_2(g)$	25.000 0.035	0.035 HCl(g)	25.000	
$O_2(g)$	25.000 20.740	0.740	$20.741 O_2(g)$	25.000 20.740	$20.741 O_2(g)$	25.000 20.740	$20.741 O_2(g)$	25.000 20.740	$20.741 \text{ CO}_2(g)$	25.000 0.035	
$N_2(g)$	25.000 77.311	7.311	$77.314 \text{ N}_2(\text{g})$	25.000 77.311	$77.314 \text{ N}_2(\text{g})$	25.000 77.311	$77.314 \text{ N}_2(\text{g})$	25.000 77.311	$77.314 O_2(g)$	25.000 20.740	20.741
HCl(g)	25.000		HCI(g)	25.000	Ar(g)	25.000 0.920	0.920 Ar(g)	25.000 0.920	$0.920 \text{ N}_2(\text{g})$	25.000 77.310	
Ar(g)	25.000 0.920	0.920	0.920 Ar(g)	25.000 0.920	0.920 KOH(g)	25.000	KOH(g)	25.000	Ar(g)	25.000 0.920	0.920
KCI(g)	25.000		KCI(g)	25.000					KOH(g)	25.000	
KOH(g)	25.000		KOH(g)	25.000					KCI(g)	25.000	
a K ₂ Cr ₂ O ₇ is	marked as	$K_2O^*C_1$	^a $K_2Cr_2O_7$ is marked as $K_2O^*Cr_2O_6$ in the software.								

 $KFeO_2$ ($KFeO_2 + 2H_2O = K^+ + Fe^{3+} + 4OH^-$). In order to shift the equilibrium so that all the dissolved Fe(III) was in the Fe³⁺ state, the filtrates were buffered to pH = 1 by mixing 1:1 ratio of sample with a solution to 1 mol l^{-1} HCl (1 : 2 dilution). This pH stabilized solution was then used to fill the quartz cuvette in the UV/VIS absorption measurements. The added Cl-ion can also form complex ions with Fe in the form $Fe(H_2O)_{6-x}(Cl)_x^{3-x}$. Concentration standards were prepared by dissolving known amounts of FeCl₃·6H₂O powder to ion exchanged water and diluting (ESI†). The pH of the standards were buffered to 1 with 1 mol l^{-1} HCl before measurement as with the samples. Then the absorbance of the standards were measured and linear concentration-absorbance curves were established. Then the absorbance of the sample filtrates were measured and the concentrations were determined using the standard curves. Molar ratios reacted to KFeO2 were calculated as follows:

KFeO₂ KFeO₂(theor.)

$$= \frac{[Fe^{3+}]V}{\left(\frac{M_{KCl}}{M_{KCl} + M_{Fe_2O_3}} M_{KCl} + \frac{M_{Fe_2O_3}}{M_{KCl} + M_{Fe_2O_3}} M_{Fe_2O_3}\right)}$$
(3)

KFeO2 KFeO₂(theor.)

$$= \frac{[Fe^{3+}]V}{\left(\frac{M_{KOH}}{M_{KOH} + M_{Fe_2O_3}} M_{KOH} + \frac{M_{Fe_2O_3}}{M_{KOH} + M_{Fe_2O_3}} M_{Fe_2O_3}\right)}$$
(4)

V = volume, l; m = sample mass, g; M = molar mass, g mol^{-1} ; $[Fe^{3+}] = Fe^{3+}$ ion concentration, mol l^{-1} .

2.6.2 Acid soluble Fe³⁺. The analysis was done in a similar way as has been discussed for the H2O soluble Fe3+ determination, except that the 15 min leaching steps were done in 20 ml of 1 mol l⁻¹ HCl in water solutions instead of pure water. Also the washing of the filtration residue was done with HCl containing water ($\approx 0.1 \text{ mol } l^{-1} \text{ HCl}$, pH = 1) instead of pure water. This prevented the precipitation of Fe(OH)₃ that was possible in the water leaching steps, where the pH values of the filtrates were ≥7. In case of 1 M HCl leaching, some filtrates had a yellow colour visible already to a naked eye, indicating that indeed the acid leaching resulted in much higher dissolution of the reaction products compared to H₂O leaching. All the filtrates had a pH value of 1, measured with pH indicator sticks (Fisher Scientific number 10642751). Because the pH of the filtrates were stabilized to one already during the leaching step, they were used directly to fill the quartz cuvette in the UV/VIS absorption measurements. In cases where the sample had Fe³⁺ concentration so high that the absorbance was higher than the standards, the sample was diluted in volumetric flasks with 1:2, 1:50 or 1:100 dilution ratios, which ever was suitable to bring the absorbance value in between the standards. In the 1:50 and 1:100 dilution cases, the dilution was done by

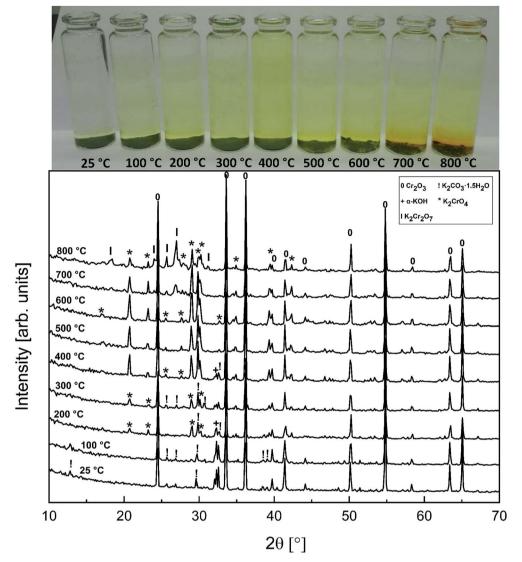


Fig. 1 XRD patterns and appearance of the water solutions on top of the KOH-Cr₂O₃ mixtures after furnace exposures

adding 1 ml of sample, then 5 ml of 1 mol l^{-1} HCl, and then filling the volumetric flask with pure H_2O .

2.7 Thermodynamic calculations

HSC v6.12 Gibbs energy minimization software was used in the thermodynamic calculations. The input files for the calculations are presented in Table 1. Air composition with $\approx 0.99~\text{mol}\%~\text{H}_2\text{O}$ vapor (RH $\approx 32\%~\text{at }25~^\circ\text{C}$) was used to simulate the humid ambient gas phase in the muffle furnace. In case of KCl based systems, HCl(g) was added as the possible gas phase Cl-compound released in the reactions. Note that each gas phase component in the atmosphere has at least several times higher absolute amounts than any of the solid phase components. This assures that the amount of the formed products was never limited by the amount of the gas phase component, thus simulating an open ambient system. The calculated systems were kept as simple as possible. Therefore, in addition to the reactants, only the phases identified in the

XRD analysis were added to the solid phase input file. In the case of Fe_2O_3 systems, $K_2Fe_4O_7$ was detected by XRD in the sample with the highest exposure temperature with KOH, but unfortunately it was not found in the HSC v6.12 database and could not be included in the thermodynamic calculation.

3. Results

3.1 KOH-Cr₂O₃ system

The powder XRD analysis of the system after furnace exposures is shown in Fig. 1. It appears that KOH reacted partially with the air in the furnace and formed $K_2CO_3 \cdot 1.5$ H_2O in samples exposed to furnace temperatures below 500 °C. Samples exposed to 500 °C or higher firing temperatures did not contain any residual $K_2CO_3 \cdot 1.5$ H_2O or KOH. This was also reflected by the pH of the water soluble filtrates as explained in the experimental section. It seems that the reaction of KOH with Cr_2O_3 , forming K_2CrO_4 is not fast enough below 500 °C and competes

Paper

2 K2Cr2O7 --- • [CrO42-] exp. K2CrO4 K2CrO4+K2Cr2O7 1.5 Cr203 n/n(K₂CrO₄)theor. [mol/mol] 1 0.5 100 200 300 400 500 600 700 800

Fig. 2 Comparison of the experimentally determined amount of $[CrO_4^{2-}]$ in the filtrates with the thermodynamically predicted amount of the reaction products in the KOH- Cr_2O_3 system with pure water leaching.

T [°C]

with $K_2CO_3 \cdot 1.5$ H_2O formation in the experimental conditions used. According to XRD analysis, K_2CrO_4 formation starts already with a solid-solid reaction at 200 °C. Melting point of KOH is 406 °C, so it appears that there is no need for molten

-0.5

phase to form in the system before K_2CrO_4 formation proceeds. The photograph in Fig. 1 reveals the characteristic colour of the $CrO_4^{\ 2^-}$ ion already appearing in the water soluble fraction of the products at room temperature exposures. However, this

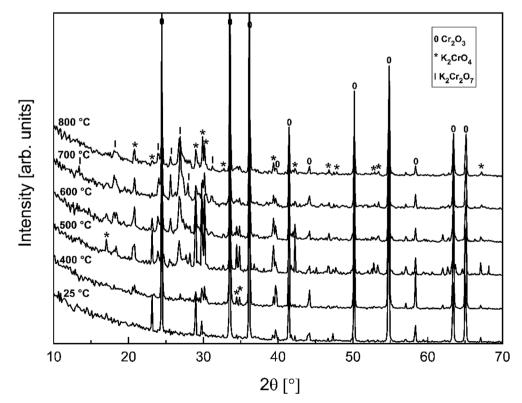


Fig. 3 XRD patterns for the K₂CrO₄-Cr₂O₃ mixtures after furnace exposures.

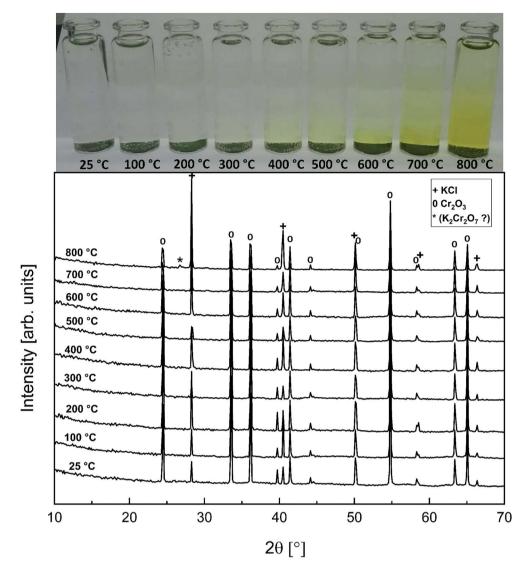


Fig. 4 $\,$ XRD patterns and appearance of the water solutions on top of the KCl-Cr₂O₃ mixtures after furnace exposures

CrO₄²⁻ may form from the dissolution of Cr₂O₃ in the basic water solution and therefore it is considered that the XRD analysis provides a better estimation of the onset temperature where K₂CrO₄ formation starts. The characteristic orange colour of the Cr₂O₇²⁻ ion was detected in samples fired at 700 °C and 800 °C. K₂Cr₂O₇ was also detected in the XRD analysis at these firing temperatures. Thermodynamic calculations predict K₂Cr₂O₇ to be the most stable reaction product throughout the temperature range used as shown in Fig. 2, but its formation appears to be kinetically prevented below 700 °C. The experimental results clearly show that K₂CrO₄ formation is kinetically preferred at the studied temperature range and exposure time used. Like explained above, K2CrO4 formation itself seemed also to be kinetically controlled at temperatures lower than 500 °C. The maximum CrO₄ ²⁻ amount (>90% of the theoretical) in the reaction products was measured at 500 °C furnace exposure, after which the amount decreased slightly at higher temperatures. Taking into account the experimental errors

associated with the $\text{CrO}_4{}^2-$ analysis, it is suggested that starting at 500 °C, practically all the KOH had reacted to K_2CrO_4 and that the slightly lower amounts of $\text{CrO}_4{}^2-$ detected at higher exposure temperatures can be explained by slight loss of KOH by evaporation, competing with the reaction with Cr_2O_3 .

3.2 K₂CrO₄-Cr₂O₃ system

In order to determine if the $K_2Cr_2O_7$ formation at higher firing temperatures proceeds directly from the reaction with KOH or via first formation of K_2CrO_4 and then further reaction with Cr_2O_3 , the K_2CrO_4 – Cr_2O_3 system was studied with XRD analysis. Results are presented in Fig. 3. From the XRD analysis it is clear that K_2CrO_4 can react with Cr_2O_3 and form $K_2Cr_2O_7$ at exposure temperatures ≥ 500 °C. Therefore, it is suggested that direct reaction of KOH with Cr_2O_3 forms K_2CrO_4 and that the formation of $K_2Cr_2O_7$ requires always the K_2CrO_4 reaction intermediate to form first.

RSC Advances Paper

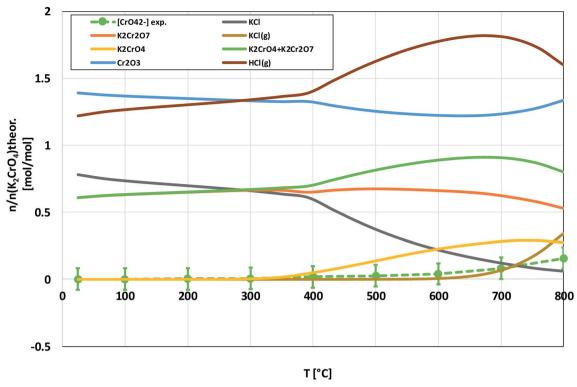


Fig. 5 Comparison of the experimentally determined amount of [CrO₄²⁻] in the filtrates with the thermodynamically predicted amount of the reaction products in the KCl-Cr₂O₃ system with pure water leaching

3.3 KCl-Cr₂O₃ system

Compared to KOH, KCl is substantially less reactive with Cr₂O₃. As shown in the XRD analysis in Fig. 4, there were no clear signs of reaction with Cr₂O₃ until the highest firing temperature, 800 °C. At 800 °C, an additional peak was detected at 26.95° (2θ). This peak coincides with the (021) reflection of K₂Cr₂O₇. However, using only one peak in phase identification is not reliable, but based on the analogy with results from the KOH-Cr₂O₃ and K₂CrO₄-Cr₂O₃ systems, K₂Cr₂O₇ was considered to be the most likely reaction product at 800 °C. CrO₄²⁻ was detected qualitatively and quantitatively also at lower firing temperatures as shown in Fig. 4 and 5. Thermodynamic calculation predicted again the formation of K₂Cr₂O₇ and K₂CrO₄ as the major products, but now the discrepancy between the thermodynamic prediction and experimental results was higher than with KOH. CrO₄²⁻ was detected only in samples exposed to firing temperatures ≥ 400 °C and even at 800 °C the CrO_4^{2-} amount was only ≈16% of the theoretical maximum.

KOH-Fe₂O₃ system

Fig. 6 shows the XRD analysis of the KOH-Fe₂O₃ system. Reaction with Fe₂O₃ started at 200 °C firing temperature, forming KFeO2 as the reaction product. KFeO2 stayed as the major reaction product throughout the temperature range. At 500 °C an additional peak at 27.95° (2 θ) was detected that could not be assigned to KFeO₂. This peak was assigned to potassium containing magnetite, $K_{1.75}Fe_{1.25}O_4$ that has the maximum intensity powder XRD peak at this position, but with one peak only, the identification remains doubtful. At 800 °C firing temperature, K₂Fe₄O₇ could also be identified as the reaction product in addition to KFeO2. There was no indication of higher oxidation state than +3 reaction products of Fe, such as K₂FeO₄. This was consistent with the lack of any colour of the water solutions containing the dissolved reaction products shown in Fig. 6. This result reflects the more favourable tendency of Cr to adapt oxidation state +6 compared to Fe. The comparison of the measured water soluble and acid soluble Fe3+ amounts with the thermodynamic prediction are presented in Fig. 7. No water soluble Fe³⁺ was found, but the amount of acid soluble Fe³⁺ was very close to the thermodynamically predicted amount of KFeO₂. This difference in the filtrates as a function of pH is caused by the fact that either KFeO2 is not soluble in water, or that after initial dissolution of KFeO2, rapid formation of insoluble Fe(OH)₃ takes place in the basic solution. The high OH concentration precipitates the initially dissolved iron and captures it in the filtration residue. In acidic conditions, Fe(OH)3 formation is prevented and KFeO2 was dissolved completely in the 15 min leaching step and the dissolved iron stayed in the solution phase during the filtration step.

3.5 KCl-Fe₂O₃ system

As with the KCl-Cr₂O₃ system, KCl turned out to be much less reactive towards Fe₂O₃ compared to KOH. There was no sign of any reaction in the XRD analysis or in the visual qualitative analysis of the water soluble reaction products as shown in Fig. 8. Similar to the KOH-Fe₂O₃ case, no water soluble iron was

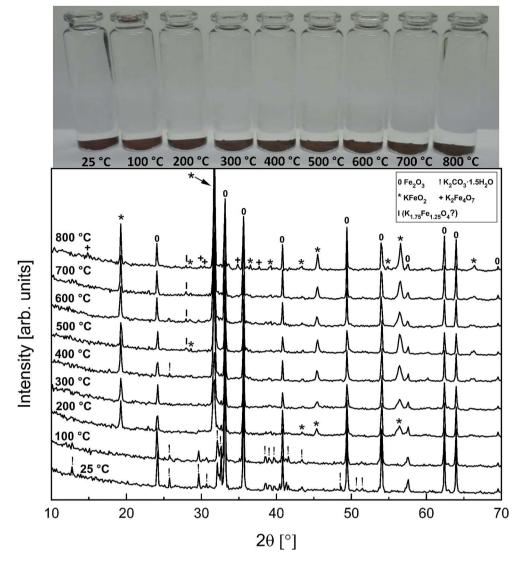


Fig. 6 XRD patterns and appearance of the water solutions on top of the KOH-Fe₂O₃ mixtures after furnace exposures.

found, but now there was only traces of ${\rm Fe}^{3+}$ detected even in the acid soluble filtrate. The results agree with thermodynamic equilibrium calculations, which predicted only slight reaction in the KCl–Fe $_2{\rm O}_3$ system at temperatures > 600 °C to form KFeO $_2$ as shown in Fig. 9.

4. Discussion

Our results are consistent with the suggestion that the reaction of KCl with Cr_2O_3 is initiated by K_2CrO_4 formation as found in the corrosion literature. However, we argue that the suggested overall reaction of KCl with Cr_2O_3 :

$$\begin{array}{ll} 4KCl \ + \ Cr_2O_3 + 1\frac{1}{2}\ O_2(g) + 2H_2O(g) \ \to \ 2K_2CrO_4 \\ \\ + \ 4HCl(g) \end{array} \eqno(R1)$$

starts with the initiation step:

$$KCl + H_2O(g) \leftrightarrow KOH + HCl(g)$$
 (R2)

and then the formed KOH can easily react with the protective oxide as shown in the experiments. Previous hypotheses of the mechanisms of steel corrosion under KCl(s) exposures have focused on the effect of Cl₂(g) or HCl(g) as the corrosive substances and the effect of KOH has been neglected.44,45 However, combustion environments contain inevitably also H₂O(g) in the flue gases and therefore KOH formation should not be neglected. Furthermore, many virgin biomass fuels contain very little Cl, so there is simply not much Cl2(g) or HCl(g) available in the flue gases when combusting these types of fuels. Still KCl layer has been found on the heat exchanger surfaces and previous work has argued that the corroding Cl₂(g) or HCl(g) must form from the KCl layer, but the fate of the K when the Cl₂(g) or HCl(g) forms from KCl has not been studied in detail. In waste incineration, the situation is different, because the feedstock contains typically large amounts of Cl and therefore the direct gas phase attack by Cl₂(g) or HCl(g) may be more relevant. It may be that the chlorine corrosion

Paper RSC Advances

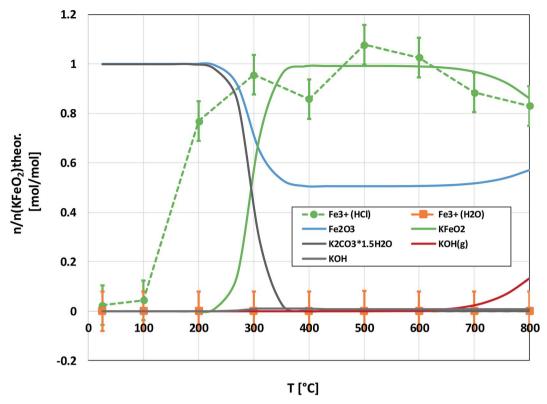


Fig. 7 Comparison of the experimentally determined amount of $[Fe^{3+}]$ in the filtrates with the thermodynamically predicted amount of the reaction products in the KOH-Fe₂O₃ system with pure water leaching and leaching in 1 M HCl_(aq) solution.

mechanisms taking place in high chlorine content feedstock combustion cannot be applied to explain the corrosion in virgin biomass combustion.

4.1 Reaction of KOH with Cr₂O₃

KOH will react readily with Cr₂O₃, reacting already at 200 °C:

4KOH + Cr₂O₃ +
$$1\frac{1}{2}$$
O₂(g) → 2K₂CrO₄
+2H₂O(g) ($T \ge 200$ °C) (R3)

The formed K_2CrO_4 can react further to $K_2Cr_2O_7$ at high temperatures. Direct formation of $K_2Cr_2O_7$ without the K_2CrO_4 intermediate is always kinetically hindered:

$$2K_2CrO_4 + Cr_2O_3 + 1\frac{1}{2}O_2(g) \leftrightarrow 2K_2Cr_2O_7 \quad (T > 400 \,^{\circ}C)$$
(R4)

4.2 Reaction of KOH with Fe₂O₃

KOH will react readily with Fe₂O₃, reacting already at 200 °C:

$$2KOH + Fe_2O_3 \rightarrow 2KFeO_2 + H_2O(g) (T \ge 200 \,^{\circ}C)$$
 (R5)

Although not experimentally verified in this study, we propose that in analogy to $KOH-Cr_2O_3$ case, the formed $KFeO_2$

can react further to $K_2Fe_4O_7$ at high temperatures. It is suggested that $K_2Fe_4O_7$ formation without the KFeO₂ intermediate is kinetically hindered as the $K_2Cr_2O_7$ formation in the Cr_2O_3 case:

$$2KFeO_2 + Fe_2O_3 \leftrightarrow K_2Fe_4O_7 (T > 700 \,^{\circ}C)$$
 (R6)

4.3 Reaction of KCl with Cr₂O₃ and Fe₂O₃

Based on the results in this study, it is proposed that the reactivity of KCl towards both oxides in H2O(g) containing environment can simply be explained by the thermodynamics of the decomposition reaction R2. Fig. 10 presents the thermodynamic equilibrium of R2 in ambient moist air. It is suggested that HCl(g) does not play a key role in the reaction with the oxides and that the reactive compound is the formed KOH. The reason that we did not detect any reaction between KCl and Fe₂O₃, but did detect K₂CrO₄ formation with Cr₂O₃ at >500 °C can be explained by the higher thermodynamic stability of K₂CrO₄ compared to KFeO₂ as shown in Fig. 11. K₂CrO₄ is much more stable than KFeO₂, therefore it is suggested that the KOH formed in the decomposition of KCl at >500 °C does not form KFeO₂ as readily as K₂CrO₄ and most of the formed KOH is lost in the gas phase by vaporization before reacting with Fe2O3. That is why KFeO₂ was not detected in the KCl-Fe₂O₃ system.

In case of Fe-Cr steel corrosion, once the protective oxide is destroyed by KOH and if the bare metals are exposed to the

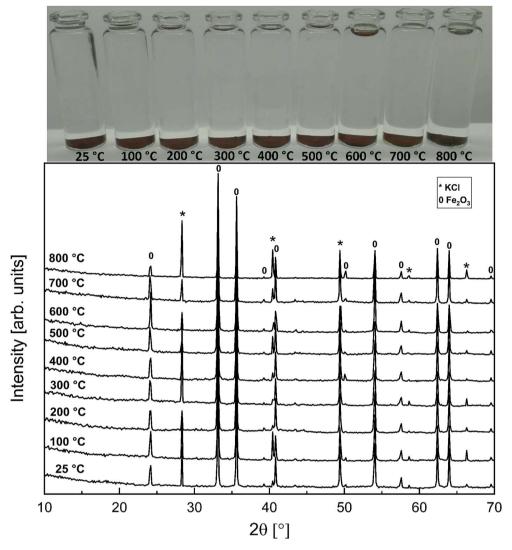


Fig. 8 XRD patterns and appearance of the water solutions on top of the KCl-Fe₂O₃ mixtures after furnace exposures.

atmosphere, HCl(g) may take part in the continuation of corrosion:

$$Cr + 2HCl(g) + \frac{1}{2}O_2(g) \rightarrow CrCl_2(g) + H_2O(g)$$
 (R7)

$$Fe + 2HCl(g) + \frac{1}{2}O_2(g) \rightarrow FeCl_2(g) + H_2O(g)$$
 (R8)

$$Cr \ + \ 3HCl(g) \ + \ \frac{3}{4}O_2(g) \ \rightarrow \ CrCl_3(g) \ + \ 1 \frac{1}{2}H_2O(g) \ \ \ \ \mbox{(R9)}$$

$$Fe \ + \ 3HCl(g) \ + \ \frac{3}{4}O_2(g) \! \to \! FeCl_3(g) + 1 \frac{1}{2}H_2O(g) \qquad \mbox{(R10)}$$

If KCl diffuses through the oxide scale (grain boundary diffusion), the formation of the reactive chlorine species can also take place at the metal-scale interface:

$$Cr + 2KCl + 2O_2(g) \rightarrow K_2CrO_4 + Cl_2(g)$$
 (R11)

$$Cr + 2KCl + 4H_2O(g) \rightarrow K_2CrO_4 + 2HCl(g) + H_2(g)$$
 (R12)

$$2\text{Fe} + 2\text{KCl} + 2\text{O}_2(g) \rightarrow 2\text{KFeO}_2 + \text{Cl}_2(g)$$
 (R13)

$$2\text{Fe} + 2\text{KCl} + 2\text{H}_2\text{O}(g) \rightarrow 2\text{KFeO}_2 + 2\text{HCl}(g) + \text{H}_2(g)$$
 (R14)

The formed chlorine compounds can further attack the metal leading to the active oxidation mechanism by chlorine. 46 However, it is somewhat arbitrary to speculate about the corrosion reactions with elemental metals, because these reactive metals in the elemental form will thermodynamically favour reaction with practically any reactant. For example, a chlorine free corrosion mechanism involving only KOH may also be suggested:

$$Cr + 2KOH + 1\frac{1}{2}O_2(g) \rightarrow K_2CrO_4 + H_2O(g)$$
 (R15)

$$2\text{Fe} + 2\text{KOH} + 1\frac{1}{2}\text{O}_2(g) \rightarrow 2\text{KFeO}_2 + \text{H}_2\text{O}(g)$$
 (R16)

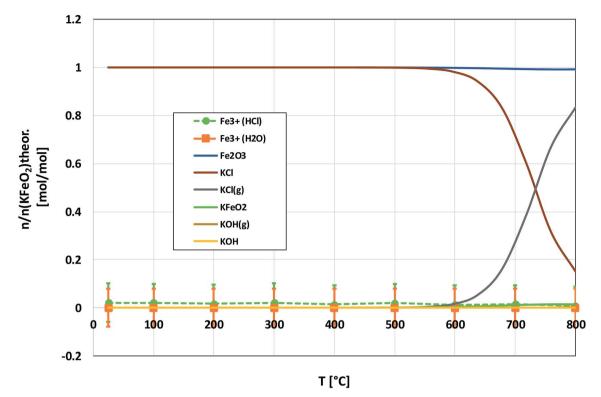


Fig. 9 Comparison of the experimentally determined amount of [Fe³⁺] in the filtrates with the thermodynamically predicted amount of the reaction products in the KCl-Fe $_2O_3$ system with pure water leaching and leaching in 1 M HCl $_{(aq)}$ solution.

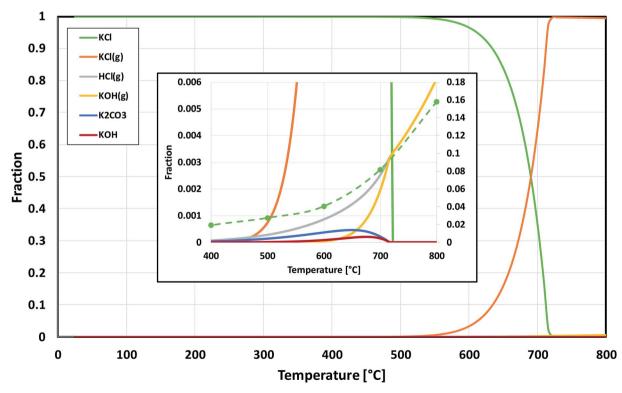


Fig. 10 Thermodynamic stability of KCl in humid air, calculated with HSC v6.12 software. The inset is a zoomed image from the bottom right $corner\ of\ the\ chart.\ The\ green\ dashed\ line\ in\ the\ inset\ shows\ the\ trend\ of\ the\ experimentally\ determined\ amount\ of\ potassium\ reacted\ to\ K_2CrO_4$ when KCl and Cr₂O₃ reacted in the furnace (shown also in Fig. 5).

RSC Advances Paper

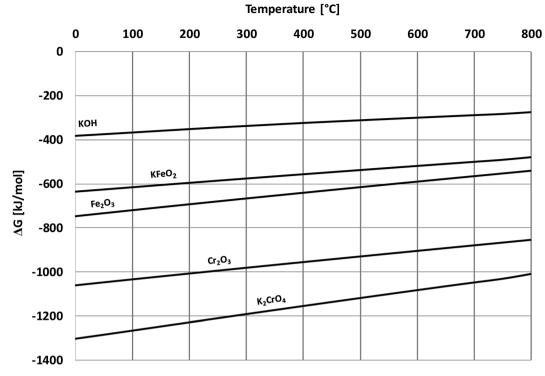


Fig. 11 Comparison of Gibbs free energies of formation of the reactants and the corrosion products, calculated with HSC v6.12 software.

The formed water or the $O_2(g)$ diffusing through the oxide scale can further oxidize the underlying metal and form Cr_2O_3 or Fe_2O_3 oxides, which are then consumed by KOH according to reactions R3 and R5, and a chlorine free active oxidation mechanism is established. It is argued that KOH diffuses more readily to the metal scale interphase than KCl, because of the lower melting point of KOH (406 °C) compared to KCl (773 °C) and thus higher mobility at typical service temperatures (400–600 °C). Because of the low melting point of KOH, diffusion can

also take place in ionic form by K^+ and O^{2-} ions diffusing to the metal-scale interphase:

$$2KOH \leftrightarrow K_2O + H_2O(g)$$
 (in liquid KOH) (R17)

$$K_2O \rightarrow 2K^+ + O^{2-}$$
 (in liquid KOH) (R18)

$$Cr + 2K^{+} + O^{2-} + 1\frac{1}{2}O_{2}(g) \rightarrow K_{2}CrO_{4}$$
 (R19)

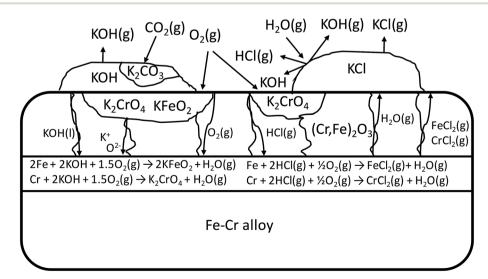


Fig. 12 Schematic of the proposed corrosion reactions under KOH and KCI containing salt deposit.

 $2Fe + 2K^+ \ + \ O^{2-} \ + \ 1\frac{1}{2}O_2(g) \! \to \! 2KFeO_2$

(R20)

(at metal-scale interface)

The schematic image in Fig. 12 summarizes the proposed corrosion reactions.

Conclusions

Paper

KOH is much more reactive towards Cr2O3 and Fe2O3 than KCl in ambient air environment. Thermodynamic calculations predict the difference in reactivity quite nicely above 400 °C. KOH reacts with both oxides at temperatures higher than 200 °C while KCl reacts with Cr_2O_3 at temperatures > 400 °C, but no reaction with Fe₂O₃ was detected in the temperature range from room temperature to 800 °C. Both KOH and KCl form K₂CrO₄ as the reaction product when reacting with Cr₂O₃. K₂CrO₄ can further react with Cr₂O₃ and form K₂Cr₂O₇ at temperatures > 400 °C. K₂CrO₄ and K₂Cr₂O₇ reaction products can be easily leached from the mixture with water at room temperature. KOH forms KFeO2 as the reaction product when reacting with Fe2O3. KFeO₂ cannot be leached with pure water, but requires an acidic media. In 1 M HCl solution, KFeO2 can be easily leached at room temperature. The reactivity of KCl towards the protective oxides of Fe-Cr steels in water containing high temperature environments can be explained by its decomposition to KOH and HCl(g) and the subsequent reaction of the formed KOH with the protective oxide. These results are very valuable for the development of materials for boilers, gasifiers, furnaces and gas turbines utilizing biomass derived fuels as their energy source.

Conflicts of interest

There are no conflicts of interest to declare.

Acknowledgements

The financial support from the Academy of Finland Strategic Research Council (SRC) and Finnish Environment Institute (SYKE) through the CloseLoop project is gratefully appreciated.

References

- 1 IEA statistics, CO2 Emissions from Fuel Combustion 2017 Highlights, 1 October 2017.
- 2 Y. Niu, H. Tan and S. Hui, Ash-related issues during biomass combustion: alkali-induced slagging, silicate melt-induced slagging (ash fusion), agglomeration, corrosion, ash utilization, and related countermeasures, Prog. Energy Combust. Sci., 2016, 52, 1-61.
- 3 H. P. Nielsen, F. J. Frandsen, K. Dam-Johansena and L. L. Baxter, The implications of chlorine-associated corrosion on the operation of biomass-fired boilers, Prog. Energy Combust. Sci., 2000, 26, 283-298.
- 4 R. A. Antunes and M. C. L. Oliveira, Corrosion in biomass combustion: a materials selection analysis and its

- interaction with corrosion mechanisms and mitigation strategies, Corros. Sci., 2013, 76, 6-26.
- 5 I. Obernberger, F. Biedermann, W. Widmann and R. Riedl, Concentrations of inorganic elements in biomass fuels and recovery in the different ash fractions, Biomass Bioenergy, 1997, 12, 211-224.
- 6 L. L. Baxtera, T. R. Miles, T. R. Miles Jr, B. M. Jenkins, T. Milne, D. Dayton, R. W. Bryerse and L. L. Oden, The behavior of inorganic material in biomass-fired power boilers: field and laboratory experiences, Fuel Process. Technol., 1998, 54, 47-78.
- 7 C. Chen, Z. Luo, C. Yu, T. Wang and H. Zhang, Transformation behavior of potassium during pyrolysis of biomass, RSC Adv., 2017, 7, 31319-31325.
- 8 D. C. Dayton, R. J. French and T. A. Milne, Direct Observation of Alkali Vapor Release during Biomass Combustion and Gasification. 1. Application of Molecular Beam/Mass Spectrometry to Switchgrass Combustion, Energy Fuels, 1995, 9, 855-865.
- 9 T. Sorvajärvi, N. DeMartini, J. Rossi and J. Toivonen, In Situ Measurement Technique for Simultaneous Detection of K, KCl, and KOH Vapors Released during Combustion of Solid Biomass Fuel in a Single Particle Reactor, Appl. Spectrosc., 2014, 68, 179-184.
- 10 P. E. Mason, L. I. Darvell, J. M. Jones and A. Williams, Observations on the release of gas-phase potassium during the combustion of single particles of biomass, Fuel, 2016, **182.** 110-117.
- 11 Y. Niu, Z. Wang, Y. Zhu, X. Zhang, H. Tan and S. Hui, Experimental evaluation of additives and K₂O-SiO₂-Al₂O₃ diagrams on high-temperature silicate melt-induced slagging during biomass combustion, Fuel, 2016, 179, 52-59.
- 12 B. Anicic, W. Lin, K. Dam-Johansen and H. Wu, Agglomeration mechanism in biomass fluidized bed combustion - reaction between potassium carbonate and silica sand, Fuel Process. Technol., 2018, 173, 182-190.
- 13 M. Hupa, Ash-Related Issues in Fluidized-Bed Combustion of Biomasses: Recent Research Highlights, Energy Fuels, 2012, 26, 4-14.
- 14 L. Hindiyarti, F. Frandsen, H. Livbjerg, P. Glarborg and P. Marshall, An exploratory study of alkali sulfate aerosol formation during biomass combustion, Fuel, 2008, 87, 1591-1600.
- 15 S. Jiménez and J. Ballester, Formation and Emission of Submicron Particles in Pulverized Olive Residue (Orujillo) Combustion, Aerosol Sci. Technol., 2004, 38, 707-723.
- 16 L. A. Hansen, H. P. Nielsen, F. J. Frandsen, K. Dam-Johansen, S. Hørlyck and A. Karlsson, Influence of deposit formation on corrosion at a straw-fired boiler, Fuel Process. Technol., 2000, 64, 189-209.
- 17 H. Wu, M. S. Bashir, P. A. Jensen, B. Sander and P. Glarborg, Impact of coal fly ash addition on ash transformation and deposition in a full-scale wood suspension-firing boiler, Fuel, 2013, 113, 632-643.
- 18 W. Weng, S. Chen, H. Wu, P. Glarborg and Z. Li, Optical Investigation of Gas-phase KCl/KOH Sulfation in Post Flame Conditions, Fuel, 2018, 224, 461-468.

19 B. Li, Z. Sun, Z. Li, M. Aldén, J. G. Jakobsen, S. Hansen and P. Glarborg, Post-flame gas-phase sulfation of potassium chloride, *Combust. Flame*, 2013, **160**, 959–969.

RSC Advances

- 20 K. Schofield, The chemical nature of combustion deposition and corrosion: the case of alkali chlorides, *Combust. Flame*, 2012, **159**, 1987–1996.
- 21 M. Broström, S. Enestam, R. Backman and K. Mäkelä, Condensation in the KCl-NaCl system, *Fuel Process. Technol.*, 2013, **105**, 142–148.
- 22 S. Karlsson, J. Pettersson, L.-G. Johansson and J.-E. Svensson, Alkali Induced High Temperature Corrosion of Stainless Steel: The Influence of NaCl, KCl and CaCl₂, Oxid. Met., 2012, 78, 83–102.
- 23 J. Pettersson, H. Asteman, J.-E. Svensson and L.-G. Johansson, KCl Induced Corrosion of a 304-type Austenitic Stainless Steel at 600°C; The Role of Potassium, *Oxid. Met.*, 2005, **64**, 23–41.
- 24 Y. S. Lia, M. Spiegel and S. Shimada, Effect of Al/Si addition on KCl induced corrosion of 9% Cr steel, *Mater. Lett.*, 2004, 58, 3787–3791.
- 25 H. T. Ma, C. H. Zhou and L. Wang, High temperature corrosion of pure Fe, Cr and Fe-Cr binary alloys in O₂ containing trace KCl vapour at 750 °C, *Corros. Sci.*, 2009, 51, 1861–1867.
- 26 S. Kiamehr, K. V. Dahl, M. Montgomery and M. A. J. Somers, KCl-induced high temperature corrosion of selected commercial alloys, *Mater. Corros.*, 2015, 66, 1414–1429.
- 27 T. Ishitsuka and K. Nose, Solubility study on protective oxide films in molten chlorides created by refuse incineration environment, *Mater. Corros.*, 2000, 51, 177–181.
- 28 K. Segerdahl, J. Pettersson, J. E. Svensson and L. G. Johansson, Is KCl(g) Corrosive at Temperatures Above its Dew Point? Influence of KCl(g) on Initial Stages of the High Temperature Corrosion of 11% Cr Steel at 600°C, *Mater. Sci. Forum*, 2004, **461–464**, 109–116.
- 29 J. Lehmusto, D. Lindberg, P. Yrjas, B.-J. Skrifvars and M. Hupa, Thermogravimetric studies of high temperature reactions between potassium salts and chromium, *Corros. Sci.*, 2012, 59, 55–62.
- 30 J. Pettersson, N. Folkeson, L.-G. Johansson and J.-E. Svensson, The Effects of KCl, K₂SO₄ and K₂CO₃ on the High Temperature Corrosion of a 304-Type Austenitic Stainless Steel, *Oxid. Met.*, 2011, 76, 93–109.
- 31 G. Y. Lai, *High-Temperature Corrosion and Materials Applications*, ASM International, Ohio, 2007.
- 32 G. P. Smith, *Corrosion of materials in fused hydroxides*, Oak Ridge National Laboratory Report, Tennessee, 1956.
- 33 Tz. Tzvetkoff and J. Kolchakov, Mechanism of growth, composition and structure of oxide films formed on ferrous alloys in molten salt electrolytes—a review, *Mater. Chem. Phys.*, 2004, 87, 201–211.

- 34 T. Blomberg, A thermodynamic study of the gaseous potassium chemistry in the convection sections of biomass fired boilers, *Mater. Corros.*, 2011, 57, 170–175.
- 35 T. Blomberg, Correlation of the corrosion rates of steels in a straw fired boiler with the thermodynamically predicted trend of KOH (g) in the flue gases, *Biomass Bioenergy*, 2012, **39**, 489–493.
- 36 S. Parirenyatwa, L. Escudero-Castejon, S. Sanchez-Segado, Y. Hara and A. Jha, Comparative study of alkali roasting and leaching of chromite ores and titaniferous minerals, *Hydrometallurgy*, 2016, **165**, 213–226.
- 37 N. Li, E. Vainio, L. Hupa, M. Hupa and E. C. Zabetta, High-Temperature Corrosion of Refractory Materials in Biomass and Waste Combustion: Method Development and Tests with Alumina Refractory Exposed to a K₂CO₃–KCl Mixture, *Energy Fuels*, 2017, 31, 10046–10054.
- 38 Z. Zhou, Y. Bo, Y. Zhang, Z. Huang, L. Chen, L. Ge, J. Zhou and K. Cen, Interactions of high-chromia refractory materials with infiltrating coal slag in the oxidizing atmosphere of a cyclone furnace, *Ceram. Int.*, 2014, 40, 3829–3839.
- 39 M. Szabó, J. Kalmár, T. Ditrói, G. Bellér, G. Lente, N. Simic and I. Fábián, Equilibria and kinetics of chromium(VI) speciation in aqueous solution a comprehensive study from pH 2 to 11, *Inorg. Chim. Acta*, 2018, 472, 295–301.
- 40 C. C. A. Loures, M. A. K. Alcântara, H. J. I. Filho, A. C. S. C. Teixeira, F. T. Silva, T. C. B. Paiva and G. R. L. Samanamud, Advanced Oxidative Degradation Processes: Fundamentals and Applications, *Int. Rev. Chem. Eng.*, 2013, 5, 102–120.
- 41 A. Roine, et al., Outokumpu HSC Chemistry for Windows, Chemical Reaction and Equilibrium Software 6.12, 2007.
- 42 F. T. Mackenzie and J. A. Mackenzie, *Our changing planet*, Prentice-Hall, Upper Saddle River, New Jersey, 1995.
- 43 T. Jonsson, J. Froitzheim, J. Pettersson, J.-E. Svensson, L.-G. Johansson and M. Halvarsson, The Influence of KCl on the Corrosion of an Austenitic Stainless Steel (304L) in Oxidizing Humid Conditions at 600 °C: A Microstructural Study, *Oxid. Met.*, 2009, 72, 213–239.
- 44 M. Spiegel, A. Zahs and H. J. Grabke, Fundamental aspects of chlorine induced corrosion in power plants, *Mater. High Temp.*, 2003, **20**, 153–159.
- 45 M. Montgomery, A. Karlsson and O. H. Larsen, Field test corrosion experiments in Denmark with biomass fuels. Part 1: Straw-firing, *Mater. Corros.*, 2002, **53**, 121–131.
- 46 H. J. Grabke, E. Reese and M. Spiegel, The effects of chlorides, hydrogen chloride, and sulfur dioxide in the oxidation of steels below deposits, *Corros. Sci.*, 1995, 37, 1023–1043.