



Cite this: *Environ. Sci.: Processes Impacts*, 2025, 27, 1495

Received 25th October 2024  
Accepted 20th December 2024

DOI: 10.1039/d4em00648h

rsc.li/espi

## Accounting for *in situ* air cleaner utilization and performance to improve interpretation of patient outcomes in real-world indoor air cleaner intervention trials†

Saeed Farhoodi,<sup>a</sup> Insung Kang,<sup>b</sup> Yicheng Zeng,<sup>a</sup> Kaveeta Jagota,<sup>c</sup> Nancy Karpen,<sup>c</sup> Mohammad Heidarinejad,<sup>b</sup> Zane Elfessi,<sup>cde</sup> Israel Rubinstein<sup>cfg</sup> and Brent Stephens<sup>ib\* a</sup>

There is an increasing number of randomized clinical trials intended to assess the effectiveness of indoor air cleaners for improving participant outcomes in real-world settings. In this communication, we synthesize the current state of registered air cleaner intervention trials and call attention to the critical importance of conducting measurements to characterize the performance and *in situ* utilization of air cleaners in such trials to improve interpretation of exposure measurements and patient outcomes. We draw upon the existing literature and preliminary findings from our ongoing one-year, randomized, single-blind, placebo-controlled case-control trial of stand-alone air filtration in the homes of U.S. military Veterans to inform our recommendations. We demonstrate how to conduct industry-standard performance testing and how to use long-term measurements of air cleaner power draw to assess air cleaner operation. In our analysis of interim data from 53 homes to date with a mean data collection period of 275 days, we found that most air cleaners, whether active or sham, were operated predominantly at low or medium fan speeds, and most participants operated their air cleaner on predominantly one fan speed. In a few homes, air cleaners were mostly off. We estimate that air cleaner operation in these homes is providing a median additional equivalent particle loss rate of ~0.7/h (ranging ~0–2.8/h). Accordingly, we recommend that air cleaner intervention trials adopt the steps described herein to account for the amount of clean air delivered in real-world settings and to provide

### Environmental significance

Interventions to improve indoor air quality, especially the use of portable indoor air cleaners, have gained significant interest in recent years. The number of randomized clinical trials assessing the effectiveness of these devices in improving patient outcomes in real-world settings is increasing steadily. However, intervention studies vary in an important yet often overlooked factor: characterization and reporting of *in situ* operation and performance of air cleaners. Here we demonstrate how ongoing air cleaner clinical trials can incorporate clean air delivery metrics to assist in data analysis and interpretation in a way that is akin to how phase I/II clinical trials control for dosage of medical interventions. We argue that if these studies fail to account for *in situ* air cleaner utilization or performance, then conclusions drawn regarding health outcomes may lack sufficient context for full interpretation.

important context alongside indoor exposure measurements and analysis of patient outcomes.

### Introduction

A growing number of randomized clinical trials have shown that indoor air cleaning, especially stand-alone or in-room air filtration with high-efficiency particulate air (HEPA) filters, can reduce indoor pollutant concentrations (especially particulate matter, or PM) and provide some improvements in health outcomes or markers of outcomes for a variety of populations.<sup>1–4</sup> Since 2020, at least five systematic reviews of clinical intervention trials intended to evaluate the health effects (or markers of effects) of indoor air cleaning or filtration have been published, with foci on cardiovascular health,<sup>5</sup> biomarkers of cardiorespiratory<sup>6</sup> or cardiovascular health,<sup>7</sup> and blood pressure.<sup>8,9</sup> Moreover, there are at least 27 currently active trials registered on <https://ClinicalTrials.gov> focused on indoor air cleaning interventions, meaning they are either ongoing, recruiting, or in preparation for recruitment. While more details are provided in an overview in the ESI,† most of the published randomized indoor air cleaning intervention trials to date have ranged from approximately 20 to 200 participants, which

<sup>a</sup>Department of Civil, Architectural, and Environmental Engineering, Illinois Institute of Technology, Alumni Memorial Hall Room 228, 3201 South Dearborn Street, Chicago, IL 60616, USA. E-mail: [brent@iit.edu](mailto:brent@iit.edu); Tel: +1-312-567-3629

<sup>b</sup>Department of Civil Engineering, University of Texas at Arlington, Arlington, TX 76019, USA

<sup>c</sup>Research and Development Service, Jesse Brown Veterans Affairs Medical Center, Chicago, IL 60612, USA

<sup>d</sup>Retzky College of Pharmacy, University of Illinois-Chicago, Chicago, IL 60612, USA

<sup>e</sup>Emergency Medicine Service, Jesse Brown Veterans Affairs Medical Center, Chicago, IL 60612, USA

<sup>f</sup>College of Medicine, University of Illinois Chicago, Chicago, IL 60612, USA

<sup>g</sup>Medical Service, Jesse Brown Veterans Affairs Medical Center, Chicago, IL 60612, USA

† Electronic supplementary information (ESI) available. See DOI: <https://doi.org/10.1039/d4em00648h>

would place them generally in the range of sample sizes that are typical for phase I/II clinical trials,<sup>10</sup> with durations of interventions ranging from as short as half a day to as long as one year (medians of ~7–14 days). They also typically, but not always, include at least one type of indoor exposure measurement, which is necessarily limited in scope and/or duration by practical factors such as time, technology, funding, or other resources to support indoor environmental sampling and analysis. Indoor exposures are also influenced by a range of factors in addition to air cleaner status (*e.g.*, sham/placebo *versus* active/true), including pollutant source strength, building characteristics (*e.g.*, air infiltration and airflow through window and door openings), and other competing pollutant removal mechanisms (*e.g.*, central air filtration or deposition to surfaces).

Within this context, there remains one important limitation to many of the past, ongoing, and planned intervention trials: their level of detail in characterizing *in situ* air cleaner utilization and performance has varied widely. Such performance metrics and measurements are crucial for contextualizing and interpreting outcomes in air cleaning intervention trials. Otherwise, differences in *in situ* air cleaner performance and/or adherence (*i.e.*, usage), if unaccounted for, can lead to misinterpretations or even erroneous conclusions from an intervention study.

To illustrate, in a recent review of interventions for respiratory outcomes (including indoor air cleaning) published in the prior 3 years, Robertson *et al.* (2024)<sup>11</sup> observed that while all 9 air cleaner intervention studies that were implemented within the general population reported measurements of the average efficacy of air cleaner interventions on at least one target pollutant (*i.e.*, the resulting impact on indoor pollutant concentrations), “few provided details on the clean air delivery rate of the air cleaners,” “few studies reported intervention adherence,” and “uniform definitions for adherence were not used.”

Even among the three reviewed studies that included “objective measurements of air cleaner adherence at high temporal resolution,” their approaches were inconsistent and did not yield a complete picture of *in situ* operation or performance. One of those studies<sup>12</sup> utilized custom air cleaners that were “equipped with a counter that recorded the number of hours the machine was plugged into a power source”, which is not the same as logging usage or amount of clean air output. This study did include initial and final measurements of air cleaner airflow rates but did not characterize the clean air delivery rate (CADR) for the targeted pollutants. Another of those studies<sup>13</sup> did not report the CADR or airflow rate of the air cleaner (and it appears the manufacturer also does not report the CADR for the device), but did use motor on/off data loggers to record air cleaner on/off status, which provides some insight into air cleaner usage. However, on/off measurements do not allow for distinguishing *in situ* fan speed operation, which also affects the amount of clean air that is supplied. Further, without knowing the CADR, one cannot ascertain the amount of clean air delivery that is possible.‡ Ultimately, findings regarding primary patient outcomes were inconclusive in both studies, which may have been due in part to real effects but may also have been due in part to differences in air cleaner performance

or utilization that were not fully characterized. Relying solely on indoor concentration measurements to characterize exposures without concurrent measurements of *in situ* air cleaner utilization or performance limits the extent to which any observed differences in indoor concentrations, for example between sham and control groups, can be plausibly attributed to air cleaner operation.

Conversely, Hansel *et al.*<sup>14</sup> reported on an air cleaner intervention trial with nearly 100 individuals with COPD who received either active HEPA (and carbon) or sham air cleaners with filters removed and completed a 6 month follow-up. While the CADR was not reported (and the manufacturer also does not report it), current transducers were used to record how often the air cleaners were utilized in participant homes. Analyzing the primary outcome data (St. George's Respiratory Questionnaire, or SGRQ, scores) across all subjects, there were no significant differences in SGRQ scores between true and sham filter groups. However, analyzing data from those individuals that utilized the air cleaner more than 80% of the time, there was a statistically significant difference in SGRQ scores between the true filter group compared to the sham filter.

It is perhaps an all-too-obvious point to make to those familiar with indoor environments and building systems, but it is a point that has been often overlooked in many prior studies: it is critical to assess the *in situ* utilization and performance of air cleaning interventions in indoor air cleaning intervention trials. If studies fail to account for *in situ* air cleaner utilization and performance, then conclusions drawn regarding health outcomes may lack sufficient context for full interpretation. In this communication, we provide recommendations for indoor air cleaning trials to incorporate approaches to conducting *in situ* measurements of air cleaner performance and analyzing performance data to help improve interpretation of trial outcomes. We draw upon the existing literature and preliminary findings from our ongoing, real-world, one-year, randomized, single-blind, placebo-controlled clinical trial of stand-alone indoor HEPA filtration in the homes of U.S. military Veterans with moderate-to-severe COPD in and around Chicago, Illinois USA to inform our recommendations. The study was approved by the Institutional Review Board (IRB) at both the Illinois Institute of Technology (#2022-92) and Jesse Brown VA Medical Center (#1675992). The trial is registered at <https://ClinicalTrials.gov> (NCT05913765).<sup>15</sup> Details of study protocol are provided elsewhere.<sup>16</sup> The trial is still ongoing.

## Methods

### Measuring air cleaner performance

Fan-powered air cleaning devices are most commonly rated for their CADR<sup>17</sup> for particles, but seldom for gases like volatile organic compounds (VOCs) or nitrogen dioxide (NO<sub>2</sub>). The CADR is most commonly reported only on the highest fan speed setting, which also tends to be the loudest setting.<sup>18</sup> In our experience, a minority of air cleaner manufacturers report CADR on lower fan speed settings. Therefore, to understand air cleaner performance in intervention trials, we recommend first conducting independent laboratory evaluations of CADR at

a range of possible fan speed settings for pollutant(s) of interest. For readers who are less familiar, in the ESI† we provide a demonstration of how to conduct independent laboratory evaluations of the CADR of a portable air cleaner for multiple pollutants, as well as other performance characteristics such as noise levels, following a combination of industry-standard and custom air cleaner performance testing approaches.

Second, we recommend that intervention trials measure *in situ* air cleaner utilization, not only *via* binary on/off measurements, but also with high-resolution time-resolved power draw (or current draw) measurements to characterize fan speed settings in addition to on, off, or unplugged status.<sup>19–23</sup> Doing so can allow for greater interpretation of any collected patient outcome data within the context of the amount of clean air delivered and thus the magnitude of reductions in pollutant exposure that would be expected to be achieved. When paired alongside indoor concentration measurements, such data can offer greater insight into the true impacts of the air cleaner.

### Measuring air cleaner utilization in an ongoing air cleaner trial

In our ongoing indoor air cleaner intervention trial, half the participants are randomized to receive a placebo/sham filtration unit (*i.e.*, an air cleaner with the filter removed and replaced with custom weights to mimic the weight of a normal unit) and half are randomized to receive a normally functioning HEPA filtration unit (*i.e.*, active or true filtration). During the initial air cleaner deployment visit to participant homes, the air cleaner is installed by the research team in a convenient location, ideally near where participants report spending most of their time (usually a living room or bedroom) but also informed by availability of space and access to an electrical power outlet. Outlet extensions or power strips are given to participants to avoid occupying available outlets, which are often limited. During this deployment visit, the research team also makes spot measurements of noise levels from the air cleaners on low, medium, and high fan speed settings as installed in the field using the NIOSH Sound Level Meter app<sup>24</sup> on a smartphone. The participants are informed that the units clean the most air at the highest fan speed settings. However, we observed during the on-site visits that most participants initially preferred low or medium fan speed settings due to the relatively high noise level for the high fan speed setting.

Each air cleaner (whether true/active or sham/placebo) is then plugged into an Onset UX120 HOBOWare Plug Load Data Logger<sup>25</sup> to monitor their operational runtime at high time resolution (*i.e.*, 5 minute intervals, launched using the “at interval” function in HOBOWare to yield consistent time stamps at xx:00 seconds) throughout the 1 year study duration. The logger measures voltage, amperage, and power draw, which allows for the team to ascertain not only when an air cleaner unit is in operation (*i.e.*, power > 0 W) but whether it is operating on low, medium, or high fan speed settings. The separate current and voltage measurement also allows for understanding if, and when, the air cleaner is unplugged (*i.e.*, 0 V and 0 A).

Spot measurements of power draw are also manually recorded on low, medium, and high fan speed settings at the initial deployment visit as well as any interim and final visits to record how power draw may have changed at each setting over time as the filter becomes loaded with collected particles/dust. Other approaches to monitor *in situ* air cleaner operation could utilize data logging anemometers,<sup>26,27</sup> motor on/off loggers,<sup>13</sup> or smart plug devices,<sup>28</sup> each of which can be used both for portable or in-room air cleaners as well as in-duct devices in central forced air heating or cooling systems. Each runtime measurement approach also has strengths and weaknesses. A strength of the plug load data logger approach is that it is highly accurate and allows for detecting unplugged conditions as well as fan speed settings, but weaknesses are cost (currently ~\$300 USD each), lack of remote monitoring capability, and lack of utility for monitoring the runtime of central air handler fans for in-duct air cleaner applications (which is not applicable in our study). Most data logging anemometers similarly provide high fan speed setting resolution, similar cost, and no remote monitoring, with an added challenge of needing a somewhat precarious installation to mount at the air supply outlet (but they can be used for both portable and in-duct systems). Motor on/off loggers are less expensive but do not provide fan speed setting resolution and are thus less useful. Smart plug based loggers are promising but typically require either on-site Bluetooth connections to phones or custom data solutions for longer-term data logging (*e.g.*, Raspberry Pi gateway), which are also subject to information technology (IT) security breaches.<sup>29</sup> Researchers should keep a watchful eye on emerging technical solutions in this arena, as there are likely emerging smart plug-based solutions that could reduce total cost of data collection while providing remote data access.<sup>30</sup>

At some point during our yearlong study, an interim visit is conducted to each home to download data, check equipment, and conduct a housing condition assessment walkthrough, which provides a number of basic housing characteristics including floor area and home volume (among other parameters). A final visit is conducted at least 12 months after initial deployment to retrieve data loggers. Here we use interim data from plug load loggers and housing condition assessments collected in 53 homes participating in our ongoing air cleaner intervention trial to demonstrate approaches to analysis of air cleaner utilization that can be used in other active trials. These interim data are not final, as the duration of interim data ranges from as little as 11 days to as long as 500 days, with a mean (SD) of 275 (157) days depending on when participants were recruited and when interim (or in some cases to date, final) visits were conducted. As such, these data should be considered preliminary and specific to this population; operation in other settings and in other populations may vary. Yet, such data are useful for illustrative purposes.

### Merging air cleaner performance and utilization data

Once *in situ* patterns of fan speed settings are characterized, a few analysis options are apparent. First, since the CADR for a given constituent can be known from prior laboratory testing

(either *via* independent testing by the research team or provided by the manufacturer), any time-resolved in-home pollutant concentration or exposure data can be time-stamp-matched with the concurrent air cleaner runtime status to provide more granular analysis of the air cleaner's impact. Second, a time-averaged CADR can be calculated for any measurement duration of interest to classify the magnitude of impact that the installed air cleaner is likely delivering. For example, eqn (1) is used to calculate a time-averaged CADR for the entire duration for which data were collected in our ongoing study using preliminary runtime results.

$$\text{CADR}_{\text{avg}} = f_{\text{low}}\text{CADR}_{\text{low}} + f_{\text{med}}\text{CADR}_{\text{med}} + f_{\text{high}}\text{CADR}_{\text{high}} \quad (1)$$

where  $f_{\text{low}}$ ,  $f_{\text{med}}$ , and  $f_{\text{high}}$  are the fraction of measurement period that an air cleaner is measured to operate on low, medium, and high fan speed settings, respectively, and  $\text{CADR}_{\text{low}}$ ,  $\text{CADR}_{\text{med}}$ , and  $\text{CADR}_{\text{high}}$  are the CADR for a given constituent on low, medium, and high fan speed settings, respectively. This equation also accounts for times when the air cleaner was measured as off (*i.e.*, with 0 CADR) and provides a single metric for the amount of particle-free air delivered in the home over time. For air cleaners that adjust fan speed more granularly (*e.g.*, algorithmically based on integrated measurements of indoor pollutant concentrations), eqn (1) could be resolved more granularly or even continuously using reported or measured efficacy (*e.g.*, CADR/W). This value can also vary over time if participants change their utilization rate over the study duration or, for some air cleaners, if the CADR on each fan speed setting changes over time (*i.e.*, the removal efficiency and/or flow rate may change with loading, depending on the nature of loading and the contaminant(s) of interest). For the air cleaners used in our ongoing study, the CADR for all particle sizes is not expected to change significantly over the 1 year duration because the air cleaners have a large amount of HEPA filter media, although gas-phase removal efficiency may vary more widely over time. However, such characterization is beyond the scope of this work.

## Results and discussion

### Air cleaner performance testing

As summarized in the ESI (Fig. S2 and Table S1†), the CADR for smoke-sized particles (*i.e.*, 0.09–1  $\mu\text{m}$ ) of the air cleaner used in our ongoing real-world intervention study was measured in laboratory testing to be  $\sim 85 \text{ m}^3 \text{ h}^{-1}$  ( $\sim 50 \text{ ft}^3 \text{ min}^{-1}$ ) on low,  $\sim 136 \text{ m}^3 \text{ h}^{-1}$  ( $\sim 80 \text{ ft}^3 \text{ min}^{-1}$ ) on medium, and  $\sim 272 \text{ m}^3 \text{ h}^{-1}$  ( $\sim 160 \text{ ft}^3 \text{ min}^{-1}$ ) on high fan speed settings with the true filters installed and less than  $17 \text{ m}^3 \text{ h}^{-1}$  ( $10 \text{ ft}^3 \text{ min}^{-1}$ ) for all fan speeds with the sham installed. For comparison, a recent review of field studies of portable air cleaners reported that most studies used air cleaners with a particulate-based CADR between 100 and  $300 \text{ m}^3 \text{ h}^{-1}$  (*i.e.*,  $\sim 60$  to  $\sim 175 \text{ ft}^3 \text{ min}^{-1}$ ), presumably measured on the highest fan speed settings.<sup>31</sup> The CADR for  $\text{NO}_2$  and  $\text{O}_3$  for the air cleaner used in our study were both estimated to be similar to the particulate-based CADRs. Noise production on the highest fan speed setting was

significantly higher than both medium and low fan speed settings (*e.g.*, 61–62 dBA *versus* 46–48 dBA and 39–40 dBA, respectively).

### *In situ* utilization of air cleaners: interim data

Fig. S3† shows an example of a few months of *in situ* air cleaner power draw measurements from a single home in our ongoing study to demonstrate how the power draw data can be tagged and sorted into bins of “off”, “low”, “medium”, and “high” fan speed operation. Fig. 1 summarizes the percentage of time from the interim collected data to date that the air cleaners in these homes have operated on low, medium, or high fan speed settings, or were off/unplugged, sorted by descending order of percentage of time the air cleaner was measured to be “off”. Most air cleaners, whether active or sham, were operated on predominantly low or medium fan speed settings, and most participants to date have operated their air cleaner on predominantly just one fan speed setting rather than adjusting frequently. In a few homes, the air cleaners were mostly off. Further, Fig. S4† summarizes the hourly mean (and standard deviation) of the air cleaner power draw measurements from the sample of 53 homes for which we have interim data to date. There were no apparent diurnal variations in mean power draw, suggesting that participants to date have rarely adjusted the fan speed settings throughout the day. Rather, they have generally left the fan speed setting for long periods of time, adjusting infrequently.

Fig. 2a shows the distribution of time-averaged CADR for smoke-sized particles delivered in each home from these interim data collected to date, estimated by combining *in situ* runtime data (from Fig. 1) with lab-based measurements of CADR for smoke-sized particles (from Table S1†) following eqn (1). Time-averaged CADRs for sham/placebo air cleaners are actually near 0 but are represented as what they would be if they had true filters installed to provide a direct comparison to the true filtration group. Because participants are blinded to air filter status, this provides a utilization-based measure of the intended effect of the air cleaner that also includes placebo.

Fig. 2b shows the same time-averaged CADR values for smoke-sized particles also normalized by the measured home volume and converted to units of 1/h to be comparable to equivalent air change rates or other loss rates such as deposition to surfaces. Compared to relying solely on an exposure outcome (*i.e.*, measured indoor pollutant concentrations), which can be influenced not only by the air cleaner intervention but also local ambient conditions, building characteristics such as envelope leakage and window opening, and the presence, nature, and magnitude of indoor pollutant sources, this calculation provides a single metric for understanding how often each participant operates their air cleaner and how large of an impact that operation would be expected to have based on the relative scale of the air cleaner (and its operational settings) to the size of the home.

These interim data show that air cleaner operation in these homes to date (again assuming all true filtration units rather than half sham, half true) is providing anywhere between  $\sim 0 \text{ m}^3$

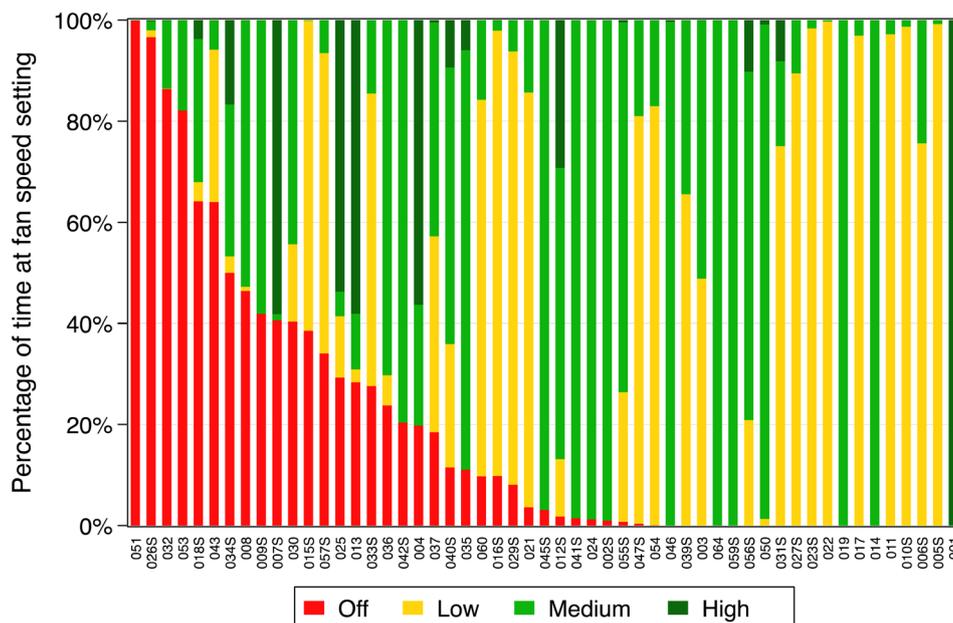


Fig. 1 Summary of air cleaner operation data from 53 interim visits to date, with data ranging from approximately 2 to 10 months of operation, sorted by true and sham air cleaner groups. Homes are sorted by descending order of percentage of time the air cleaner was measured to be off. Home IDs increase incrementally with date of recruitment and randomization. Home IDs with "S" denotes a sham filter.

$\text{h}^{-1}$  ( $\sim 0 \text{ ft}^3 \text{ min}^{-1}$ ) of particle-free air and  $\sim 0$  per hour in equivalent particle loss rate (*i.e.*, air cleaner is always off) to  $\sim 270 \text{ m}^3 \text{ h}^{-1}$  ( $\sim 159 \text{ ft}^3 \text{ min}^{-1}$ ) of particle-free air (*i.e.*, air cleaner is operating on high all the time) and  $\sim 2.8$  per hour in equivalent particle loss rate (*i.e.*, air cleaner is operating on high all the time and in a relatively small home volume). The mean  $\pm$  SD *in situ* time-averaged CADRs to date are estimated to be  $102 \pm 48 \text{ m}^3 \text{ h}^{-1}$  ( $60 \pm 28 \text{ ft}^3 \text{ min}^{-1}$ ) across all homes,  $107 \pm 58 \text{ m}^3 \text{ h}^{-1}$  ( $63 \pm 34 \text{ ft}^3 \text{ min}^{-1}$ ) for the true air cleaners, and  $99 \pm 36 \text{ m}^3 \text{ h}^{-1}$  ( $58 \pm 21 \text{ ft}^3 \text{ min}^{-1}$ ) for the sham air cleaners, with no significant difference between true/sham air cleaner groups to date ( $p = 0.45$  from Wilcoxon–Mann–Whitney test). The mean  $\pm$  SD *in situ* time-averaged CADR/V values (CADR divided by house volume) to date are estimated to be  $0.77 \pm 0.52$  per hour across all homes,  $0.85 \pm 0.61$  per hour in the true air cleaner homes, and  $0.70 \pm 0.42$  per hour in the sham air cleaner homes, also with no significant difference between true and sham air cleaner groups to date ( $p = 0.40$  from Wilcoxon–Mann–Whitney test).

Approximately 25% of homes are receiving less than 0.5 per hour in additional equivalent air change rate for PM, meaning that the time-averaged rate of particle removal added by the air cleaner is less than the average air change rate or natural particle deposition rate in typical U.S. homes.<sup>32,33</sup> In other words: the air cleaner is not doing much to improve particle removal in these homes because it is not operated often enough and/or it is inadequately sized for the space. Another  $\sim 40\%$  of homes are receiving  $\sim 0.5$ –1 per hour in additional time-averaged equivalent air change rate, while only  $\sim 10\%$  are receiving more than 1.5 per hour (again, ignoring sham/true status). We are not able to make direct comparisons to air change rates due to infiltration or ventilation in our study

homes because they were not measured. None of our study homes to date have dedicated mechanical ventilation systems other than intermittent kitchen and/or bathroom exhaust fans, although we did observe window opening in several homes at our initial and/or interim visits. Future work should leverage advances in low-cost indoor air quality sensors for both particulate matter (PM) and carbon dioxide ( $\text{CO}_2$ ) to assess air change rates and particle loss rates from time-resolved concentration data.<sup>34,35</sup>

These data serve to demonstrate how air cleaner utilization and performance data are crucial for contextualizing and interpreting outcomes in real-world air cleaning intervention trials. This analysis accounts only for the CADR of a specific particle size range and assumes that CADR does not change with loading over time, which is likely true for periods of up to a few years for some HEPA filtration devices but not necessarily all;<sup>36</sup> the CADR for other constituents may vary at different rates. Long-term measurements of such parameters are important – and achievable with current technology – to characterize operational patterns over time and to analyze factors that influence air cleaner operation.<sup>19,21,37</sup>

To return to the phase I/II clinical trials analogy, such measurements would allow for controlling for the amount of clean air delivered over time in the analysis and interpretation of exposure measurements and resulting patient outcomes in air cleaner intervention trials. This approach is akin to controlling for the dosage in a clinical trial of a medical intervention rather than assuming each participant receives the same dosage. This simple metric of clean air delivered can also be a useful surrogate for exposure (or exposure reduction) in trials that include patient outcomes but do not include indoor environmental exposure measurements (*e.g.*, ref. 38). Another

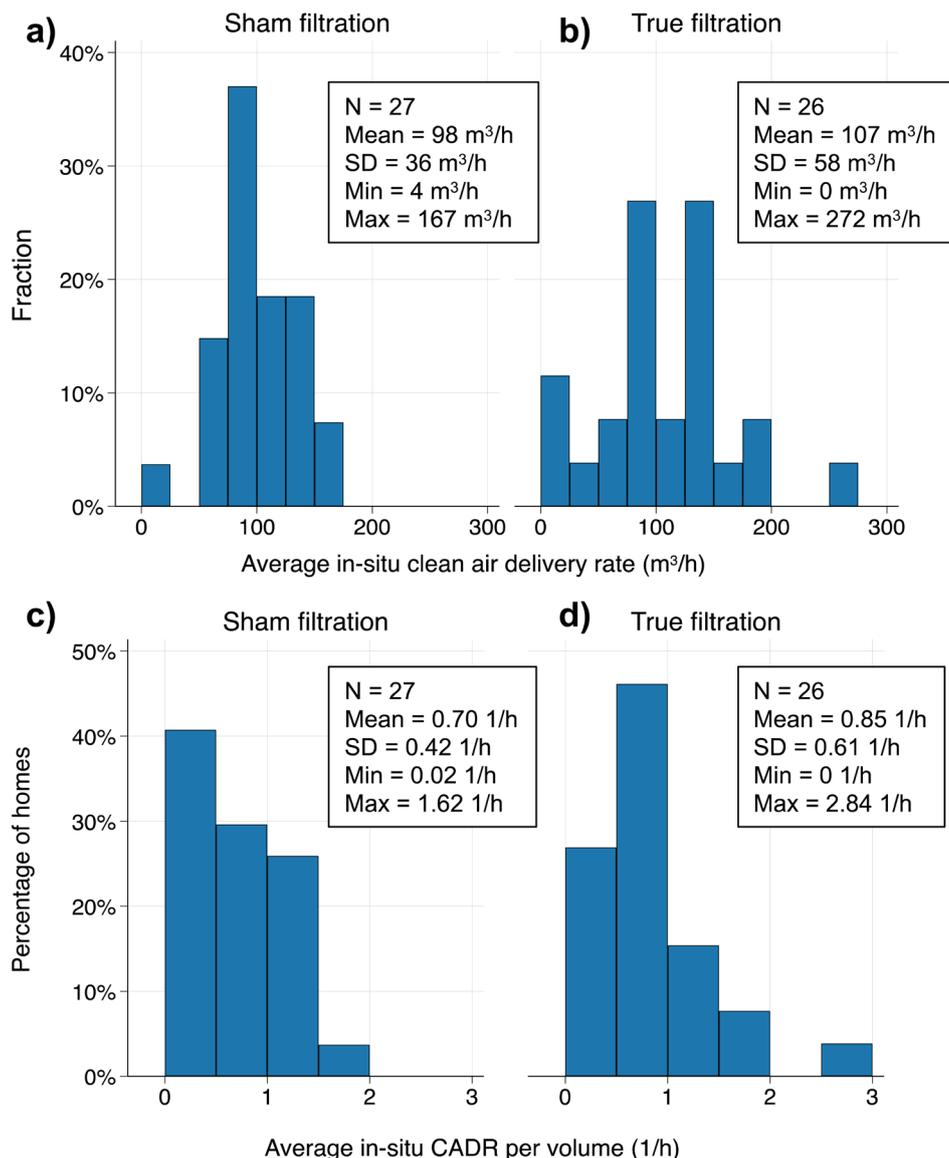


Fig. 2 Interim analysis of (a and b) time-averaged *in situ* CADR ( $\text{m}^3 \text{h}^{-1}$ ) and (c and d) CADR divided by house volume (CADR/V, 1/h) for smoke-sized particles delivered in the 53 homes with interim visits to date, split by sham and true filtration groups. Estimates of CADR and CADR/V for sham filtration group assume what the CADR would be if true filtration was used for direct comparison to true filtration group.

challenge, however, is that the dosage of clean air in this case becomes a continuous variable that can vary both between participants over the study duration and within participants over time and will need to be accounted for accordingly.

## Conclusions

An increasing number of indoor air cleaner intervention trials are currently registered and in planning stages or already underway. A limited number of prior studies have demonstrated the importance of conducting *in situ* air cleaner performance and utilization measurements for aiding in the interpretation of any patient outcomes, although many prior air cleaner intervention trials have not done so. As such, we aim to help inform clinical trial investigators, funding program

managers, and the broader research community that exists at the intersection of indoor air science, exposure science, public health, and medical intervention trials by providing recommendations for air cleaner intervention trials to incorporate approaches to conducting measurements of air cleaner performance and utilization and analyzing such data to help improve interpretation of trial outcomes. We argue that for such trials to be successful and maximally informative regarding the efficacy of air cleaners for improving patient outcomes in real-world settings, they should leverage the approaches described herein to account for the amount of clean air delivered over time in each participant's setting. Doing so will provide important context to concurrent indoor exposure measurements and analysis of patient outcomes.

## List of abbreviations

AHAM:	Association of Home Appliance Manufacturers
ANSI:	American National Standards Institute
CADR:	Clean air delivery rate
CADR/V:	Clean air delivery rate divided by space volume
CFM:	Cubic feet per minute
COPD:	Chronic obstructive pulmonary disease
CO <sub>2</sub> :	Carbon dioxide
dBa:	A-weighted decibel
ESI:	Electronic supplementary information
HEPA:	High-efficiency particulate air
HUD:	Housing and Urban Development
IRB:	Institutional Review Board
IT:	Information technology
JBVAMC:	Jesse Brown Veterans Affairs Medical Center
NIOSH:	National Institute for Occupational Safety and Health
NO <sub>2</sub> :	Nitrogen dioxide
O <sub>3</sub> :	Ozone
PM:	Particulate matter
SGRQ:	St. George's Respiratory Questionnaire
UVGI:	Ultraviolet germicidal irradiation
VOC:	Volatile organic compounds

## Data availability

Data for this article, including air cleaner laboratory test data and *in situ* air cleaner operational data are available at <https://osf.io/kwjta/>. <https://doi.org/10.17605/OSF.IO/KWJTA>. The currently registered trials data from <https://ClinicalTrials.gov> supporting this article have been included as part of the ESI.†

## Author contributions

Conceptualization: BS, MH, SF, IR. Data curation: SF, YZ, IK, NK, KJ, ZE, BS, MH, formal analysis: SF, YZ, IK, ZE, BS, MH. Funding acquisition: BS, IR, MH. Investigation: IK, SF, YZ, KJ, ZE, BS, MH. Methodology: IK, SF, YZ, NK, KJ, ZE, IR, BS, MH. Project administration: KJ, BS, IR, MH. Resources: KJ, BS, IR, MH. Software: IK, SF, ZE, BS, MH. Supervision: BS, IR, MH. Validation: IK, SF, YZ, BS, MH. Visualization: IK, SF, YZ, BS. Writing – original draft preparation: BS. Writing – review and editing: SF, IK, NK, KJ, ZE, IR, BS, MH.

## Conflicts of interest

The authors declare no competing interests.

## Acknowledgements

The work that provided the basis for this publication was supported by funding under an award with the U.S. Department of Housing and Urban Development (HUD #ILHHU0049-19 and #ILHHU0077-24). The substance and findings of the work are dedicated to the public. The authors and publisher are solely

responsible for the accuracy of the statements and interpretations contained in this publication. Such interpretations do not necessarily reflect official views of the U.S. government. We are grateful for the donation of air cleaners from Austin Air and discounts from Onset for plug load data loggers to enable this study. We are grateful for staff members and students at Illinois Institute of Technology, including Aditya Singh, Mingyu Wang, Saman Haratian, Saba Fatemi Abhari, Stan Johnson, and Andrew Edwards for their assistance in evaluating and preparing equipment and supplies for field work and contributing to the data analysis plan; Amanda Gramigna, Marina Beke, and Anna McCreery at Elevate, Chicago, Illinois, for their contributions to the study methodology and housing condition assessments; Julie Fabre and Karen Lenehan from Research Service at Jesse Brown Veterans Affairs Medical Center for their assistance with without compensation appointments and IRB submission; Lauren Rich, Sean Resetar, and Cindy Reutzel at the Chicago Association for Research and Education in Science, Hines Illinois, for facilitating with the recruitment reimbursements.

## Notes and references

† A longer introduction to CADR and industry-standard approaches to air cleaner testing is provided in the ESI† as a reference.

- 1 National Academies of Sciences, Engineering, and Medicine, *Health Risks of Indoor Exposure to Fine Particulate Matter and Practical Mitigation Solutions*, National Academies Press, Washington, D.C., 2024 [cited 2024 Feb 9], available from: <https://www.nap.edu/catalog/27341>.
- 2 W. J. Fisk, Health benefits of particle filtration, *Indoor Air*, 2013, 23(5), 357–368.
- 3 US EPA, *Residential Air Cleaners: A Technical Summary*, U.S. Environmental Protection Agency, 3rd edn, 2018 [cited 2018 Aug 17], available from: <https://www.epa.gov/indoor-air-quality-iaq/air-cleaners-and-air-filters-home>.
- 4 J. L. Sublett, J. Seltzer, R. Burkhead, P. B. Williams, H. J. Wedner and W. Phipatanakul, Air filters and air cleaners: Rostrum by the American Academy of Allergy, Asthma & Immunology Indoor Allergen Committee, *J. Allergy Clin. Immunol.*, 2010, 125(1), 32–38.
- 5 X. Xia, K. H. Chan, K. B. H. Lam, H. Qiu, Z. Li, S. H. L. Yim, *et al.*, Effectiveness of indoor air purification intervention in improving cardiovascular health: A systematic review and meta-analysis of randomized controlled trials, *Sci. Total Environ.*, 2021, 789, 147882.
- 6 S. Liu, R. Wu, Y. Zhu, T. Wang, J. Fang, Y. Xie, *et al.*, The effect of using personal-level indoor air cleaners and respirators on biomarkers of cardiorespiratory health: a systematic review, *Environ. Int.*, 2022, 158, 106981.
- 7 S. Wittkopp, D. Walzer, L. Thorpe, T. Roberts, Y. Xia, T. Gordon, *et al.*, Portable air cleaner use and biomarkers of inflammation: A systematic review and meta-analysis, *Am. Heart J. Plus*, 2022, 18, 100182.
- 8 D. Walzer, T. Gordon, L. Thorpe, G. Thurston, Y. Xia, H. Zhong, *et al.*, Effects of Home Particulate Air Filtration

- on Blood Pressure: A Systematic Review, *Hypertension*, 2020, **76**(1), 44–50.
- 9 S. Faridi, R. W. Allen, R. D. Brook, F. Yousefian, M. S. Hassanvand and C. Carlsten, An updated systematic review and meta-analysis on portable air cleaners and blood pressure: Recommendations for users and manufacturers, *Ecotoxicol. Environ. Saf.*, 2023, **263**, 115227.
  - 10 NIH, *NIH Clinical Research Trials and You*, National Institutes of Health, 2022, available from: <https://www.nih.gov/health-information/nih-clinical-research-trials-you/basics>.
  - 11 N. M. Robertson, A. Qiu, S. Raju, M. C. McCormack and K. Koehler, Cleaning indoor air—what works for respiratory health: An updated literature review and recommendations, *J. Allergy Clin. Immunol.*, 2024, **154**(4), 847–860.
  - 12 J. F. Gent, T. R. Holford, M. B. Bracken, J. M. Plano, L. A. McKay, K. M. Sorrentino, *et al.*, Childhood asthma and household exposures to nitrogen dioxide and fine particles: a triple-crossover randomized intervention trial, *J. Asthma*, 2023, **60**(4), 744–753.
  - 13 R. L. Drieling, P. D. Sampson, J. E. Krenz, M. I. Tchong French, K. L. Jansen, A. E. Massey, *et al.*, Randomized trial of a portable HEPA air cleaner intervention to reduce asthma morbidity among Latino children in an agricultural community, *Environ. Health*, 2022, **21**(1), 1.
  - 14 N. N. Hansel, N. Putcha, H. Woo, R. Peng, G. B. Diette, A. Fawzy, *et al.*, Randomized Clinical Trial of Air Cleaners to Improve Indoor Air Quality and Chronic Obstructive Pulmonary Disease Health: Results of the CLEAN AIR Study, *Am. J. Respir. Crit. Care Med.*, 2022, **205**(4), 421–430.
  - 15 B. Stephens, *Air Filtration for COPD in VA Population of Veterans (NCT05913765)*. *ClinicalTrials.gov*, 2024, available from: <https://clinicaltrials.gov/study/NCT05913765>.
  - 16 B. Stephens, I. Kang, K. Jagota, Z. Elfessi, N. Karpen and M. Heidarinejad, *et al.*, *Study protocol for a one-year, randomized, single-blind, clinical trial of stand-alone indoor air filtration in the homes of U.S. military Veterans with moderate to severe COPD in metropolitan Chicago*, 2024 [cited 2024 Aug 31], available from: <https://www.researchsquare.com/article/rs-4645870/v1>.
  - 17 ANSI/AHAM, *ANSI/AHAM Standard AC-1: Method for Measuring Performance of Portable Household Electric Room Air Cleaners*, Association of Home Appliance Manufacturers, 2020.
  - 18 R. L. Peck, S. A. Grinshpun, M. Yermakov, M. B. Rao, J. Kim and T. Reponen, Efficiency of portable HEPA air purifiers against traffic related combustion particles, *Build. Environ.*, 2016, **98**, 21–29.
  - 19 K. Singh-Smith, L. Sprague Martinez, M. Eliasziw, S. Lerman Ginzburg, N. Hudda, G. M. Betz, *et al.*, Reaction to at-home air purifiers installed to reduce traffic-related air pollution in near-highway residences, *Trials*, 2024, **25**(1), 551.
  - 20 C. H. Huang, T. Bui, D. Hwang, J. Shirai, E. Austin, M. Cohen, *et al.*, Assessing the effectiveness of portable HEPA air cleaners for reducing particulate matter exposure in King County, Washington homeless shelters: Implications for community congregate settings, *Sci. Total Environ.*, 2023, **891**, 164402.
  - 21 S. Batterman, L. Du, E. Parker, T. Robins, T. Lewis, B. Mukherjee, *et al.*, Use of free-standing filters in an asthma intervention study, *Air Qual., Atmos. Health*, 2013, **6**(4), 759–767.
  - 22 A. M. McIntyre, M. K. Scammell, P. L. Kinney, K. Khosla, L. Benton, R. Bongiovanni, *et al.*, Portable Air Cleaner Usage and Particulate Matter Exposure Reduction in an Environmental Justice Community: A Pilot Study, *Environ. Health Insights*, 2024, **18**, 11786302241258587.
  - 23 W. Chen, Z. M. Wang, K. Peerless, E. Ullman, M. J. Mendell, D. Putney, *et al.*, Monitoring of Ventilation, Portable Air Cleaner Operation, and Particulate Matter in California Classrooms: A Pilot Study, *Sustainability*, 2024, **16**(5), 2052.
  - 24 NIOSH, *NIOSH Sound Level Meter*, 2024, available from: <https://www.cdc.gov/niosh/topics/noise/pdfs/NIOSH-Sound-Level-Meter-Application-app-English.pdf>.
  - 25 Onset, *UX120-018 HOBO Plug Load Data Logger*, 2024, available from: <https://www.onsetcomp.com/sites/default/files/2023-04/17838-FMAN-UX120-018.pdf>.
  - 26 B. C. Singer, W. R. Chan, Y. Kim, F. J. Offermann and I. S. Walker, Indoor air quality in California homes with code-required mechanical ventilation, *Indoor Air*, 2020, **30**(5), 885–899.
  - 27 I. Kang, A. McCreery, P. Azimi, A. Gramigna, G. Baca, K. Abromitis, *et al.*, Indoor air quality impacts of residential mechanical ventilation system retrofits in existing homes in Chicago, IL, *Sci. Total Environ.*, 2022, **804**, 150129.
  - 28 A. Santos, G. P. Duggan, J. Davis and D. Zimmerle, A Cautionary Note on Using Smart Plugs for Research Data Acquisition, *e-Prime - Advances in Electrical Engineering, Electronics and Energy*, 2023, **4**, 100137.
  - 29 Z. Ling, J. Luo, Y. Xu, C. Gao, K. Wu and X. Fu, Security Vulnerabilities of Internet of Things: A Case Study of the Smart Plug System, *IEEE Internet Things J.*, 2017, **4**(6), 1899–1909.
  - 30 T. Xia, J. Ranases, B. Schmiesing, R. Garcia, A. Walding, R. DeMajo, *et al.*, How teacher behaviors and perceptions, air change rates, and portable air purifiers affect indoor air quality in naturally ventilated schools, *Front. Public Health*, 2024, **12**, 1427116.
  - 31 A. Ebrahimifakhar, M. Poursadegh, Y. Hu, D. P. Yuill and Y. Luo, A systematic review and meta-analysis of field studies of portable air cleaners: Performance, user behavior, and by-product emissions, *Sci. Total Environ.*, 2024, **912**, 168786.
  - 32 D. M. Murray and D. E. Burmaster, Residential air exchange rates in the United States: empirical and estimated parametric distributions by season and climatic region, *Risk Anal.*, 1995, **15**(4), 459–465.
  - 33 Q. Y. Meng, B. J. Turpin, L. Korn, C. P. Weisel, M. Morandi, S. Colome, *et al.*, Influence of ambient (outdoor) sources on residential indoor and personal PM<sub>2.5</sub> concentrations: Analyses of RIOPA data, *J. Exposure Anal. Environ. Epidemiol.*, 2005, **15**(1), 17–28.

- 34 S. Westgate and N. L. Ng, Using in-situ CO<sub>2</sub>, PM<sub>1</sub>, PM<sub>2.5</sub>, and PM<sub>10</sub> measurements to assess air change rates and indoor aerosol dynamics, *Build. Environ.*, 2022, **224**, 109559.
- 35 C. Schreck, S. Rouchier, A. Fouquier, F. Machefert and E. Wurtz, In situ air change rate estimation from metabolic CO<sub>2</sub> measurement. Summer experimental campaign in a single-family test house, *Build. Environ.*, 2024, **259**, 111646.
- 36 C. H. Huang, N. Liu, J. Shirai, M. Cohen, E. Austin and E. Seto, Effects of dust loading on the long-term performance of portable HEPA air cleaner to woodsmoke – A laboratory investigation, *Indoor Environ.*, 2024, **1**(4), 100057.
- 37 W. Lorizio, H. Woo, M. C. McCormack, C. Liu, N. Putcha, M. Wood, *et al.*, Patterns and Predictors of Air Cleaner Adherence Among Adults with COPD, *Chronic Obstructive Pulmonary Diseases*, 2022, 366–376.
- 38 S. A. K. B. Thottiyil, J. Sim, V. M. McDonald, J. McDonagh, M. Clapham and B. G. Mitchell, Air Purifiers and Acute Respiratory Infections in Residential Aged Care: A Randomized Clinical Trial, *JAMA Netw. Open*, 2024, **7**(11), e2443769.