

Cite this: *Energy Environ. Sci.*,  
2024, 17, 9509

## Market optimization and technoeconomic analysis of hydrogen-electricity coproduction systems†

Daniel J. Laky,<sup>‡</sup><sup>a</sup> Nicole P. Cortes,<sup>‡</sup><sup>a</sup> John C. Eslick,<sup>§</sup><sup>b</sup> Alexander A. Noring,<sup>b</sup> Naresh Susarla,<sup>¶</sup><sup>b</sup> Chinedu Okoli,<sup>||</sup><sup>b</sup> Miguel A. Zamarripa,<sup>b</sup> Douglas A. Allan,<sup>b</sup> John H. Brewer,<sup>Ⓜ</sup><sup>c</sup> Arun K. S. Iyengar,<sup>b</sup> Maojian Wang,<sup>b</sup> Anthony P. Burgard,<sup>d</sup> David C. Miller<sup>Ⓜ</sup><sup>\*\*d</sup> and Alexander W. Dowling<sup>Ⓜ</sup><sup>\*a</sup>

Decarbonization efforts across North America, Europe, and beyond rely on variable renewable energy sources such as wind and solar, as well as alternative fuels, such as hydrogen, to support the sustainable energy transition. These advancements have prompted a need for more flexibility in the electric grid to complement non-dispatchable energy sources and increased demand from electrification. Integrated energy systems are well suited to provide this flexibility, but conventional technoeconomic modeling paradigms neglect the time-varying dynamic nature of the grid and thus undervalue resource flexibility. In this work, we develop a computational optimization framework for dynamic market-based technoeconomic comparison of integrated energy systems that coproduce low-carbon electricity and hydrogen (e.g., solid oxide fuel cells, solid oxide electrolysis) against technologies that only produce electricity (e.g., natural gas combined cycle with carbon capture) or only produce hydrogen. Our framework starts with rigorous physics-based process models, built in the open-source Institute for the Design of Advanced Energy Systems (IDAES) modeling and optimization platform, for six energy process concepts. Using these rigorous models and a workflow to optimally design each technology, the framework is shown to be capable of evaluating new and emerging technologies in varying energy markets under a plethora of future scenarios (i.e., renewables penetration, carbon tax, etc.). Ultimately, our framework finds that solid oxide fuel cell-based coproduction systems achieve positive profits for 85% of the analyzed market scenarios. From these market optimization results, we use multivariate linear regression ( $R^2$  values up to 0.99) to determine which electricity price statistics are most significant to predict the optimized annual profit of each system. The proposed framework provides a powerful tool for directly comparing flexible, multi-product energy process concepts to help discern optimal technology and integration options.

Received 1st June 2024,  
Accepted 9th October 2024

DOI: 10.1039/d4ee02394c

rsc.li/ees

### Broader context

Integrated energy systems (IESs) provide power grid flexibility by coupling multiple technologies and products to create more efficient and dynamically responsive systems. Due to hydrogen's anticipated role in decarbonization, we investigate the integration of electricity and hydrogen production *via* solid oxide electrolysis. We develop a framework to directly compare technology options of varying flexibility and demonstrate its use *via* six process concepts. Our results indicate that solid oxide fuel cell (SOFC) and solid oxide electrolyzer cell (SOEC)-based IESs have significant economic advantages over standalone fuel cells and natural gas combined cycles. Integrated systems that coproduce electricity and hydrogen – SOFC + SOEC and reversible solid oxide cell (rSOC) – are profitable in 85% and the top performer in 74% of considered market scenarios. The SOFC and rSOC technologies also show extremely flexible performance in anticipated market scenarios with high levels of variable renewable energy penetration. These findings strongly encourage research investments in SOFC and SOEC technologies, especially flexible coproduction systems.

<sup>a</sup> Department of Chemical and Biomolecular Engineering University of Notre Dame, Notre Dame, IN 46556, USA. E-mail: adowling@nd.edu<sup>b</sup> National Energy Technology Laboratory Site Support Contractor, Pittsburgh, PA 15236, USA<sup>c</sup> National Energy Technology Laboratory, Morgantown, WV 15236, USA<sup>d</sup> National Energy Technology Laboratory, Pittsburgh, PA 15236, USA† Electronic supplementary information (ESI) available. See DOI: <https://doi.org/10.1039/d4ee02394c>

‡ These authors contributed equally to this work.

§ Current address: Carrier Global Corporation, Palm Beach Gardens, FL 33418.

¶ Current address: Air Products, Allentown, Pennsylvania, 18106.

|| Current address: Procter &amp; Gamble, Cincinnati, OH 45202.

\*\* Current address: OLI Systems, Inc., Parsippany, NJ 07054.



# 1. Introduction

Broad efforts across the U.S. and beyond to decarbonize the electric grid and energy-intensive industries have led to variable renewable energy (VRE) sources such as solar and wind growing faster than any other technology.<sup>1</sup> VRE sources cannot control their energy production beyond curtailment, which exacerbates the difficulties in balancing supply and demand, often resulting in dramatic and undesirable ramping events for dispatchable generation resources which are generally designed for baseload operations.<sup>2–4</sup> This being said, alternate energy carriers such as hydrogen (H<sub>2</sub>) have been investigated to support economy-wide decarbonization. Energy systems with increased flexibility, which can respond quickly to supply and demand imbalances, are needed to integrate VRE sources into the electric grid while maintaining efficiency, cost competitiveness, reliability, and resiliency. Integrated energy systems (IESs) provide grid flexibility by exploiting synergies from combining multiple technologies while switching rapidly between operating modes, *e.g.*, switching from electricity to H<sub>2</sub> production, in response to grid demands. As a result of this increased flexibility, IESs have been shown to have many benefits, including lower costs<sup>5</sup> and reduced emissions<sup>6</sup> compared to prevailing standalone technologies.

Prior work has highlighted the potential of H<sub>2</sub> to decarbonize multiple industrial sectors<sup>7–9</sup> and support the transition to higher VRE penetration.<sup>10–13</sup> Bødal and colleagues showed that joint planning of H<sub>2</sub> and electricity production can reduce the cost of grid expansion.<sup>14</sup> Accounting for these benefits, H<sub>2</sub> production is a great candidate for integration with electricity production processes by offering additional grid flexibility and an additional revenue opportunity for participants in increasingly volatile power markets.

Fuel cell technologies are becoming increasingly popular for power and H<sub>2</sub> generation. In terms of electrical power, solid oxide fuel cells (SOFCs) are particularly interesting, as they have comparably better fuel flexibility, more capacity options, and higher efficiency than other fuel cell types.<sup>15,16</sup> Additionally, while posing general operating challenges, their high-temperature operation makes them an ideal candidate for closely-coupled heat integration with other processes (*i.e.*, H<sub>2</sub> or liquid fuel) to improve overall process efficiencies.<sup>17</sup> Prior reviews highlight current deployments of SOFCs,<sup>18</sup> the outlook of SOFCs for grid-scale deployment and integration with other systems,<sup>19</sup> as well as current research in improving SOFC technology, including materials advancements and systems design.<sup>20</sup>

Low temperature fuel cell (LTFC) technologies of present interest include alkaline fuel cell (AFC) and proton-exchange membrane fuel cell (PEMFC) systems.<sup>21–24</sup> AFCs and PEMFCs, due to their short start-up times and portability, are generally utilized for small-scale applications in the 1–500 kW range such as backup power, transportation, and distributed generation. However, carbon dioxide (CO<sub>2</sub>) severely limits the performance and life of an AFC, while a PEMFC is susceptible to poisoning from a variety of impurities including carbon monoxide.

Consequently, such systems cannot leverage a low-cost feedstock like natural gas without introducing pre-processing steps to produce pure H<sub>2</sub> fuel with significant adverse impacts on overall system electrical efficiency. High temperature SOFC systems, on the other hand, can produce power operating directly on natural gas while utilizing both the process and waste heat effectively to result in much higher system efficiencies relative to any of the LTFCs.<sup>16,25,26</sup> SOFC systems are also typically more electrically efficient than a molten carbon fuel cell (MCFC), which operates at a slightly lower temperature while eschewing the long-term durability implications of the corrosive MCFC electrolyte.

Concomitantly, high temperature solid oxide electrolyzer cell (SOEC) technologies can use both electricity and waste heat to produce H<sub>2</sub> at efficiencies that can be 25 percentage points higher than low temperature proton exchange membrane (PEM) electrolysis.<sup>27,28</sup> These heightened efficiencies hold immense promise in reducing the electricity demand, a primary cost driver in H<sub>2</sub> production through electrolysis. Additionally, achieving the ambitious hydrogen cost target of 1.00 \$ kg<sup>-1</sup>, as outlined in the Department of Energy's Hydrogen Shot initiative,<sup>29</sup> may necessitate such elevated efficiencies given that PEM-based H<sub>2</sub> production, even after optimizing design and dynamic operation for time-varying electricity prices, is well-above this threshold.<sup>30</sup>

Accordingly, the present study focuses on SOFC and SOEC technologies with the potential to produce power and H<sub>2</sub> at high efficiencies, which along with the capability to operate reversibly between the power and electrolysis modes can result in higher round trip efficiencies (cycling between power and electrolysis modes) than low temperature fuel cell technologies. Additionally, their higher temperature operation and ability to utilize waste heat make them particularly attractive for integration with existing technologies. There is a wide variety of prior work on novel SOFC-based IES (SOFC-IES) concepts and different technology options for these systems. Many of these works focus on developing highly detailed, physics-based models of the system and optimizing the steady-state operation for increased efficiency,<sup>31–35</sup> reduced costs,<sup>32,34,36</sup> less environmental impact,<sup>36</sup> and other objectives.<sup>32,34,35,37,38</sup>

Traditional cost optimizations often hinge on the levelized cost of electricity (LCOE) or similar cost metrics. These static methods have sufficed for the historical grid, dominated by base-loaded systems. However, current and future grid optimization needs to consider the intermittency imposed by increased VRE penetration and electrification. Instead of considering a time-varying operating profile, LCOE calculates the system's lifetime costs and divides them by an assumed lifetime electricity production to find a cost per unit of energy produced.<sup>39</sup> LCOE is one of the most popular technoeconomic analysis (TEA) metrics because it is easy to calculate and provides a means to compare power generation costs with prices in different regions quickly. However, because LCOE assumes a fixed capacity factor regardless of market dynamics, it does not value system flexibility and is a poor predictor for grid-parity for some technologies.<sup>40–42</sup> As such, new TEA



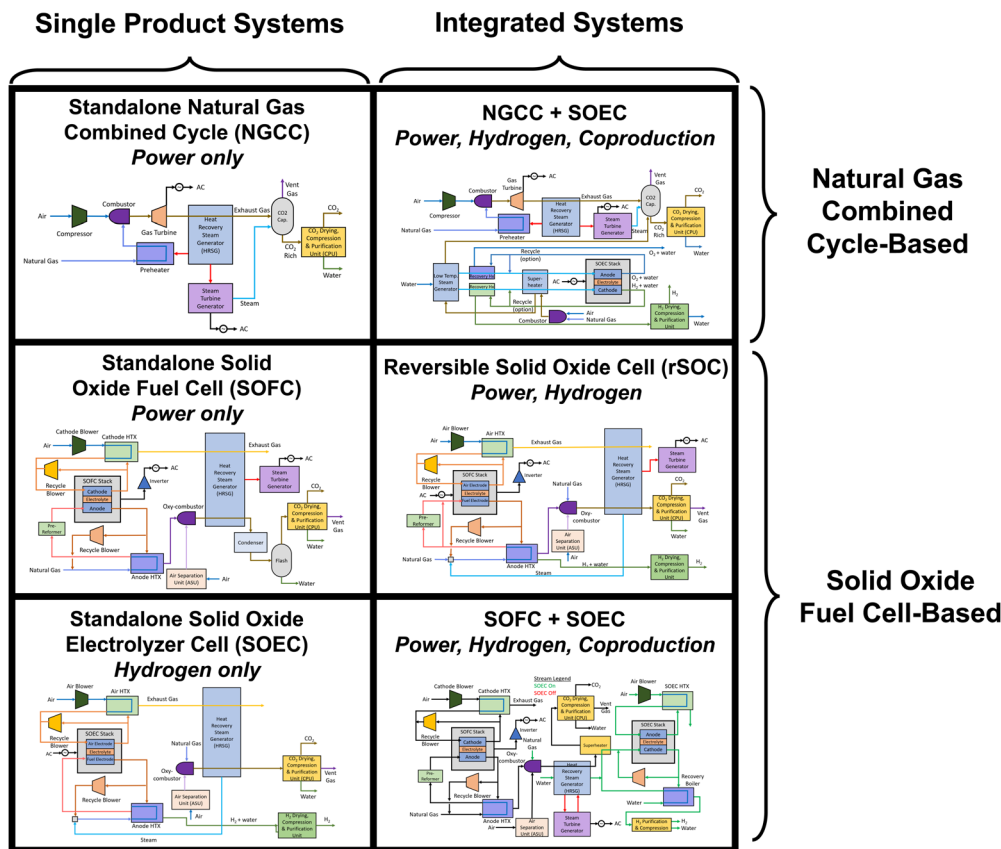


Fig. 1 Process flow diagrams of process concepts compared in this work. The left column contains single product systems, including electricity (NGCC and SOFC) and  $H_2$  (SOEC) producers. The right column contains integrated concepts of those technologies. The top row are NGCC-based concepts, and the bottom two rows are SOFC-based. Each concept is fitted with greater than 97% carbon capture. For more information on the models see ref. 48 and 49. Larger images of each process concept is included in the ESI† (S9).

methods that go beyond LCOE and capture dynamic market forces are needed to capture the value of flexibility, especially for IESS.<sup>43–45</sup> For example, Naeni *et al.*<sup>38</sup> developed a detailed model of SOFC cell degradation over time which optimized cell size and cell replacement schedule for 20 years of the plant. Through these models, they found that the mode of operation of SOFCs significantly impacts LCOE. Glenk and colleagues evaluated reversible power-to-gas systems<sup>46</sup> and forecast technology cost and the efficiency of such technology<sup>46,47</sup> finding that even under current dynamic energy markets, power-to-gas systems can be profitable. However, integration and retrofitting with existing natural gas-based technologies and important operational constraints (*i.e.*, minimum production constraints, minimum up and down time constraints) were not considered and only two electricity markets (Germany and Texas) were studied. To the authors' knowledge, no prior studies have systematically evaluated the operation of SOFC-IESS in the context of a wide variety of both historical and forecast wholesale electricity market scenarios.

In this work, we address these gaps by developing a novel computational optimization framework to predict the maximum possible profits of SOFC-IESS in the context of different energy markets. We also address important operational decisions such as minimum up and down times, minimum

operating loads, and modular coproduction that were not considered previously.<sup>46,47</sup> Using this framework, we directly compare the performance of multiple process concepts, each with 97% or greater carbon capture and storage (CCS), that hybridize SOFCs or natural gas combined cycles (NGCCs) for power generation with SOECs for  $H_2$  production. For each of the six technologies (Fig. 1), we optimize their operation within many historical and forecast real-time energy markets under many carbon tax and renewables penetration conditions. We find that SOFC and SOEC-based  $H_2$  production and coproduction IESS, even within historical conditions, provide a lucrative option at high throughput, promoting research into the scale-up of existing SOFC/SOEC technologies. As the framework allows for direct comparison of economic performance of energy process concepts, it has the potential to serve as a powerful tool to assist in discerning optimal technology and integration options for future energy system deployment and strategically guide R&D investments in enabling the systems.

## 2. Methodology


### 2.1. Technology overview – process concepts

We compare six process concepts, shown in Fig. 1, that produce electric power,  $H_2$ , or both. The (1) standalone NGCC system







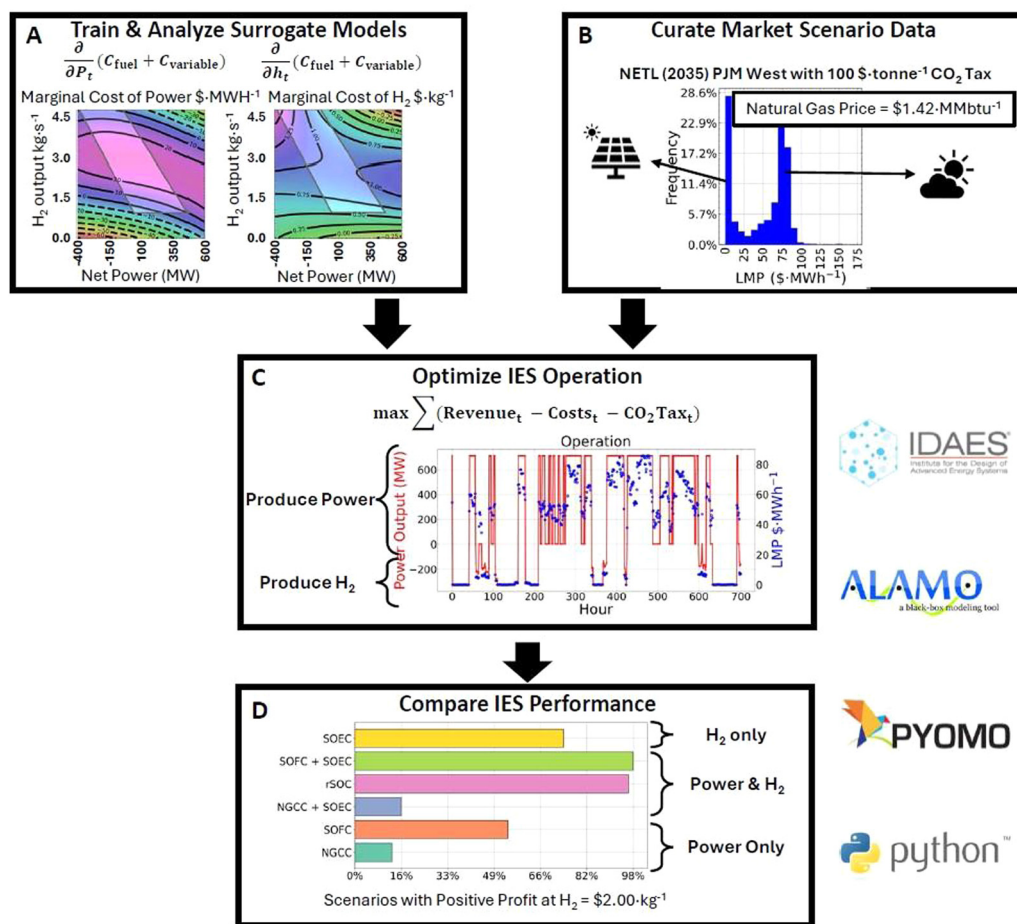

**Fig. 2** Framework for market optimization and techno-economic analysis of process alternatives. (A) Algebraic surrogate models are trained from rigorous nonlinear steady-state process optimization results from the IDAES-PSE framework. Analyzing the partial derivatives of these surrogate models reveals the marginal costs of H<sub>2</sub> and electricity for each system. (B) Past, present, and future hourly time-series electricity price data (historical, forecasts) are collected for six U.S. wholesale markets: CAISO, ERCOT, MISO, NYISO, PJM, SPP. (C) Over one thousand instances of the multi-period optimization problem (using the algebraic surrogates from box A) are solved to analyze all six energy process concepts using 61 electricity market scenarios and five fixed H<sub>2</sub> price scenarios. (D) Energy process concepts are compared using annual net profit, electricity and H<sub>2</sub> capacity factors, and other performance metrics. Linear regression analysis reveals which electricity market price statistics are most significant in predicting the annual net profit of each system.

systems. Similarly, Fig. S9 and S10 (ESI<sup>†</sup>) use the cost surrogates to determine the mean electricity and H<sub>2</sub> prices for concepts to break even (analysis from ref. 49).

#### 2.4. Curating market data

To analyze a diverse set of price markets, we collected 61 annual locational marginal price (LMP) signals to represent historical, present, and future wholesale electricity market scenarios. Table S7 in the ESI<sup>†</sup> summarizes these datasets, including key statistics. Historical and present LMPs were gathered from publicly available datasets published by independent system operators (ISOs) and regional transmission organizations (RTOs) across the United States, including the California ISO (CAISO – NP15, ZP26, and SP15 regions); Electric Reliability Council of Texas (ERCOT – North, South, West, and Houston regions); ISO New England (ISO-NE); New York ISO (NYISO); Midwest ISO (MISO – Indiana, Louisiana, and Minnesota regions); and the Pennsylvania Jersey Maryland Interconnection West, and Southwest Power Pool (SPP – North

and South regions).<sup>54</sup> We used data from 2019 to represent historical pricing (pre-COVID-19 pandemic) and data from 2022 to represent more current pricing trends. Natural gas prices for each region were selected by taking the average spot price reported by the Energy Information Administration.<sup>55</sup> These prices ranged from 2.39 to 10.79 \$ MMBtu<sup>-1</sup> across the different regions.

We selected three price projection methods to represent possible future market scenarios. These projected market scenarios contain low to high VRE penetration conditions, as well as low to high carbon tax levels. First, projections from Durvasulu and Cohen<sup>56</sup> used the National Renewable Energy Laboratory's (NREL) Regional Energy Deployment System (ReEDS) capacity planning tool<sup>57</sup> and PLEXOS energy market simulation platform<sup>58</sup> to simulate five regions of the U.S. (CAISO, ERCOT, MISO-W, NYISO, and PJM-W) under CO<sub>2</sub> taxes of 100 and 150 \$ tonne<sup>-1</sup>. Carbon taxes were implemented as increasing trajectories from 0 \$ tonne<sup>-1</sup> to the target value to drive capacity toward low carbon systems, but not allowing for CCS



deployment to ensure LMPs were not affected. These price scenarios assumed natural gas prices between 1 and 3 \$ MMBtu<sup>-1</sup>, depending on the region modeled. This dataset will be referred to as “NREL (2035)”.

Second, we considered projections by Jenkins *et al.*,<sup>59</sup> which utilized GenX<sup>60</sup> and PowerGenome<sup>61</sup> to simulate prices in a single integrated planning model representing the U. S. under different levels of VRE penetration and CO<sub>2</sub> tax policies. All these projections assumed a natural gas price of 2.94 \$ MMBtu<sup>-1</sup>. This dataset will be referred to as “Princeton (2030)”.

Lastly, we performed a series of independent production cost simulations for the ERCOT region covering 2033 through 2037, assuming a range of CO<sub>2</sub> tax rates ranging from 0 to 250 \$ tonne<sup>-1</sup>. This enabled the exercise of simulations for a 2035 study year with sufficient run-in and run-out periods to ensure that unit commitment constraints did not artificially impact the results. These projections assumed a natural gas price of 4.42 \$ MMBtu<sup>-1</sup>. See Section S1 (ESI<sup>†</sup>) for a detailed explanation of these projections.<sup>62,63</sup> This dataset will be referred to as “NETL (2035)”.

A summary of the market scenarios can be seen in Fig. 3. We present the mean LMP value (panel (a)), the natural gas price

for that scenario (panel (b)), and the two multimodality tests that were performed (see Section S4, ESI<sup>†</sup>) to indicate if a market should be considered multimodal (panel (c)). If the market passed both multimodality tests (above 1.0 in Fig. 3, panel (c)), the market was considered to be multimodal. To further visualize the price signal data from some of the markets, 25 of the 61 markets (5 from each reference) are shown as histograms in ESI,† Fig. S16.

While H<sub>2</sub> is expected to be a key energy carrier in decarbonized economies, H<sub>2</sub> markets remain in their infancy, currently dominated by private bilateral contracts between suppliers and consumers. Instead of speculating on the structure of future H<sub>2</sub> markets, we selected five static H<sub>2</sub> selling prices between 1.00 and 3.00 \$ kg<sup>-1</sup> and performed a sensitivity analysis. In 2019, the International Energy Agency (IEA) reported the global average levelized cost of H<sub>2</sub> (LCOH) to be from 1.20 to 2.10 \$ kg<sup>-1</sup> for production from natural gas (*via* steam methane reforming (SMR)) and 3.2 to 7.7 \$ kg<sup>-1</sup> for renewables-based electrolysis.<sup>64</sup> More recently, an NETL report estimated LCOH of 1.64 \$ kg<sup>-1</sup> for SMR with CCS, 1.59 \$ kg<sup>-1</sup> for auto thermal reforming (ATR) with CCS, 3.09 \$ kg<sup>-1</sup> for coal gasification with CCS, and 3.64 \$ kg<sup>-1</sup> for a coal and biomass co-gasification

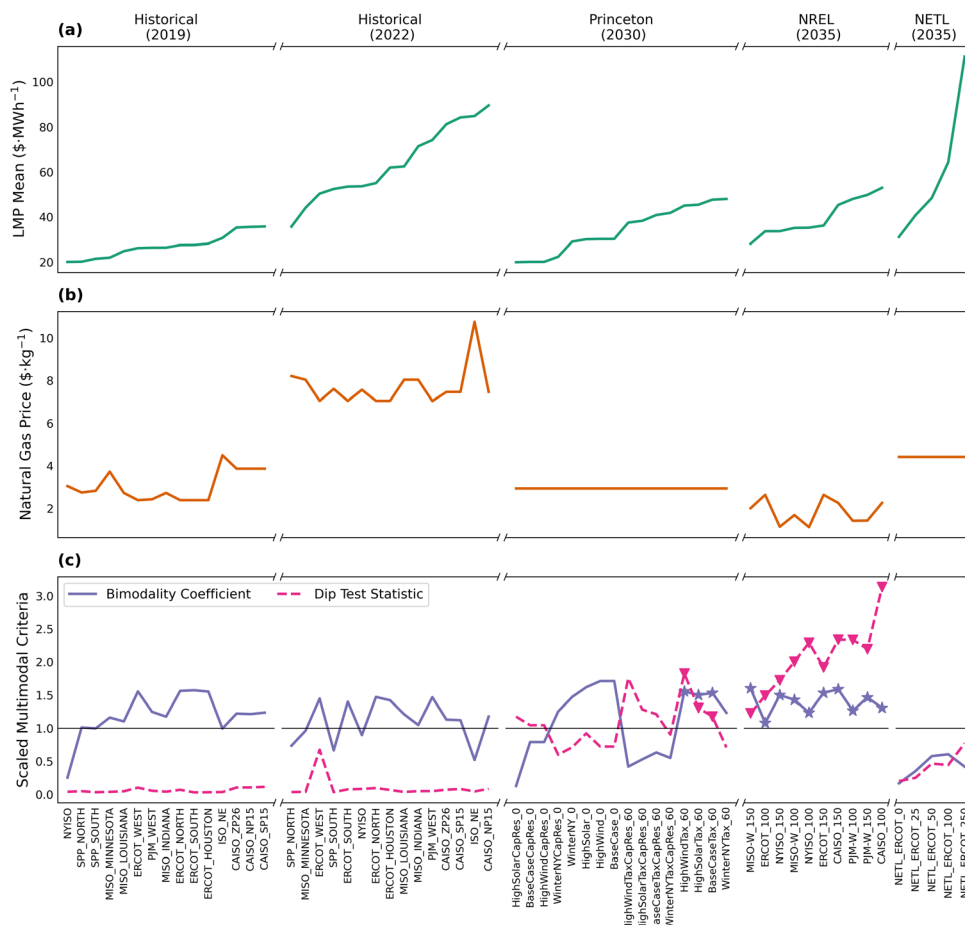


Fig. 3 Summary statistics of the market characteristics with respect to (a) mean LMP, (b) natural gas price, and (c) multimodality test statistics. For market signal modality, only those that have both statistics above the normalized threshold are considered to be multimodal (indicated with markers). Markets have been broken down by reference and are sorted by increasing mean LMP.



system with CCS.<sup>65</sup> This is part of a broader DOE goal to reduce the cost of clean H<sub>2</sub> to 1.00 \$ kg<sup>-1</sup> by 2030.<sup>29</sup> Additional work has highlighted paths to achieve this goal, including integrating clean H<sub>2</sub> production with other energy systems.<sup>29,66</sup> Based on these guidelines, we select a nominal H<sub>2</sub> selling price of 2.00 \$ kg<sup>-1</sup> and analyze additional prices of 1.00, 1.50, 2.50, and 3.00 \$ kg<sup>-1</sup> for each of the 61 LMP signals. This results in 305 different market scenarios assessed for each of the six process concepts.

We note the nominal H<sub>2</sub> selling pricing is the selling price after taking into account both the transportation and storage costs and possible tax credits. Thus, this analysis allows technologies to be evaluated by how much net profit is required from each kilogram of H<sub>2</sub> produced to justify technology investment. Nevertheless, we note that H<sub>2</sub> transport and storage costs can vary widely depending on the chosen technologies. For example, whereas salt cavern storage coupled to pipeline transport may add as little as \$0.2 kg<sup>-1</sup> to the cost of H<sub>2</sub>, further compressing the H<sub>2</sub>, storing it in a tank, and transporting it by truck can add more than ten times that amount.<sup>67</sup> Thus, we chose not to embed these costs directly into the optimization formulation to facilitate interpretation of the results. The sensitivity of the results to variation in H<sub>2</sub> transport and storage costs can be explored, however, by comparing results generated assuming different selling prices of H<sub>2</sub>. Alternatively, one can directly incorporate these costs into the optimization problem (Section 3.5). However, since we consider that H<sub>2</sub> price is static for the reasons given above, incorporation of static transportation and storage costs will lead to consistent conclusions.

### 2.5. Optimizing process concept operation

Proper valuation of the process concepts requires computing the optimal time-varying operation that responds to the fluctuations in market conditions. For each of the six process concepts and 305 market scenarios (1830 total scenarios), we solve a mixed-integer nonlinear programming (MINLP) optimization problem with the following general structure:

---


$$\begin{aligned} & \text{Maximize Electricity revenue} + \text{H}_2 \text{ revenue} - \text{system costs} \\ & \quad (\text{algebraic surrogates}) - \text{carbon taxes} \\ & \text{Subject to Profit model constraints (algebraic surrogates),} \\ & \quad \text{operating mode integer constraints, startup and} \\ & \quad \text{shutdown costs and logic, minimum up and down} \\ & \quad \text{time constraints, feasible operating constraints} \\ & \quad (\text{algebraic surrogates}) \end{aligned}$$


---

The optimization degrees of freedom (decision variables) are the hourly power and H<sub>2</sub> production rates (continuous variables) and the operating decisions (discrete variables). The objective is to maximize the system's profit over the annual planning horizon. The electricity and H<sub>2</sub> revenues are calculated by multiplying the production rates by the respective

hourly prices. The system costs are calculated using an algebraic surrogate model (see Section 3.3). We define a set of possible operating modes for each system, depending on the process concept's flexibility. Possible modes include off (no output), power only, H<sub>2</sub> only, or coproduction (producing both power and H<sub>2</sub> simultaneously). A set of operating mode integer constraints enforces operation within the feasible region of the active mode at each operational time step. The systems are also subject to startup and shutdown costs, as well as time limits for how long a system must be down before starting back up again or up before it can shut down again.<sup>68</sup> For coproduction systems, we also include feasible operating region constraints, in the form of linear inequalities, that bound system power production rate as a function of H<sub>2</sub> production rate. This optimization formulation assumes the new system is operating as a price-taker meaning the addition of the modeled system does not significantly affect the LMPs or energy system makeup.<sup>69</sup> See Fig. 2 box C (middle) for an example hourly operation schedule.

A detailed description and statement of the mathematical formulation used to solve these market scenarios is included in ESI,<sup>†</sup> Section S2. Therein, the MINLP is presented in detail with descriptions of each variable, set, and equation, as well as the solution procedure and solver tools used to optimize each MINLP instance.

### 2.6. Comparing system performance

The output of the optimization model is the best annual profit and system operating schedule, which includes hourly electricity and H<sub>2</sub> production rates, as well as the best time to switch between operating modes, startups, and shutdowns. Fig. 2 box C (middle) shows an example system output. The red line depicts the hourly dispatch schedule, and the blue dots represent the LMPs plotted against the hour. When the LMP (blue dots) are low, the system chooses to shut down, and when the LMP is higher (typically, above the system's marginal costs), power is produced at its maximum capacity. The red lines may dip below zero power output for coproduction systems or H<sub>2</sub>-only systems, indicating a net purchase of electricity from the grid. A supplemental spreadsheet provides the annualized profit optimization results for each system and scenario and several dashboard-like plots that automatically update as the data are filtered and sorted.

Using these data, we perform statistical analysis to compare the economic performance across process concepts under each scenario. Fig. 2 box D (bottom) depicts the percentage of scenarios for each case that result in a positive profit for all scenarios with a H<sub>2</sub> selling price of 2.00 \$ kg<sup>-1</sup>. Analyses like this plot allow us to observe which systems are most robust to variation in market conditions. Moreover, we perform multivariate linear regression to correlate the system's optimal profit to market features such as natural gas price, carbon taxes, H<sub>2</sub> price, and LMP statistics (*e.g.*, mean, median, multimodality,<sup>70–73</sup> unimodality, *etc.*<sup>74,75</sup>). Ultimately, this analysis helps us distill 1830 annual operation optimization results into a concise set of key findings about the relative economic



competitiveness of the process concepts across diverse market scenarios.

### 3. Results

#### 3.1 SOFC outperforms existing NGCC systems

Fig. 4 shows optimization results for all 61 market price signals at the nominal  $H_2$  price of  $2.00 \text{ \$ kg}^{-1}$  for each process concept. Price scenarios are plotted by name along the horizontal axis and are divided into groups by source (see Section 2.4). The vertical axis shows the optimal annual profit,  $H_2$  capacity factor, and power capacity factor calculated in our rigorous optimization framework. High capacity factors stem from operating procedures that keep the process on and, while on, running near maximum capacity for a large part of the operating year. Technologies without  $H_2$  (NGCC, and SOFC) or power production (SOEC) will have a capacity factor of 0 for the missing process output. Scenarios within each source are sorted by increasing annual profit for the SOFC process concept to make

comparison more clear. Versions of these plots at all the  $H_2$  selling prices, are in the ESI† (Fig. S11–S14).

From Fig. 4, we see that the standalone SOFC concept always outperforms the standalone NGCC. Additionally, whereas the SOFC system achieves a positive profit in 52% of the examined market scenarios, the NGCC achieves a positive profit in only 13%. This is due to the anticipated higher efficiency and lower capital cost for SOFC-based power plants with CCS compared to NGCC-based power plants with CCS leading to a lower LCOE. Also, SOFC has a higher power capacity factor than NGCC in every scenario analyzed, many times exceeding a 40% capacity factor increase (see Fig. 4 and ESI,† Fig. S11–S14). This dramatic result indicates that SOFC-based power plants can produce power at profit under significantly more market conditions than NGCC-based power plants. Also, at the nominal  $H_2$  price, the SOFC-based integrated systems and SOEC-based hydrogen producing system have positive profits in nearly all scenarios (97%, 98%, and 74%, respectively).

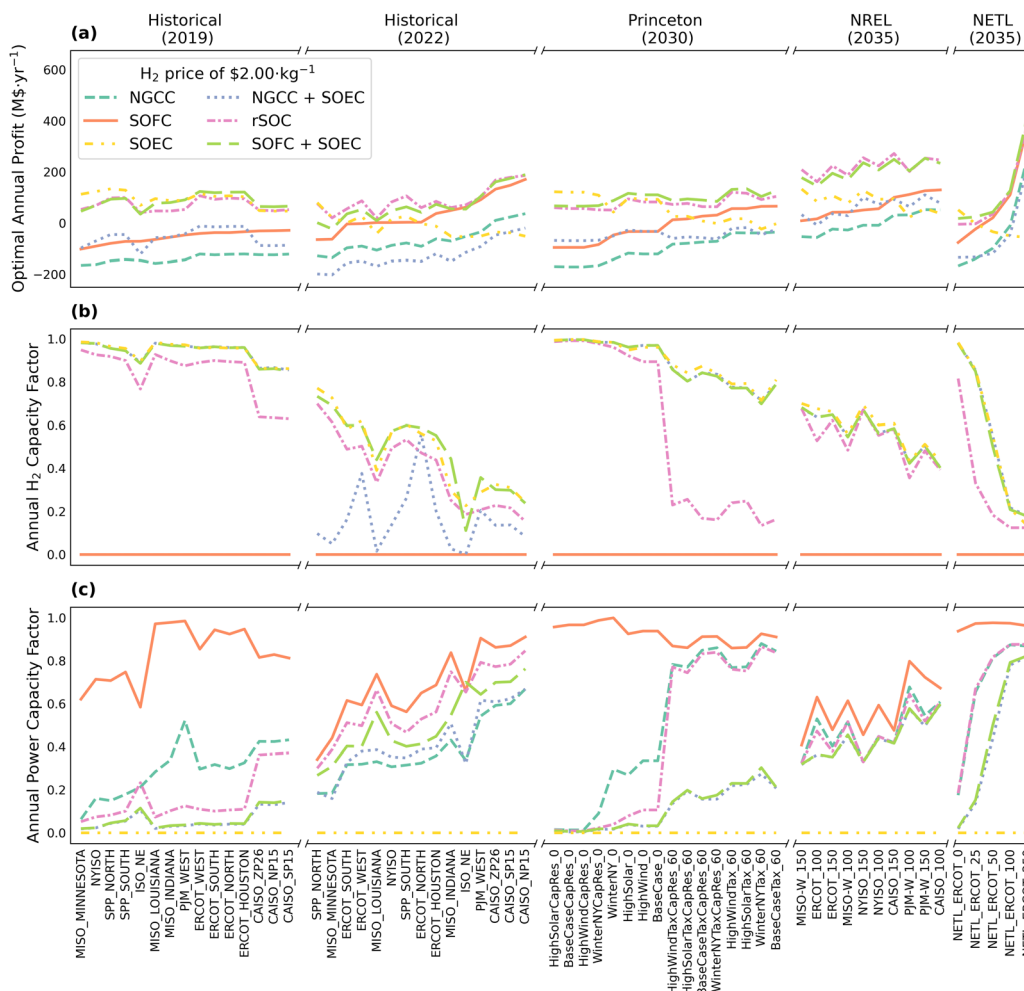


Fig. 4 Optimized annual profits for all analyzed electricity price signals at a nominal  $H_2$  selling price of  $2.00 \text{ \$ kg}^{-1}$ . Price signals are separated by source and, within each source, sorted by SOFC annual profit. Also, panels (b) and (c) display the  $H_2$  and power capacity factors for the given optimal operating solution, respectively. Names of market signals are the region followed by the carbon tax for future scenarios (i.e., ERCOT\_100 from the NREL (2035) data set is the ERCOT region with a carbon tax of  $100 \text{ \$ tonne}^{-1}$ ).





### 3.2. H<sub>2</sub> price sensitivity analysis

Fig. 5 summarizes all 1830 process concept/market scenario pairs as a panel of histograms. Each histogram contains the optimal annual profit data from all 61 market scenarios at a given H<sub>2</sub> price. Each column represents a different H<sub>2</sub> price, and each row represents a unique process concept. As H<sub>2</sub> increases across a row, profit either stays the same if the system produces only power (*i.e.*, NGCC and SOFC) or increases if the system can produce H<sub>2</sub> (*i.e.*, SOEC, rSOC, NGCC + SOEC, SOFC + SOEC) for a given market scenario. The flexibility is obvious for the rSOC and SOFC + SOEC process concepts as almost all LMP signals result in profitability with a H<sub>2</sub> price at or above 2.00 \$ kg<sup>-1</sup> (Fig. 5, rows 3, 4 and 5). Also, the benefit of adapting a NGCC system with an additional SOEC unit becomes clear at higher H<sub>2</sub> prices. Finally, the SOEC profitability is on average increasing, but the spread of profitability also grows, indicating that although a standalone SOEC is quite profitable in many scenarios at high H<sub>2</sub> prices, there are still a handful scenarios where little to no profit, or even losses, can occur.

Table 1 summarizes these histograms in terms of the percentage of profitable market scenarios for each technology at each H<sub>2</sub> price is available. This table highlights the large benefit of integrated systems (rSOC and SOFC + SOEC), even at low H<sub>2</sub> prices. Even at the DOE target price of 1.00 \$ kg<sup>-1</sup> H<sub>2</sub>, rSOC and SOFC + SOEC IESs are profitable in 54% and 46% of scenarios, respectively. Also, Table 1 reiterates that moving from NGCC systems to SOFC systems (both with 97% carbon capture) would result in significantly more profitable scenarios (from 13% with NGCC to 54% with SOFC). Finally, integrating current NGCC systems with an SOEC (NGCC + SOEC) results in profitability only when H<sub>2</sub> exceeds a price of 2.00 \$ kg<sup>-1</sup>,

Table 1 Percentage of LMP scenarios each process concept achieves positive annual profits aggregated by H<sub>2</sub> selling price

Process concept	1.00 \$ kg <sup>-1</sup>	1.50 \$ kg <sup>-1</sup>	2.00 \$ kg <sup>-1</sup>	2.50 \$ kg <sup>-1</sup>	3.00 \$ kg <sup>-1</sup>
NGCC	13%	13%	13%	13%	13%
SOFC	54%	54%	54%	54%	54%
NGCC + SOEC	8%	11%	16%	62%	80%
rSOC	54%	77%	97%	100%	100%
SOFC + SOEC	46%	79%	98%	100%	100%
SOEC	10%	49%	74%	87%	98%

indicating that simply adding an SOEC to an existing NGCC does not result in enough H<sub>2</sub> production to outweigh the capital investment at low H<sub>2</sub> prices.

### 3.3. Integrated IESs exploit multimodal LMP signals to increase profit

The increasing prevalence of VRE sources is shifting the distribution of LMPs away from Gaussian and similar unimodal distributions toward multimodal distributions with periods of very low<sup>76</sup> (near zero or negative) prices and extreme prices, resulting in LMP distributions with two local maxima rather than one. Fig. 2 box B (top right) contains a histogram depicting a multimodal price distribution of a LMP signal. In wholesale electricity markets, LMPs are determined by a market clearing process where projected demand is assessed and subsequently met in order of increasing cost.<sup>77,78</sup> This means low (or zero) marginal cost power production, like VRE sources (*e.g.*, solar and wind), are cleared before higher marginal cost resources (*e.g.*, NGCCs). The highest system marginal cost selected determines the LMP for a specific period. Specifically,

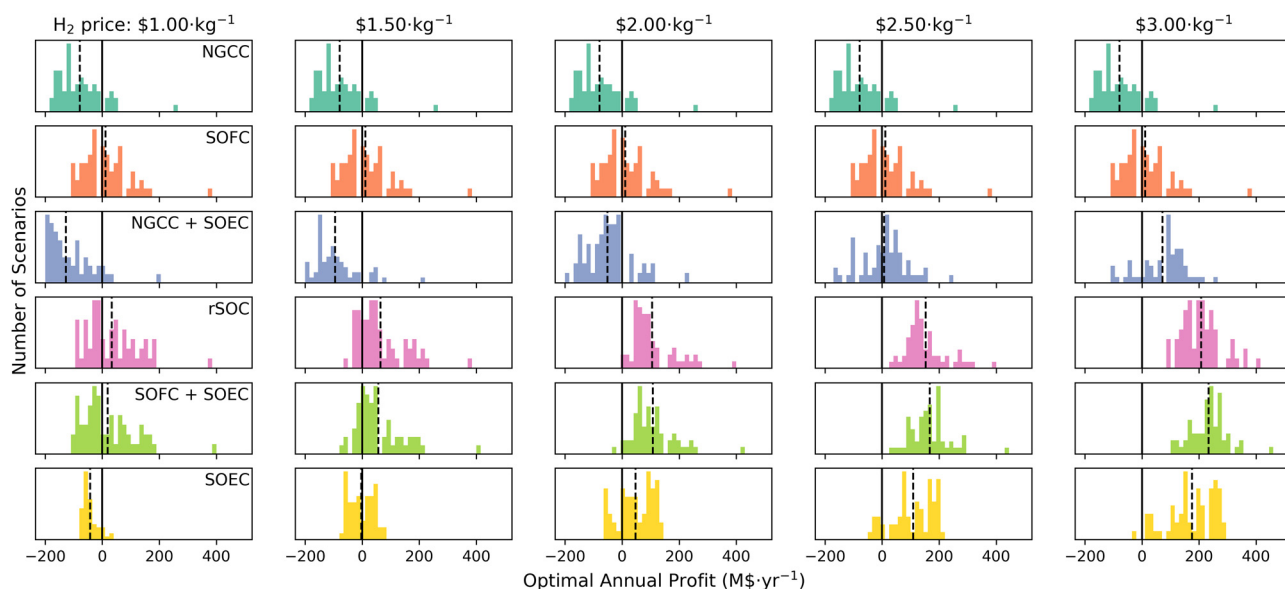


Fig. 5 Optimized annual profits for each process concept at each H<sub>2</sub> price presented as histograms. The height of the bars indicates how many scenarios achieve a profit in the range indicated by the horizontal axis profit values. Each column has the same H<sub>2</sub> price, and each row is the same technology. Break even lines (solid black) and mean profit over all scenarios for a given H<sub>2</sub> price and process concept (dashed line) are shown for reference. As H<sub>2</sub> price increases, system profitability increases for H<sub>2</sub> production.



under high VRE penetration, periods of ultra-low LMPs stem from abundant, low-cost renewable supply and high LMPs stem from limited supply of wind and solar, leaving only more expensive options to meet demand.<sup>79</sup> As states across the U.S. move toward achieving renewables portfolio standard targets, multimodal price signals could become more common. Thus, analyzing systems that thrive under these conditions is increasingly important.

In markets that are considered strongly multimodal (see Section S5, ESI<sup>†</sup>), there is a high concentration of low electricity prices and high electricity prices around distribution modes. The scenarios that exhibited multimodal behavior were future scenarios from the NREL (2035)<sup>56</sup> and Princeton (2030)<sup>59</sup> datasets where prediction of higher renewables penetration leads to periods of inexpensive, and sometimes negative, power costs (see Fig. 3, panel (c)) in addition to price spikes during peak hours. For market distributions visualization for 5 markets from each reference, see Fig. S16 (ESI<sup>†</sup>) (multimodal distributions in orange and unimodal in blue).

Fig. 6 shows that the integrated SOFC + SOEC IESs enjoy higher profits when compared with standalone process concepts (e.g., SOFC and SOEC, respectively) within the same price market. This benefit is amplified within multimodal price markets (Fig. 6, orange portion of bars). The benefit is amplified because the integrated system can take advantage of high electricity prices (produce power only) and low electricity prices (produce hydrogen only), whereas the standalone systems can only operate in a single product space. The conclusion of

integrated systems benefiting from multimodality generalizes also to the NGCC + SOEC system (see Fig. S17, ESI<sup>†</sup>).

Fig. 7 shows the strong correlation of all process concepts with mean LMP, except SOEC. For the integrated technologies (right side of Fig. 7), the benefit from the multimodal scenarios (orange stars) is much greater than the benefit of multimodality within the standalone systems (left side of Fig. 7). This is because both peaks of a multimodal price signal can be taken advantage of by the integrated systems, *i.e.*, H<sub>2</sub> production at low energy prices and power production at high energy prices. The standalone technologies can only take advantage of one of these peaks.


### 3.4. Linear regression predicts annual profit using market statistics across all scenarios

Finally, we train multivariate linear regression models to predict the maximum annual profit calculated from each optimization problem based on statistics of the input market data. Full regression coefficients (Table S5), feature correlation (Fig. S1), and methodological description (Sections S4 and S5) are available in the ESI<sup>†</sup>. Fig. 8 shows the parity between the regression model predictions (vertical axes) and rigorous market optimization results (horizontal axes). The high  $R^2$  values ranging from 0.88 to 0.99 and tight trending indicates a good fit. The SOEC (Fig. 8 bottom left) has a dip at lower profit values. This is explained because the lower bound (system always off) has total cost normalized at  $-0.82$ , resulting in a barrier in realizable losses even though the linear model predicts more losses.

Examination of the linear regression coefficients further bolsters three key conclusions from the figures above. First, the rSOC process concept is much more sensitive to carbon tax than the other systems, as shown in regression coefficient Table S5 (ESI<sup>†</sup>). This is seen in Fig. 4 and in ESI<sup>†</sup> Fig. S11–S14. At high hydrogen prices, electricity is more profitable to produce when the carbon tax is high, and at low hydrogen prices, electricity is more profitable to produce when carbon tax is low (note the power capacity factor, especially for the NREL (2035) reference). The integrated systems have less dependence because the feasible region to coproduce diminishes the benefit of single-product operation that the rSOC gains in these specific markets.

Second, the integrated process concepts (e.g., SOFC + SOEC and NGCC + SOEC) have a higher dependence on natural gas price. This can also be seen in Fig. 4 and ESI<sup>†</sup> Fig. S11–S14, where the scenarios with high natural gas price (see Fig. 3, 2022 prices) show high variability in production capacity factor. The higher variability in H<sub>2</sub> price for the 2022 scenarios leads to significantly higher dependence on natural gas price, which is a differentiating factor between the 2022 scenarios and other scenarios.

Lastly, H<sub>2</sub> price has a lower impact on rSOC profit than the other H<sub>2</sub>-producing process concepts. This is explained by coproducing IESs (e.g., SOFC + SOEC and NGCC + SOEC) and H<sub>2</sub> only IESs (e.g., SOEC standalone) have higher H<sub>2</sub> capacity factors. The rSOC system has market conditions where

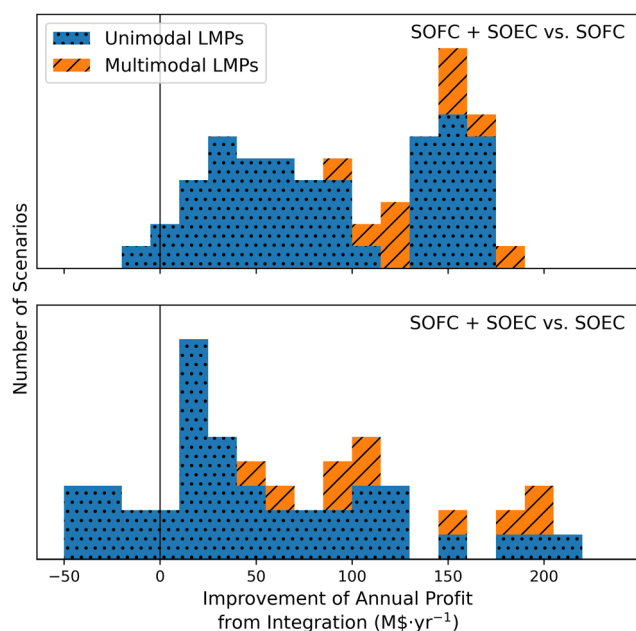

**Fig. 6** Here, the difference in optimized annual profits for standalone SOFC (top) and SOEC (bottom) process concepts when compared with the SOFC + SOEC integrated process concept is shown at a H<sub>2</sub> price of 2.00 \$ kg<sup>-1</sup>. The height of the bars indicates how many scenarios achieve a profit improvement through integration. Break even line is shown for reference (solid black). Multimodal scenarios are labeled differently to demonstrate that multimodal scenarios see large profit differences.



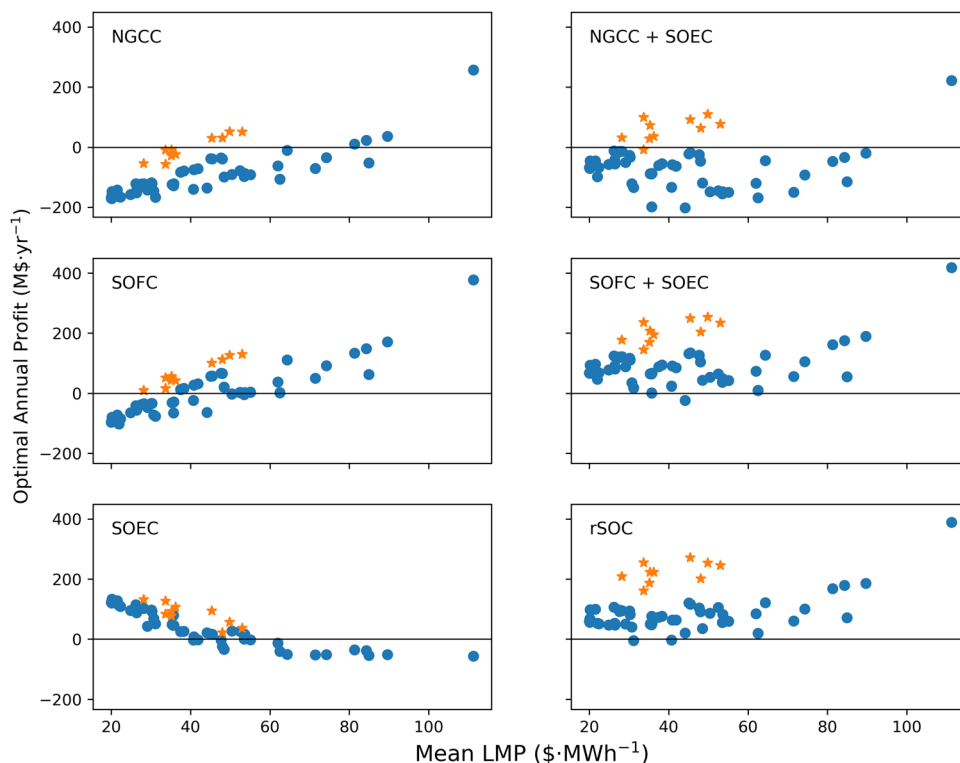


Fig. 7 Optimized annual profits for each technology at an  $\text{H}_2$  price of  $2.00 \text{ \$ kg}^{-1}$  plotted against the mean of the LMP signal distribution. The orange stars represent points that passed two multimodal tests and are considered multimodal, and the blue circles represents the markets that did not pass both tests. Higher mean LMP leads to higher profit in all process concepts except SOEC.

producing only power is better than  $\text{H}_2$  because the integrated systems can coproduce  $\text{H}_2$  using self-produced power, which can exceed the marginal benefit of purchasing power from the grid. These three conclusions justify holistic analysis that includes optimizing individual systems alongside regression or other comparative studies to uncover subtle conclusions.

### 3.5. Power and $\text{H}_2$ operational recommendations from marginal utility

From these results, we observe most units exhibit “on-and-off” dispatch. For a traditional thermal generator, it is either at full capacity (LMP is greater than the marginal cost of power) or off (LMP is less than the marginal cost of power). In Fig. S2–S8 (ESI<sup>†</sup>), we visualize the marginal cost for power and hydrogen for all the IESs. We hypothesize based on these data that it would be possible to extract simple heuristics that explain based on price when a unit should be producing power or hydrogen, coproduction, or neither, similar to the analysis in ref. 80.

## 4. Discussion

This analysis demonstrates the compelling advantages of co-generating electricity and  $\text{H}_2$  in a tightly coupled IES across diverse market scenarios. The economic performance of both NGCC and SOFC technologies is significantly enhanced through integration with  $\text{H}_2$  production, thereby creating a

promising path toward the production of low-cost, low-carbon  $\text{H}_2$  that aligns with the DOE’s hydrogen shot objective of achieving clean  $\text{H}_2$  for less than  $1.00 \text{ \$ kg}^{-1}$  within a decade.<sup>29</sup> The analysis reveals that the SOFC + SOEC system is profitable in 45% of the tested market scenarios with  $\text{H}_2$  capacity factors as high as 0.8 ( $>126 \text{ M kg year}^{-1}$  for a  $5.0 \text{ kg s}^{-1}$  capacity  $\text{H}_2$  system). Similarly, the rSOC could profitably sell  $\text{H}_2$  at a price point of  $1.00 \text{ \$ kg}^{-1}$  in 54% of the market scenarios, with  $\text{H}_2$  capacity factors as high as 0.68 ( $>107 \text{ M kg year}^{-1}$  for a  $5.0 \text{ kg s}^{-1}$   $\text{H}_2$  system). Moreover, one of the integrated systems that coproduce electricity and  $\text{H}_2$  – SOFC + SOEC or rSOC – is the top performer in 74% of the considered market scenarios. To summarize the entire analysis, Table 1 reports the percentage of LMP scenarios that achieve positive profits for each process concept and  $\text{H}_2$  selling price. These results clearly demonstrate the economic advantage of SOFC-IESs across a wide range of market scenarios. In addition, the IES concepts described herein enable higher annualized profits than similarly scaled SMR and ATR processes with CCS in scenarios with high natural gas prices (*i.e.*, all 2022 scenarios), multimodal electricity pricing (*i.e.*, all<sup>36</sup> scenarios), or unimodal electricity pricing scenarios with high carbon taxes (*e.g.*, all scenarios with a carbon tax of  $100 \text{ \$ tonne}^{-1}$  and greater) as can be seen in the supplemental spreadsheet. Though beyond this study’s scope, such systems’ value propositions could be enhanced even further through tax credits for carbon sequestration (45Q) and clean  $\text{H}_2$  production (45V).



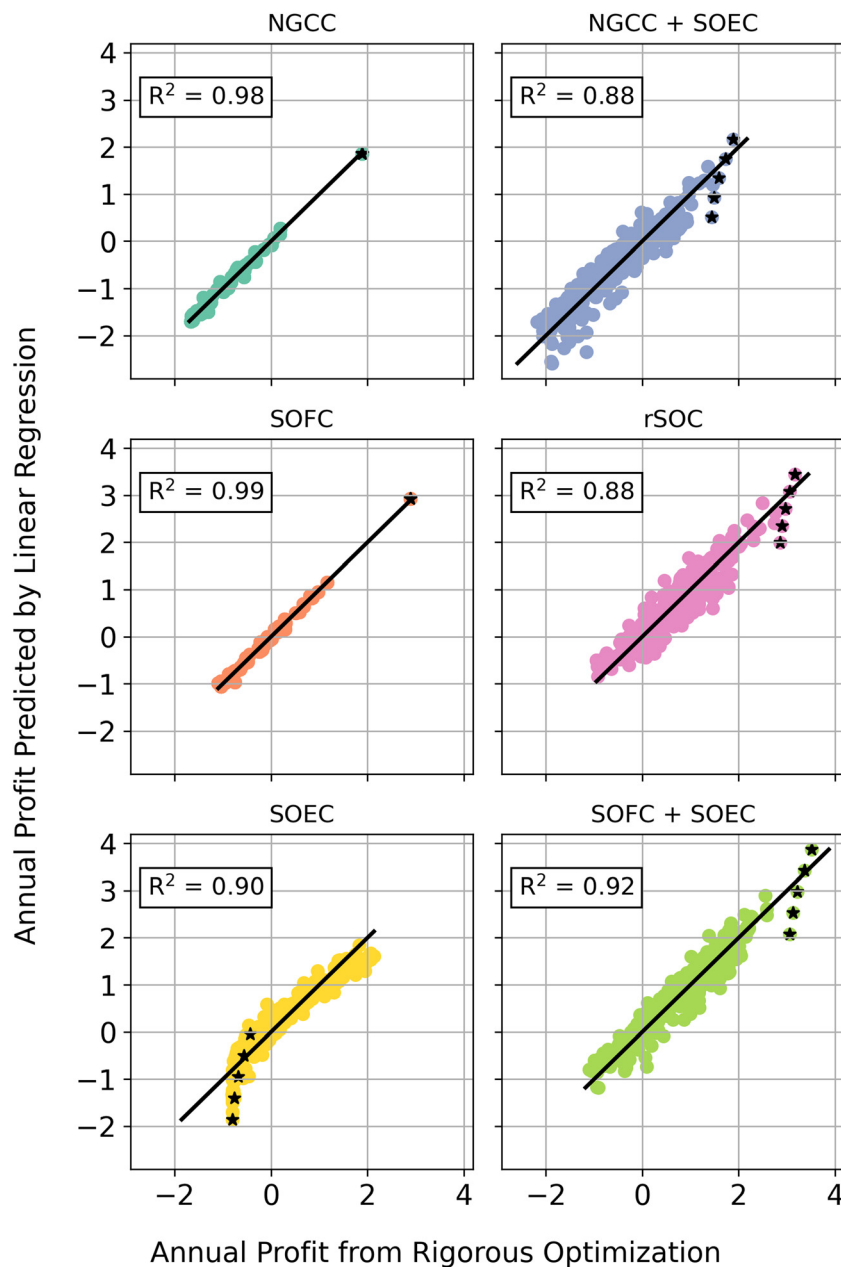


Fig. 8 Parity between linear regression model and market optimization results for all six process concepts. Black stars represent a market that appears to be an outlier: the NETL scenario with carbon tax of 250 \$ kg<sup>-1</sup> which results in high volatility and extreme prices.

Furthermore, the capabilities of our computational optimization framework have allowed us to directly compare a variety of process concepts and draw important conclusions. Along with these technology comparison results, we emphasize that this framework is generalizable beyond fuel cells, electrolysis, and even H<sub>2</sub>. The methodology we have employed, starting with detailed physics-based models (currently abundant in literature) or cost equations from any source and solving tractable market optimization problems, applies to many IES concepts with technologies including VRE sources, grid-scale storage, chemicals production, and residential heating and cooling. Based on our analysis, this work could be extended to explore the profitability of retrofit concepts instead

of new construction concepts. Extensions to our market model may include analyzing faster timescales, such as real-time markets or ancillary service markets where prices are more volatile,<sup>44,81,82</sup> and considering equipment degradation over longer time horizons.<sup>45,83,84</sup> Also, we only consider static H<sub>2</sub> selling prices (Section 2.4). One may improve this framework by including dynamic H<sub>2</sub> pricing alongside dynamic transportation and storage costs. Finally, embedding this framework within analyses that include impact of the IES participating in the market (*e.g.*, ref. 44) would improve the conclusions and prevent overestimating the benefit of emerging power generation and coproduction technologies.





## 5. Experimental procedures

### 5.1 Resource availability

**5.1.1 Lead contact.** Further information and requests for resources and materials should be directed to and will be fulfilled by the lead contact, Prof. Alexander Dowling (adowling@nd.edu).

**5.1.2 Materials availability.** This study did not generate new unique materials.

**5.1.3 Data and code availability.** Description and sources of all LMP data can be found in Section 3.4 of this work. A more detailed description of how internal price projections were made is included in Section S1 (ESI<sup>†</sup>). Additional information about the IES concept process modeling can be found in ref. 49. IES concept models were generated in the IDAES-PSE open-source modeling platform<sup>51</sup> version 2.0 which can be obtained for free on GitHub (<https://github.com/IDAES/idaes-pse>). Tools used for surrogate generation and market optimization modeling, including ALAMO version 2022.6.4, are available as part of the IDAES modeling platform. The market optimization model was built in Pyomo version 6.5.0 and solved using GAMS 41.3 with Dicopt 2. Visit <https://github.com/IDAES/publications/> for all code used to generate the results presented in this work.

## Disclaimer

This project was funded by the United States Department of Energy, National Energy Technology Laboratory, in part, through a site support contract. Neither the United States Government nor any agency thereof, nor any of their employees, nor the support contractor, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

## Author contributions

D. J. Laky formal analysis, writing – original draft, writing – review & editing, visualization. N. P. Cortes conceptualization, methodology, software, formal analysis, investigation, writing – original draft, writing – review & editing, visualization. J. C. Eslick conceptualization, methodology, software, formal analysis, investigation, data curation, writing – original draft, writing – review & editing. A. Noring conceptualization, methodology, software, writing – review & editing. N. Susarla conceptualization, methodology, software, writing – review & editing. C. Okoli conceptualization, methodology, software,

writing – review & editing. M. A. Zamarripa conceptualization, methodology, software, writing – review & editing. D. Allan conceptualization, methodology, software, writing – review & editing. J. H. Brewer methodology, software, data curation, resources, writing – original draft, writing – review & editing. A. K. S. Iyengar conceptualization, methodology, software, writing – review & editing. M. Wang formal analysis, software, writing – review & editing. A. P. Burgard conceptualization, methodology, writing – review & editing, supervision, project administration, funding acquisition. D. C. Miller conceptualization, project administration, funding acquisition, writing – review & editing. A. W. Dowling conceptualization, methodology, software, investigation, data curation, writing – original draft, writing – review & editing, visualization, supervision, project administration.

## Data availability

A summary of all results used to generate the figures in this manuscript is included as an excel file entitled ‘optimal\_summary\_SOFC\_results.xlsx’. The data included are summarized input conditions (*i.e.*, market signal used, technology being analyzed, carbon tax, *etc.*) and summarized outputs (*i.e.*, annualized net profit). In addition, a compiled version of the inputs for the problem (*i.e.*, energy system variables, LMP price signals for the 61 market scenarios, code for building and solving the optimization models) is available on GitHub: [https://github.com/djlaky/idaes-publications/tree/cortes\\_joule\\_plotting/cortes\\_et\\_al\\_2023](https://github.com/djlaky/idaes-publications/tree/cortes_joule_plotting/cortes_et_al_2023).

## Conflicts of interest

The authors declare that they have no conflict of interest.

## Acknowledgements

This work was conducted as part of the Institute for the Design of Advanced Energy Systems (IDAES) with support from the Simulation-Based Engineering and Reversible Solid Oxide Fuel Cells Programs within the U.S. Department of Energy's Office of Fossil Energy and Carbon Management. We also thank Dr Radhakrishna Tumbalam Gooty and Dr Jaffer Ghose at the National Energy Technology Laboratory for insightful feedback on this study.

## References

- 1 U. E. I. Administration, Annual Energy Outlook 2022, <https://www.eia.gov/outlooks/aeo/> Accessed January 10, 2023 (March 2022).
- 2 J.-B. Rosenkranz, C. B. Martinez-Anido and B.-M. Hodge, *Analyzing the impact of solar power on multi-hourly thermal generator ramping*, in 2016 IEEE Green Technologies Conference (GreenTech), IEEE, 2016, pp. 153–158.





- PR-5900-82933, National Renewable Energy Laboratory, Golden, CO (United States) (6 2022).
- 30 D. H. Chung, E. J. Graham, B. A. Paren, L. Schofield, Y. Shao-Horn and D. S. Mallapragada, Design space for pem electrolysis for cost-effective H<sub>2</sub> production using grid electricity, *Ind. Eng. Chem. Res.*, 2024, **63**(16), 7258–7270.
- 31 A. Hawkes and M. Leach, Solid oxide fuel cell systems for residential micro-combined heat and power in the UK: Key economic drivers, *J. Power Sources*, 2005, **149**, 72–83.
- 32 A. Behzadi, A. Habibollahzade, V. Zare and M. Ashjaee, Multi-objective optimization of a hybrid biomass-based SOFC/GT/double effect absorption chiller/RO desalination system with CO<sub>2</sub> recycle, *Energy Convers. Manage.*, 2019, **181**, 302–318.
- 33 M. Meratizaman, S. Monadzadeh and M. Amidpour, Techno-economic assessment of high efficient energy production (SOFC-GT) for residential application from natural gas, *J. Nat. Gas Sci. Eng.*, 2014, **21**, 118–133.
- 34 A. Habibollahzade, E. Gholamian, E. Houshfar and A. Behzadi, Multi-objective optimization of biomass-based solid oxide fuel cell integrated with stirling engine and electrolyzer, *Energy Convers. Manage.*, 2018, **171**, 1116–1133.
- 35 M. A. Haghghi, S. G. Holagh, A. Chitsaz and K. Parham, Thermodynamic assessment of a novel multi-generation solid oxide fuel cell-based system for production of electrical power, cooling, fresh water, and hydrogen, *Energy Convers. Manage.*, 2019, **197**, 111895.
- 36 T. Elmer, M. Worall, S. Wu and S. B. Riffat, Emission and economic performance assessment of a solid oxide fuel cell micro-combined heat and power system in a domestic building, *Appl. Therm. Eng.*, 2015, **90**, 1082–1089.
- 37 M. Gandiglio, A. Lanzini, P. Leone, M. Santarelli and R. Borchiellini, Thermo-economic analysis of large solid oxide fuel cell plants: Atmospheric vs. pressurized performance, *Energy*, 2013, **55**, 142–155.
- 38 M. Naeini, J. S. Cotton and T. A. Adams, Economically optimal sizing and operation strategy for solid oxide fuel cells to effectively manage long-term degradation, *Ind. Eng. Chem. Res.*, 2021, **60**(47), 17128–17142.
- 39 W. Shen, X. Chen, J. Qiu, J. A. Hayward, S. Sayeef, P. Osman, K. Meng and Z. Y. Dong, A comprehensive review of variable renewable energy levelized cost of electricity, *Renewable Sustainable Energy Rev.*, 2020, **133**, 110301.
- 40 U. Nissen and N. Harfst, Shortcomings of the traditional “levelized cost of energy” [LCOE] for the determination of grid parity, *Energy*, 2019, **171**, 1009–1016.
- 41 E. Veronese, G. Manzolini and D. Moser, Improving the traditional levelized cost of electricity approach by including the integration costs in the techno-economic evaluation of future photovoltaic plants, *Int. J. Energy Res.*, 2021, **45**(6), 9252–9269.
- 42 A. W. Dowling, T. Zheng and V. M. Zavala, Economic assessment of concentrated solar power technologies: A review, *Renewable Sustainable Energy Rev.*, 2017, **72**, 1019–1032.
- 43 D. J. Arent, S. M. Bragg-Sitton, D. C. Miller, T. J. Tarka, J. A. Engel-Cox, R. D. Boardman, P. C. Balash, M. F. Ruth, J. Cox and D. J. Garfield, Multi-input, multi-output hybrid energy systems, *Joule*, 2021, **5**(1), 47–58.
- 44 X. Gao, B. Knueven, J. D. Siirola, D. C. Miller and A. W. Dowling, Multiscale simulation of integrated energy system and electricity market interactions, *Appl. Energy*, 2022, **316**, 119017.
- 45 F. Sorourifar, V. M. Zavala and A. W. Dowling, Integrated multiscale design, market participation, and replacement strategies for battery energy storage systems, *IEEE Trans. Sustainable Energy*, 2018, **11**(1), 84–92.
- 46 G. Glenk and S. Reichelstein, Reversible power-to-gas systems for energy conversion and storage, *Nat. Commun.*, 2022, **13**, 2010, DOI: [10.1038/s41467-022-29520-0](https://doi.org/10.1038/s41467-022-29520-0).
- 47 G. Glenk, P. Holler and S. Reichelstein, Advances in power-to-gas technologies: cost and conversion efficiency, *Energy Environ. Sci.*, 2023, **16**, 6058–6070, DOI: [10.1039/D3EE01208E](https://doi.org/10.1039/D3EE01208E).
- 48 A. Iyengar, A. Noring, J. MacKay, D. Keairns and G. Hackett, Techno-economic analysis of natural gas fuel cell plant configurations, *Tech. Rep. DOE/NETL-2022/3259*, National Energy Technology Laboratory, Pittsburgh, PA, Morgantown, WV, Albany, OR (United States) (2022).
- 49 J. C. Eslick, A. Noring, N. Susarla, C. Okoli, D. Allan, M. Wang, J. Ma, M. Zamarripa, A. Iyengar and A. P. Burgard, *Technoeconomic evaluation of solid oxide fuel cell hydrogen-electricity co-generation concepts*, *Tech. Rep. DOE/NETL-2023/4322*, National Energy Technology Laboratory, Pittsburgh, PA (United States) (March 2023).
- 50 T. Schmitt, S. Leptinsky, M. Turner, A. Zoelle, C. White, S. Hughes, S. Homsy, M. Woods, H. Hoffman, T. Shultz and R. E. James, III, *Cost and performance baseline for fossil energy plants volume 1: Bituminous coal and natural gas to electricity*, *Tech. Rep. DOE/NETL-2023/4320*, National Energy Technology Laboratory, Pittsburgh, PA, Morgantown, WV, Albany, OR (United States) (2022).
- 51 A. Lee, J. H. Ghouse, J. C. Eslick, C. D. Laird, J. D. Siirola, M. A. Zamarripa, D. Gunter, J. H. Shinn, A. W. Dowling and D. Bhattacharyya, *et al.*, The IDAES process modeling framework and model library—Flexibility for process simulation and optimization, *J. Adv. Manuf. Process.*, 2021, **3**(3), e10095.
- 52 A. Cozad, N. V. Sahinidis and D. C. Miller, Learning surrogate models for simulation-based optimization, *AIChE J.*, 2014, **60**(6), 2211–2227.
- 53 J. Theis, *Quality Guidelines for Energy Systems Studies: Cost Estimation Methodology for NETL Assessments of Power Plant Performance*, *Tech. Rep. NETL-PUB-22580*, National Energy Technology Laboratory, Pittsburgh, PA, Morgantown, WV, Albany, OR (United States) (February 2021).
- 54 Hitachi Energy – Velocity Suite, ISO Real Time Day Ahead LMP Pricing – All Price Nodes Hourly (Non-Optimized), website, <https://www.hitachienergy.com/us/en/products-and-solutions/energy-portfolio-management/market-intelligence-services/velocity-suite> Accessed April 10, 2023 (2023).
- 55 U.S. Energy Information Administration, Natural gas – data, Website, [https://www.eia.gov/dnav/ng/ng\\_pri\\_sum\\_dcu\\_nus\\_m.htm](https://www.eia.gov/dnav/ng/ng_pri_sum_dcu_nus_m.htm) Accessed January 10, 2023.





- 56 S. Cohen and V. Durvasulu, *NREL Price Series Developed for the ARPA-E FLECCS Program*, Tech. Rep. NREL/TP-6A20-78195, National Renewable Energy Laboratory – Data (NREL-DATA), Golden, CO (United States) (December 2021).
- 57 J. Ho, J. Becker, M. Brown, P. Brown, I. Chernyakhovskiy, S. Cohen, W. Cole, S. Corcoran, K. Eurek, W. Frazier, P. Gagnon, N. Gates, D. Greer, P. Jadun, S. Khanal, S. Machen, M. Macmillan, T. Mai, M. Mowers, C. Murphy, A. Rose, A. Schleifer, B. Sergi, D. Steinberg, Y. Sun and E. Zhou, *Regional energy deployment system (reeds) model documentation (version 2020)*, Tech. Rep. NREL/TP-6A20-78195, National Renewable Energy Laboratory, Golden, CO (United States) (6 2021).
- 58 Energy Exemplar, Plexos, website, <https://www.energyexemplar.com/plexos> Accessed April 10, 2023.
- 59 J. D. Jenkins, S. Chakrabarti, F. Cheng and N. Patankar, Summary Report of the GenX and PowerGenome runs for generating Price Series (for ARPA-E FLECCS Project), DOI: [10.5281/zenodo.5765798](https://doi.org/10.5281/zenodo.5765798) (Dec. 2021).
- 60 J. D. Jenkins and N. A. Sepulveda, *Enhanced Design for a Changing Electricity Landscape: The GenX Configurable Electricity Resource Capacity Expansion Model*, Tech. Rep. MITEI-WP-2017-10, Massachusetts Institute of Technology Energy Initiative (MITeI), Cambridge, MA (November 2017).
- 61 Massachusetts Institute of Technology (MIT), PowerGenome, website, <https://github.com/PowerGenome/PowerGenome> Accessed April 10, 2023.
- 62 J. Brewer and K. Labarbara, *Quality Guideline for Energy Systems Studies: Guideline for Developing Security Constrained Unit Commitment and Dispatch Models for NETL Studies*, Tech. Rep. DOE/NETL-2019/1905, National Energy Technology Laboratory, Morgantown, WV (2021).
- 63 Electric Reliability Council of Texas, Report on the Capacity, Demand and Reserves in the ERCOT Region, 2022–2031, [https://www.ercot.com/files/docs/2021/12/29/CapacityDemandandReservesReport\\_December2021.pdf](https://www.ercot.com/files/docs/2021/12/29/CapacityDemandandReservesReport_December2021.pdf) Accessed January 10, 2023.
- 64 International Energy Agency, Global average levelised cost of hydrogen production by energy source and technology, 2019 and 2050 (2022).
- 65 E. Lewis, S. McNaul, M. Jamieson, M. S. Henriksen, H. S. Matthews, L. Walsh, J. Grove, T. Shultz, T. J. Skone and R. Stevens, *Comparison of commercial, state-of-the-art, fossil-based hydrogen production technologies*, Tech. Rep. DOE/NETL-2022/3241, National Energy Technology Laboratory, Pittsburgh, PA, Morgantown, WV, Albany, OR (United States) (April 2022).
- 66 S. McNaul, C. White, B. Wallace, T. Warner, H. S. Matthews, J. N. Ma, M. Ramezan, E. Lewis, D. Morgan, M. Henriksen, J. White, C. Munson, R. Stevens and T. Shultz, *Strategies for Achieving the DOE Hydrogen Shot Goal: Thermal Conversion Approaches*, Tech. Rep. DOE/NETL-2023/3824, National Energy Technology Laboratory, Pittsburgh, PA, Morgantown, WV, Albany, OR (United States) (January 2023).
- 67 U. D. of Energy, Pathways to commercial liftoff: Clean hydrogen, Tech. rep., US Department of Energy (2023).
- 68 D. Rajan and S. Takriti, *Minimum Up/Down Polytopes of the Unit Commitment Problem with Start-Up Costs*, Tech. Rep. W0506-050, IBM Research Division, Yorktown Heights, NY (United States) (06 2005). <https://dominoweb.draco.res.ibm.com/cdcb02a7c809d89e8525702300502ac0.html>.
- 69 J. Jalving, J. Ghouse, N. Cortes, X. Gao, B. Knueven, D. Agi, S. Martin, X. Chen, D. Guittet, R. Tumbalam-Gooty, L. Bianchi, K. Beattie, D. Gunter, J. D. Sirola, D. C. Miller and A. W. Dowling, Beyond price taker: Conceptual design and optimization of integrated energy systems using machine learning market surrogates, *Appl. Energy*, 2023, **351**, 121767.
- 70 I. Eisenberger, Genesis of bimodal distributions, *Technometrics*, 1964, **6**(4), 357–363.
- 71 T. R. Knapp, Bimodality revisited, *J. Mod. Appl. Stat. Methods*, 2007, **6**(1), 3.
- 72 J. A. Hartigan and P. M. Hartigan, The dip test of unimodality, *Ann. Stat.*, 1985, 70–84.
- 73 R. Pfister, K. A. Schwarz, M. Janczyk, R. Dale and J. B. Freeman, Good things peak in pairs: a note on the bimodality coefficient, *Front. Psychol.*, 2013, **4**, 700.
- 74 S. Institute, *SAS/STAT User's Guide: version 6*, SAS Institute Incorporated, 1990, vol. 2.
- 75 J. B. Freeman and R. Dale, Assessing bimodality to detect the presence of a dual cognitive process, *Behav. Res. Methods*, 2013, **45**, 83–97.
- 76 A. W. Dowling and V. M. Zavala, Economic opportunities for industrial systems from frequency regulation markets, *Comput. Chem. Eng.*, 2018, **114**, 254–264, DOI: [10.1016/j.compchemeng.2017.09.018](https://doi.org/10.1016/j.compchemeng.2017.09.018), fOCAPO/CPC 2017.
- 77 K. Imran and I. Kockar, A technical comparison of wholesale electricity markets in north america and europe, *Electr. Power Syst. Res.*, 2014, **108**, 59–67, DOI: [10.1016/j.epsr.2013.10.016](https://doi.org/10.1016/j.epsr.2013.10.016).
- 78 A. W. Dowling, R. Kumar and V. M. Zavala, A multi-scale optimization framework for electricity market participation, *Appl. Energy*, 2017, **190**, 147–164, DOI: [10.1016/j.apenergy.2016.12.081](https://doi.org/10.1016/j.apenergy.2016.12.081).
- 79 R. B. Hytowitz, B. Frew, G. Stephen, E. Ela, N. Singhal, A. Bloom and J. Lau, *Impacts of price formation efforts considering high renewable penetration levels and system resource adequacy targets*, Tech. Rep. NREL/TP-6A20-74230, National Renewable Energy Laboratory, Golden, CO (United States) (2020).
- 80 M. Watson, A. Veronese da Silva, P. G. Machado, C. D. O. Ribeiro, C. A. Oller de Nascimento and A. Dowling, *The case for bio-jet fuel from bioethanol in brazil: An optimization-based analysis using historical market data*, *ChemRxiv*, 2024, preprint. , DOI: [10.26434/chemrxiv-2024-j519x](https://doi.org/10.26434/chemrxiv-2024-j519x).
- 81 A. W. Dowling, R. Kumar and V. M. Zavala, A multi-scale optimization framework for electricity market participation, *Appl. Energy*, 2017, **190**, 147–164.
- 82 A. W. Dowling and V. M. Zavala, Economic opportunities for industrial systems from frequency regulation markets, *Comput. Chem. Eng.*, 2018, **114**, 254–264.





- 83 H. Lai, N. F. Harun, D. Tucker and T. A. Adams II, Design and eco-technoeconomic analyses of sofc/gt hybrid systems accounting for long-term degradation effects, *Int. J. Hydrogen Energy*, 2021, **46**(7), 5612–5629.
- 84 M. Naeini, J. S. Cotton and T. A. Adams II, Dynamic life cycle assessment of solid oxide fuel cell system considering long-term degradation effects, *Energy Convers. Manage.*, 2022, **255**, 115336.

